


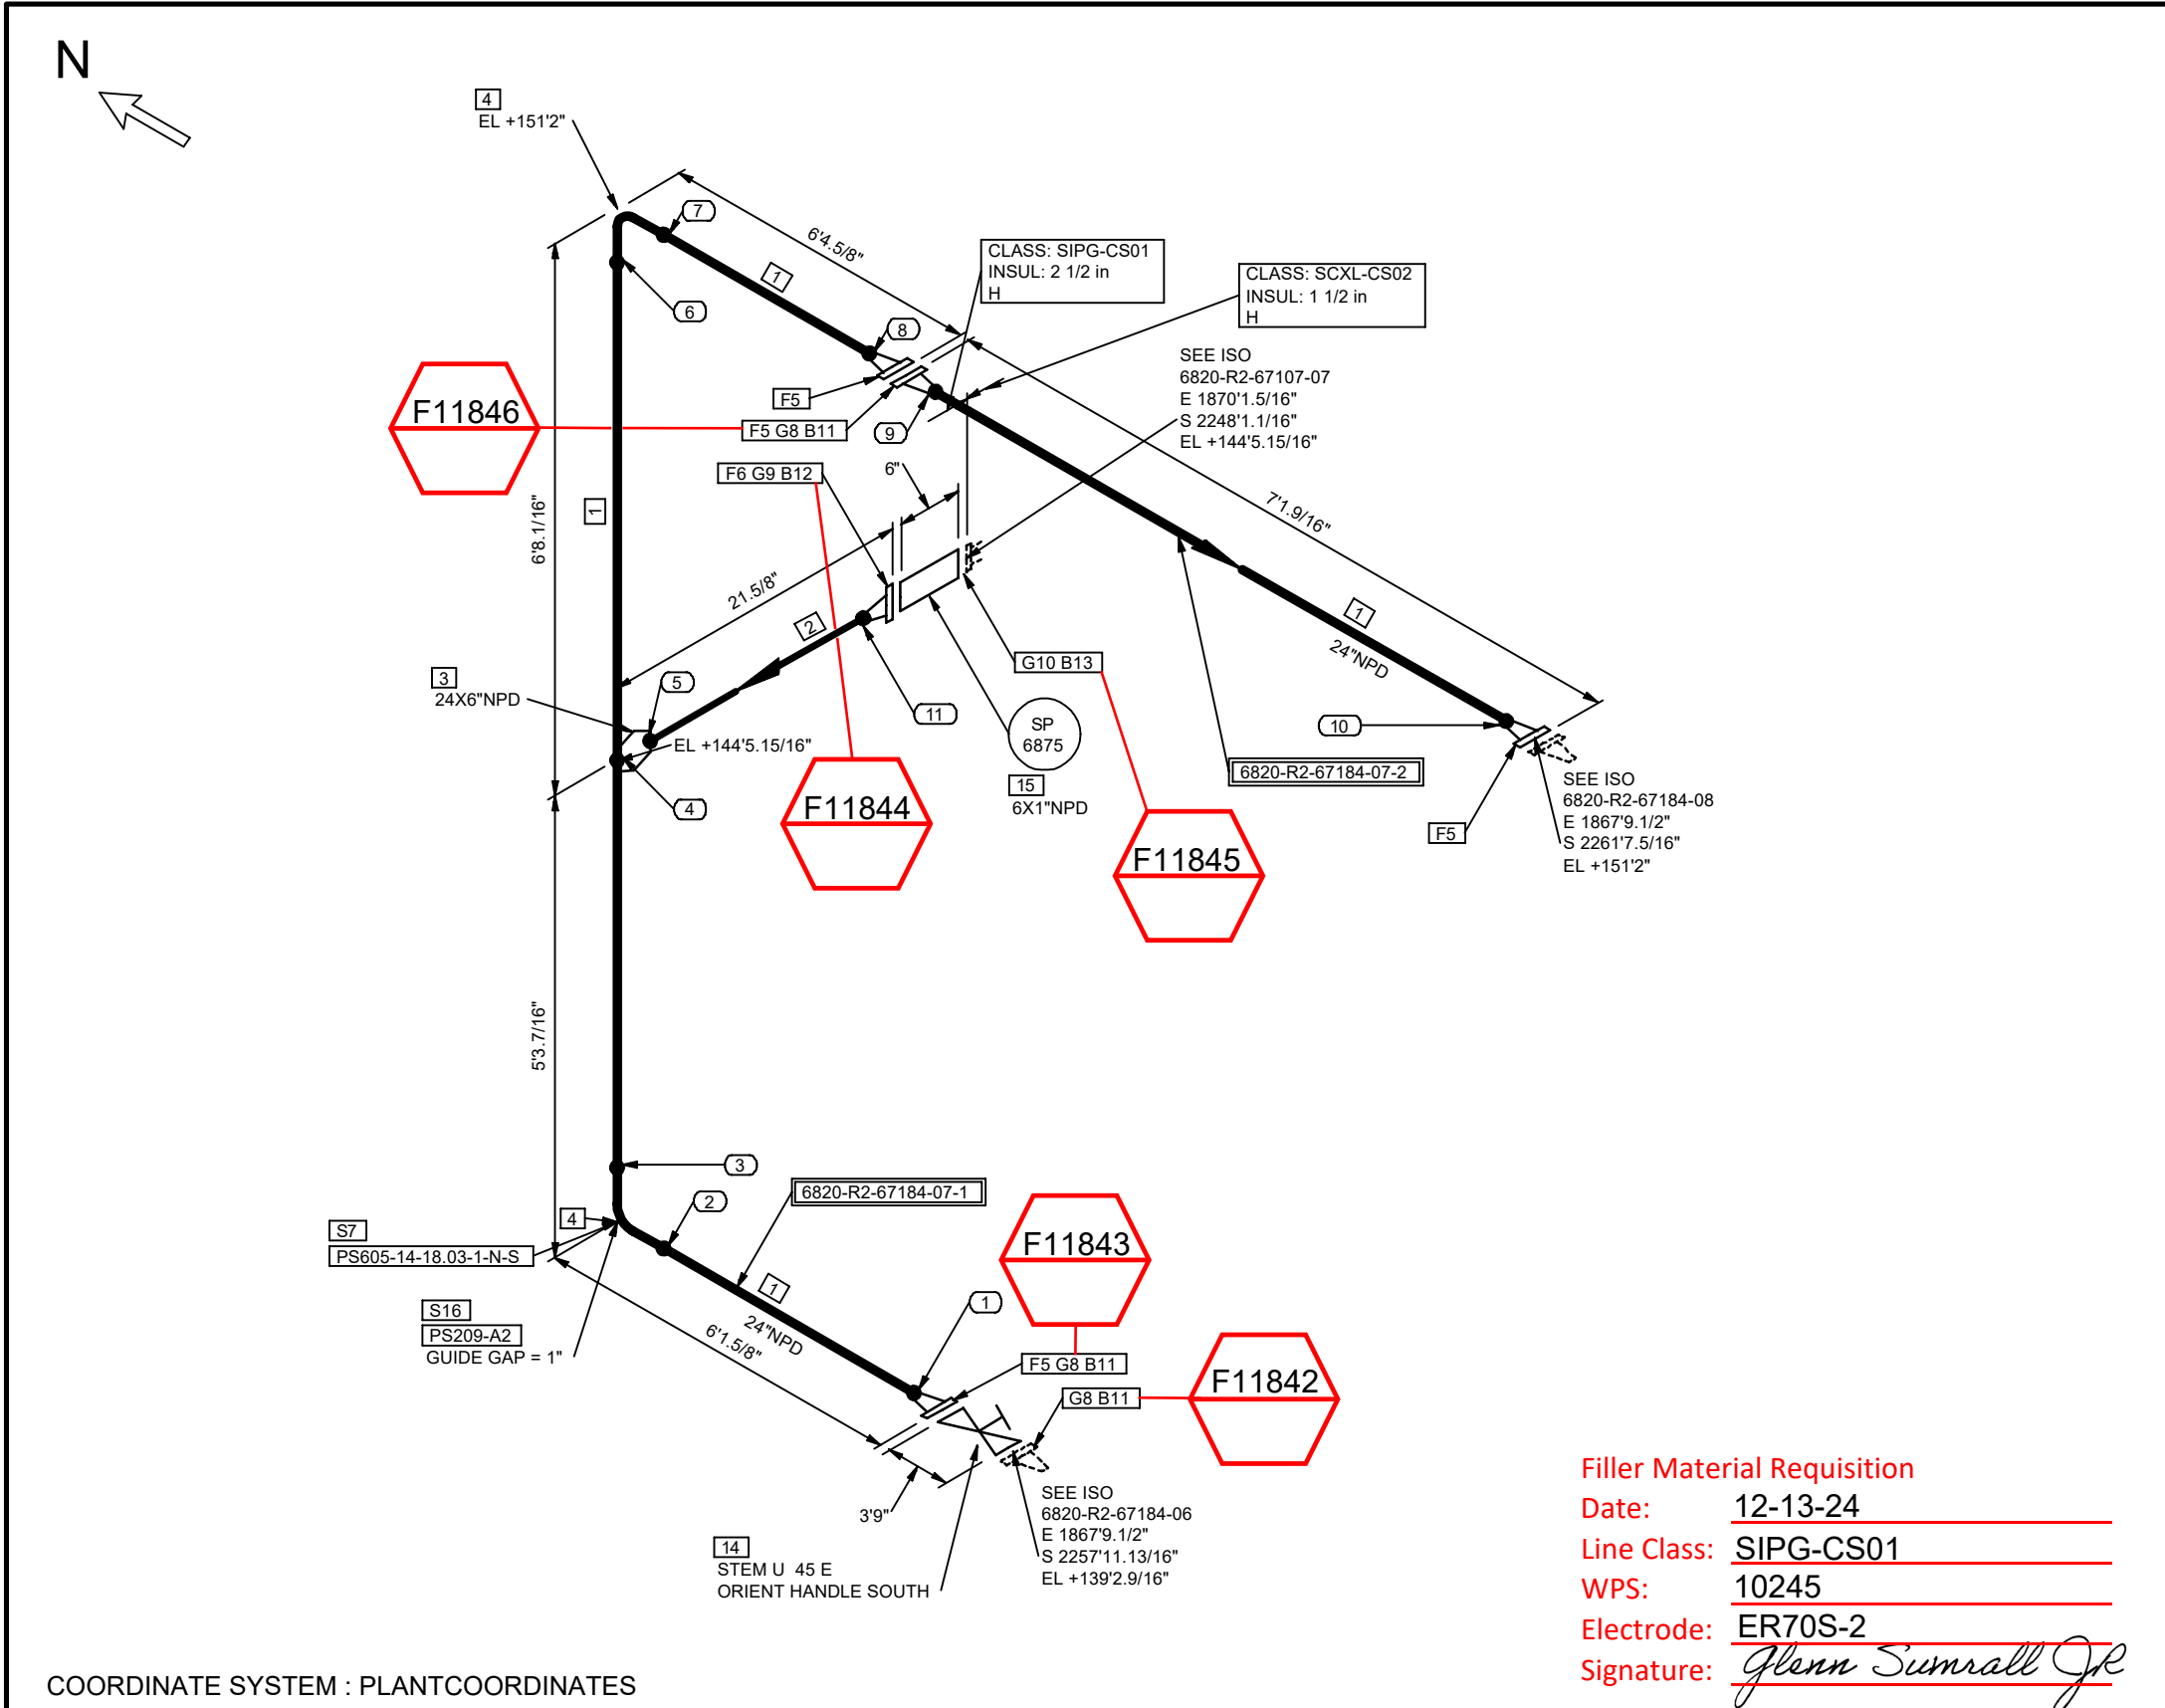

SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
1	24	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP0AN0E	17.4 '
2	6	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP00336	0.3 '
3	24X6	Weldolet, MSS SP-97, ASTM A105N, BW Ends, -, S-STD	C2HYB2F	1
4	24	90° Elb LR, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, -, S-STD	CDB66GJA	2
5	24	WN Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/BW End, -, S-STD	CFG6WKNU	4
6	6	WN Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/BW End, -, S-STD	CFG6WKU7	1
PIPE SUPPORTS				
7	24	PS605-14-18.03-1-N-S	PS605	1
OTHER THAN SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
8	24	SW Gk, AISI 304/Graphite, 300 Lbs, RF as per ASME B16.5, Thk=1/8in, -, -,	CGKFEG67	3
9	6	SW Gk, AISI 304/Graphite, 300 Lbs, RF as per ASME B16.5, Thk=1/8in, -, -,	CGKFEG6E	1
10	1	SW Gk, AISI 304/Graphite, 300 Lbs, RF as per ASME B16.5, Thk=1/8in, -, -,	CGKFEG5V	1
11	1.1/2	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 9.25 in. Length	C6S4K8MD	72
12	3/4	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 5 in. Length	C6S4K8BF	12
13	5/8	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3 in. Length	C6S4K88N	4
14	24	Gat Flg, -, API 600, ASTM A216 Gr.WCB, 300 Lbs, RF, Ends as per ASME B16.5, GO,-, Valve Tag: VG-4	C7J7XW33	1
INSTRUMENTS				
15	6X1	SP-6875	SP-6875	1
PIPE SUPPORTS				
16	24	PS209-A2	PS209	1
PIECE MARKS				
6820-R2-67184-07-1 6820-R2-67184-07-2				
Turner Industries Group, LLC Received November 12, 2024 DOCUMENT CONTROL				
SERVICE: R2	VAPOR/LIQUID: V	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y
FIELD: Y	PAINT CODE: Per LDT	MODULE: -		
		P&ID: 202998C-001-PID-0021-0320		
UNIT#: 6800	EWPA AREA: 6820	SPEC: SIPG-CS01	STRESS CALC #: CN-0023	
LINE No. 24"-R2-67184-SIPG-CS01-H				
OxyChem Redstone Battleground PROJECT			DRAWING NUMBER 6820-R2-67184-07	
			REV.	0

NOTES:

- FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
- FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
- FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
- FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
- ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
- FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
- REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

T.EN **TECHNIP ENERGIES**

Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

0	2024-12-06	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD

