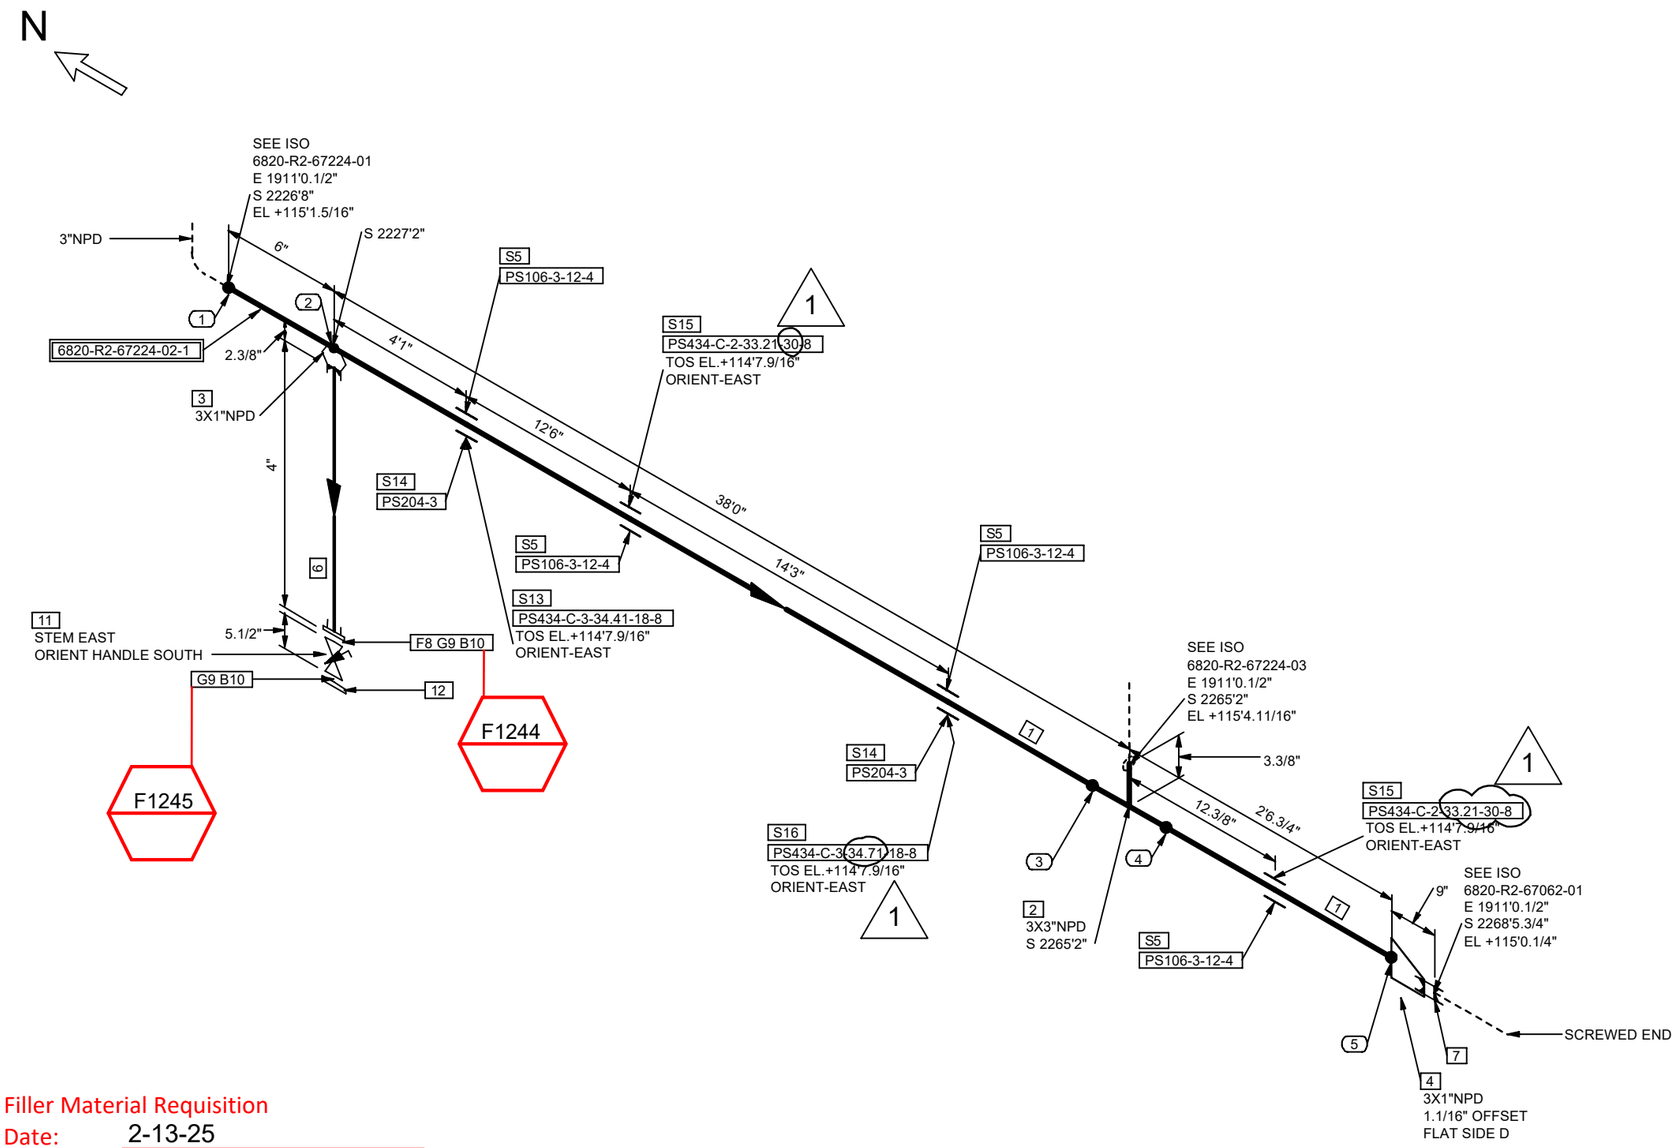

Filler Material Requisition

Date: 2-13-25

Line Class: EPCL-SS01

WPS: 802

Electrode: ER308L

Signature: Glenn Sumrall Jr

COORDINATE SYSTEM : PLANTCOORDINATES

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	3	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP304L, BE, -, -, S-10S	CPP6WN1S	40.5 '
2	3X3	Eq Te, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -,Annealed, S-10S	C6SEUHT5	1
3	3X1	Threadolet, ASTM A182 Gr.F304L, 3000 Lbs, NPTF Ends, -, Annealed,	C7BP7RMA	1
4	3X1	Eccentric swage, MSS SP-95, ASTM A403 Gr.WP304L,BE/NPTM End,-, Annealed, S-10S x S-80S	C7BP5PBR	1
		PIPE SUPPORTS		
5	3	PS106-3-12-4	PS106	4

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
6	1	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP304L, NPTM Ends, w/ coupling, -, S-80S	C76KFFTD	0.4 '
7	1	Full Coup, ASME B16.11, ASTM A182 Gr.F304L, 3000 Lbs, NPTF Ends, Annealed,	C7BP51NV	1
8	1	THD Flg, ASME B16.5, ASTM A182 Gr.F304L, 150 Lbs, RF/NPTF End, Annealed,	C7W2U48L	1
9	1	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C7CT1ZFH	2
10	1/2	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, -2.75 in. Length	C6S4K87U	8
11	1	Plug Flg,SP, Tapered Plug, Non Lubricated, API 599, ASTM A351 Gr.CF8M, 150 Lbs, RF, Ends as per ASME B16.5, -, LO,-, -, Valve Tag: PL-0548	C76KHSRR	1
12	1	Bld Flg, ASME B16.5, ASTM A182 Gr.F304L, 150 Lbs, RF, Annealed,	C7W2U478	1
		PIPE SUPPORTS		
13	3	PS434-C-3-34.41-18-8	PS434	
14	3	PS204-3	PS204	
15	3	PS434-C-2-33.21-30-8	PS434	
16	3	PS434-C-3-34.71-18-8	PS434	

PIECE MARKS

6820-R2-67224-02-1

Turner Industries Group, LLC
Received
FEBRUARY 13,2025
DOCUMENT CONTROL

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

T.EN TECHNIP ENERGIES

information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client.use of this information is restricted in accordance with conditions specified by the contract.Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
1	2025-01-31	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
0	2024-07-18	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	BRD	GR

SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:
R2	L	Per LDT	Per LDT	Y	Y	Per LDT	-

OXY

OxyChem Redstone Battleground
PROJECT

P&ID: 202998C-001-PID-0021-0331

UNIT#:	EWP AREA:	SPEC:	STRESS CALC #:
6800	6820	EPCL-SS01	-

LINE No. 3"-R2-67224-EPCL-SS01-H

DRAWING NUMBER: 6820-R2-67224-02

REV.: 1

29 JAN 2025 00:20