


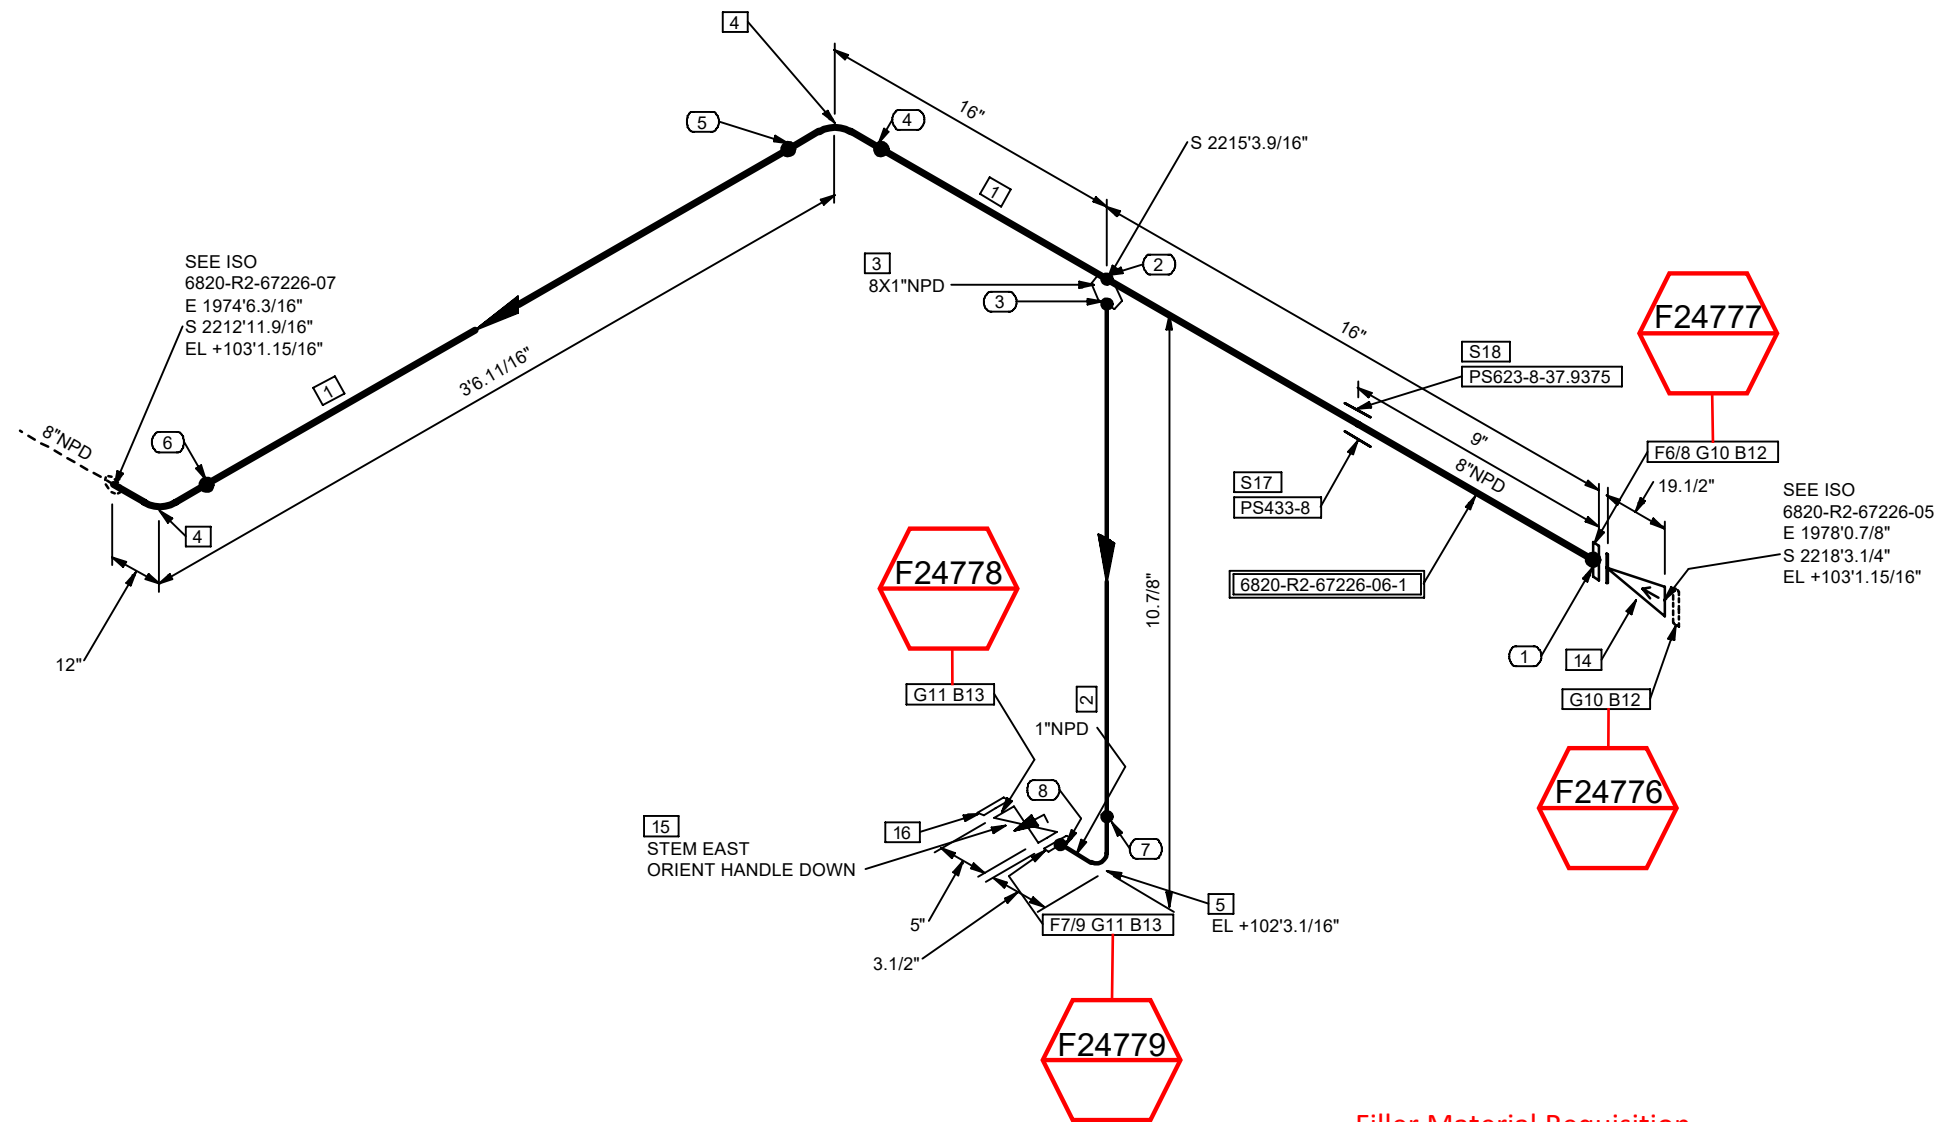

Filler Material Requisition

Date: 11-12-24
Line Class: NOHD-SS03
WPS: 802
Electrode: ER308L
Signature: *Glenn Sumrall Jr*

COORDINATE SYSTEM : PLANTCOORDINATES

NOTES:

- FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
- FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
- FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
- FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
- ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
- FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
- REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTD	STRESS	APRVD
0	2024-11-08	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR

SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
1	8	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP304L, BE, -, -, S-10S	C7FCT25	2.9 '
2	1	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP304L, BE, -, -, S-40S	C275NB8F	0.4 '
3	8X1	Weldolet, MSS SP-97, ASTM A182 Gr.F304L, BW Ends, Annealed, S-10S x S-40S	C80RJVV0	1
4	8	90° Elb LR, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -Annealed, S-10S	C6SEUJRF	2
5	1	90° Elb LR, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -Annealed, S-40S	C80RG22P	1
6	8	LJ Flg, ASME B16.5, ASTM A105 Galv. as per ASTM A153, 150 Lbs, FF, -,	C26WFFFR	1
7	1	LJ Flg, ASME B16.5, ASTM A105 Galv. as per ASTM A153, 150 Lbs, FF, -,	C26WFFF7	1
MISCELLANEOUS COMPONENTS				
8	8	Stub SP, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -Annealed, x S-10S	C8A5BL7M	1
9	1	Stub SP, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -Annealed, x S-40S	C8A5BKT4	1
OTHER THAN SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
10	8	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -,	C6SBWZF4	2
11	1	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -,	C6S4K87F	2
12	3/4	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 4.75 in. Length	C6S4K8BE	16
13	1/2	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 2.75 in. Length	C6S4K87U	8
14	8	SwgChk Flg, ASME B16.34, ASTM A351 Gr.CF8M, 150 Lbs, RF, Ends as per ASME B16.5, -, Valve Tag: CH-0276	C76KHSRG	1
15	1	Plug Flg.SP, Tapered Plug, Non Lubricated, API 599, ASTM A351 Gr.CF8M, 150 Lbs, RF, Ends as per ASME B16.5, -, LO, -, -, Valve Tag: PL-0548	C76KHSRR	1
16	1	Bld Flg, ASME B16.5, ASTM A182 Gr.F304L, 150 Lbs, RF, Annealed,	C7W2U478	1
PIPE SUPPORTS				
17	8	PS433-8	PS433	1
18	8	PS623-8-37.9375	PS623	1
PIECE MARKS				
6820-R2-67226-06-1				



SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:	
R2	L	Per LDT	Per LDT	Y	Y	Per LDT	-	
				P&ID:				
				202998C-001-PID-0021-0338				
				UNIT#:	EWP AREA:	SPEC:	STRESS CALC #:	
				6800	6820	NOHD-SS03	CN-0129	
				LINE No:				
OxyChem Redstone Battleground PROJECT				8"-R2-67226-NOHD-SS03-P				
				DRAWING NUMBER				
				6820-R2-67226-06				
						REV.		
						0		

