


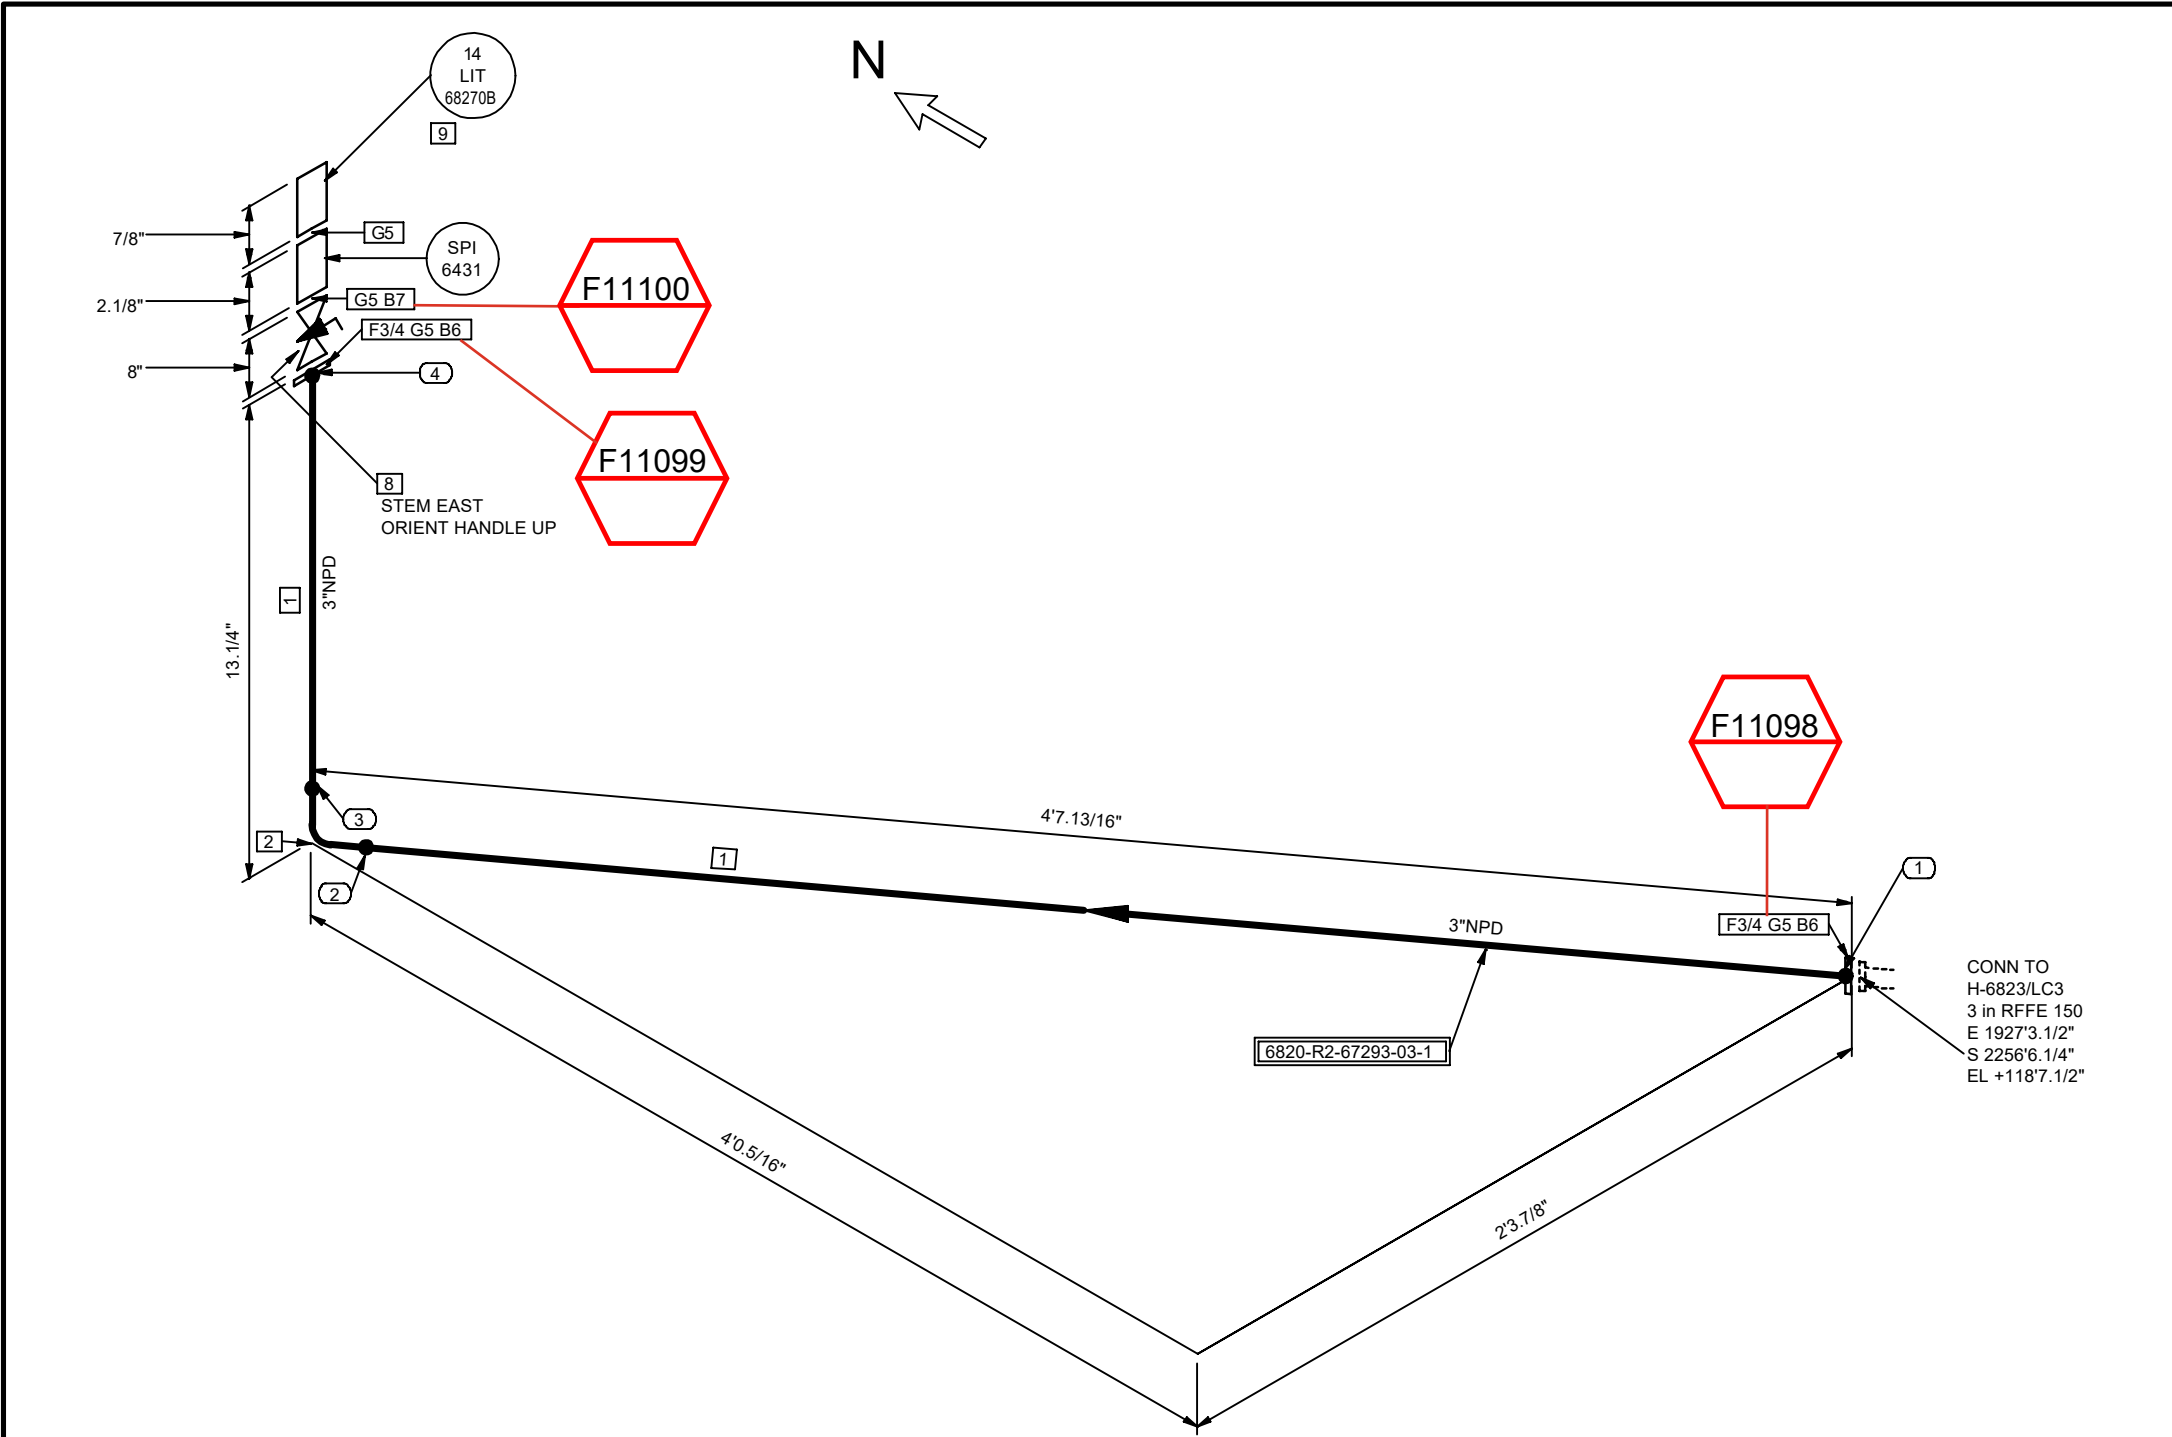

Filler Material Requisition
Date: 12-3-24
Line Class: NOHD-SS01
WPS: 802
Electrode: ER316L
Signature: *Glenn Sumrall Jr*

COORDINATE SYSTEM : PLANTCOORDINATES

- NOTES:
- 1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
 - 2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
 - 3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
 - 4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
 - 5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
 - 6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
 - 7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

0	2024-11-22	RVA	ISSUED FOR CONSTRUCTION			SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION			CHKD	MTO	STRESS	APRVD

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	3	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP316L, BE, -, -, S-10S	CPP5F8Z6	4.6'
2	3	90° Elb LR, Seamless, ASME B16.9, ASTM A403 Gr.WP316L, BW Ends, -, Annealed, S-10S	C6SDP2MF	1
3	3	LJ Flg, ASME B16.5, ASTM A105 Galv. as per ASTM A153, 150 Lbs, FF, -,	C26WFFFK	2

MISCELLANEOUS COMPONENTS

4	3	Stub SP, Seamless, ASME B16.9, ASTM A403 Gr.WP316L, BW Ends, -, Annealed, x S-10S	C8A57RYL	2
---	---	---	----------	---

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
5	3	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -,	C6S4K87L	4
6	5/8	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3.75 in. Length	C6S4K88S	8
7	5/8	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 6 in. Length	C6S4K891	4
8	3	Plug Flg, SP, Tapered Plug, Non Lubricated, API 599, ASTM A351 Gr.CF8M, 150 Lbs, RF, Ends as per ASME B16.5, -, LO, -, -, Valve Tag: PL-0548	C6SDVYL1	1

INSTRUMENTS

9	3	14-LIT-68270B	14-LIT-68270B	1
---	---	---------------	---------------	---

PIECE MARKS

6820-R2-67293-03-1

Turner Industries Group, LLC
Received
DECEMBER 03, 2024
DOCUMENT CONTROL

SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:
R2	L	Per LDT	Per LDT	Y	Y	Per LDT	-

OxyChem Redstone Battleground PROJECT

P&ID:
202998C-001-PID-0021-0326

UNIT#:	EWPA AREA:	SPEC:	STRESS CALC #:
6800	6820	NOHD-SS01	-

LINE No:
3"-R2-67293-NOHD-SS01-H

DRAWING NUMBER	REV.
6820-R2-67293-03	0

