



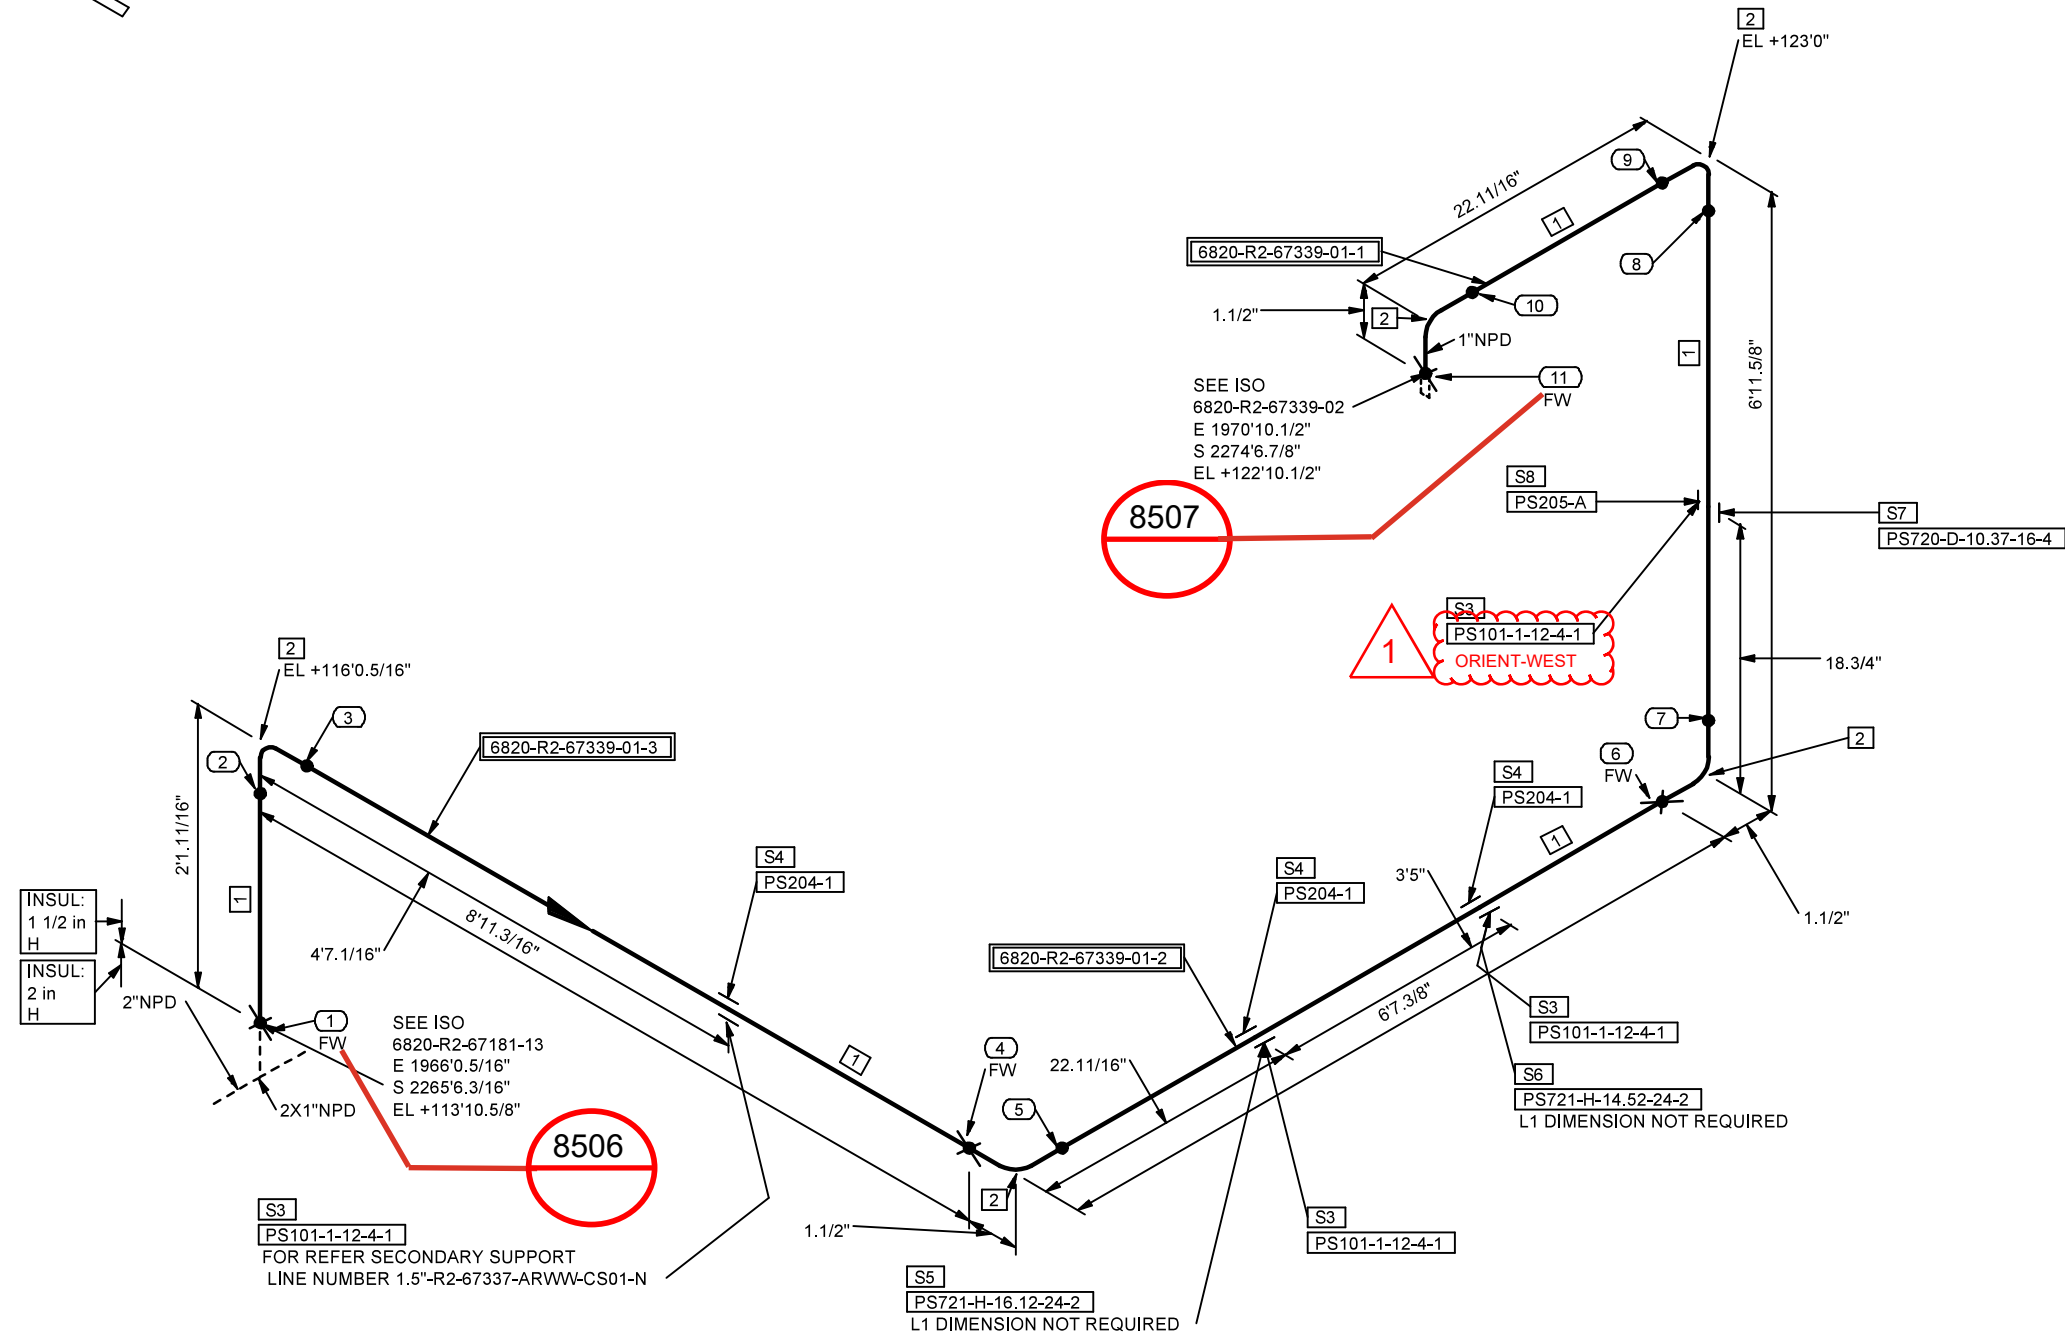

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



1	2025-03-21	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
0	2024-12-27	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTD	STRESS	APRVD

N0	NPD	DESCRIPTION	IDENT	QTY
1	1	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-XS	C2UE2BC	25.7
2	1	90° Elb LR, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, -, S-XS	C2UE473	5

3	1	PS101-1-12-4-1	PS101	4
---	---	----------------	-------	---

NO	NPD	DESCRIPTION	IDENT	QTY
----	-----	-------------	-------	-----

4	1	PS204-1	PS204	3
5	1	PS721-H-16.12-24-2	PS721	1
6	1	PS721-H-14.52-24-2	PS721	1
7	1	PS720-D-10.37-16-4	PS720	1
8	1	PS205-A	PS205	1

6820-R2-67339-01-1 6820-R2-67339-01-2 6820-R2-67339-01-3

Date: 3-27-25
Line Class: SLPG-CS01
WPS: 10245
Electrode: ER70S-2
Signature: *Pedro Morin*



SERVICE: R2	VAPOR/LIQUID V	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -
				P&ID: 202998C-001-PID-0021-0335			
				UNIT#: 6800	EWMP AREA: 6820	SPEC: SLPG-CS01	STRESS CALC #: -
				LINE No. 1"-R2-67339-SLPG-CS01-H			
				DRAWING NUMBER 6820-R2-67339-01			
OxyChem Redstone Battleground PROJECT				REV. 1			