


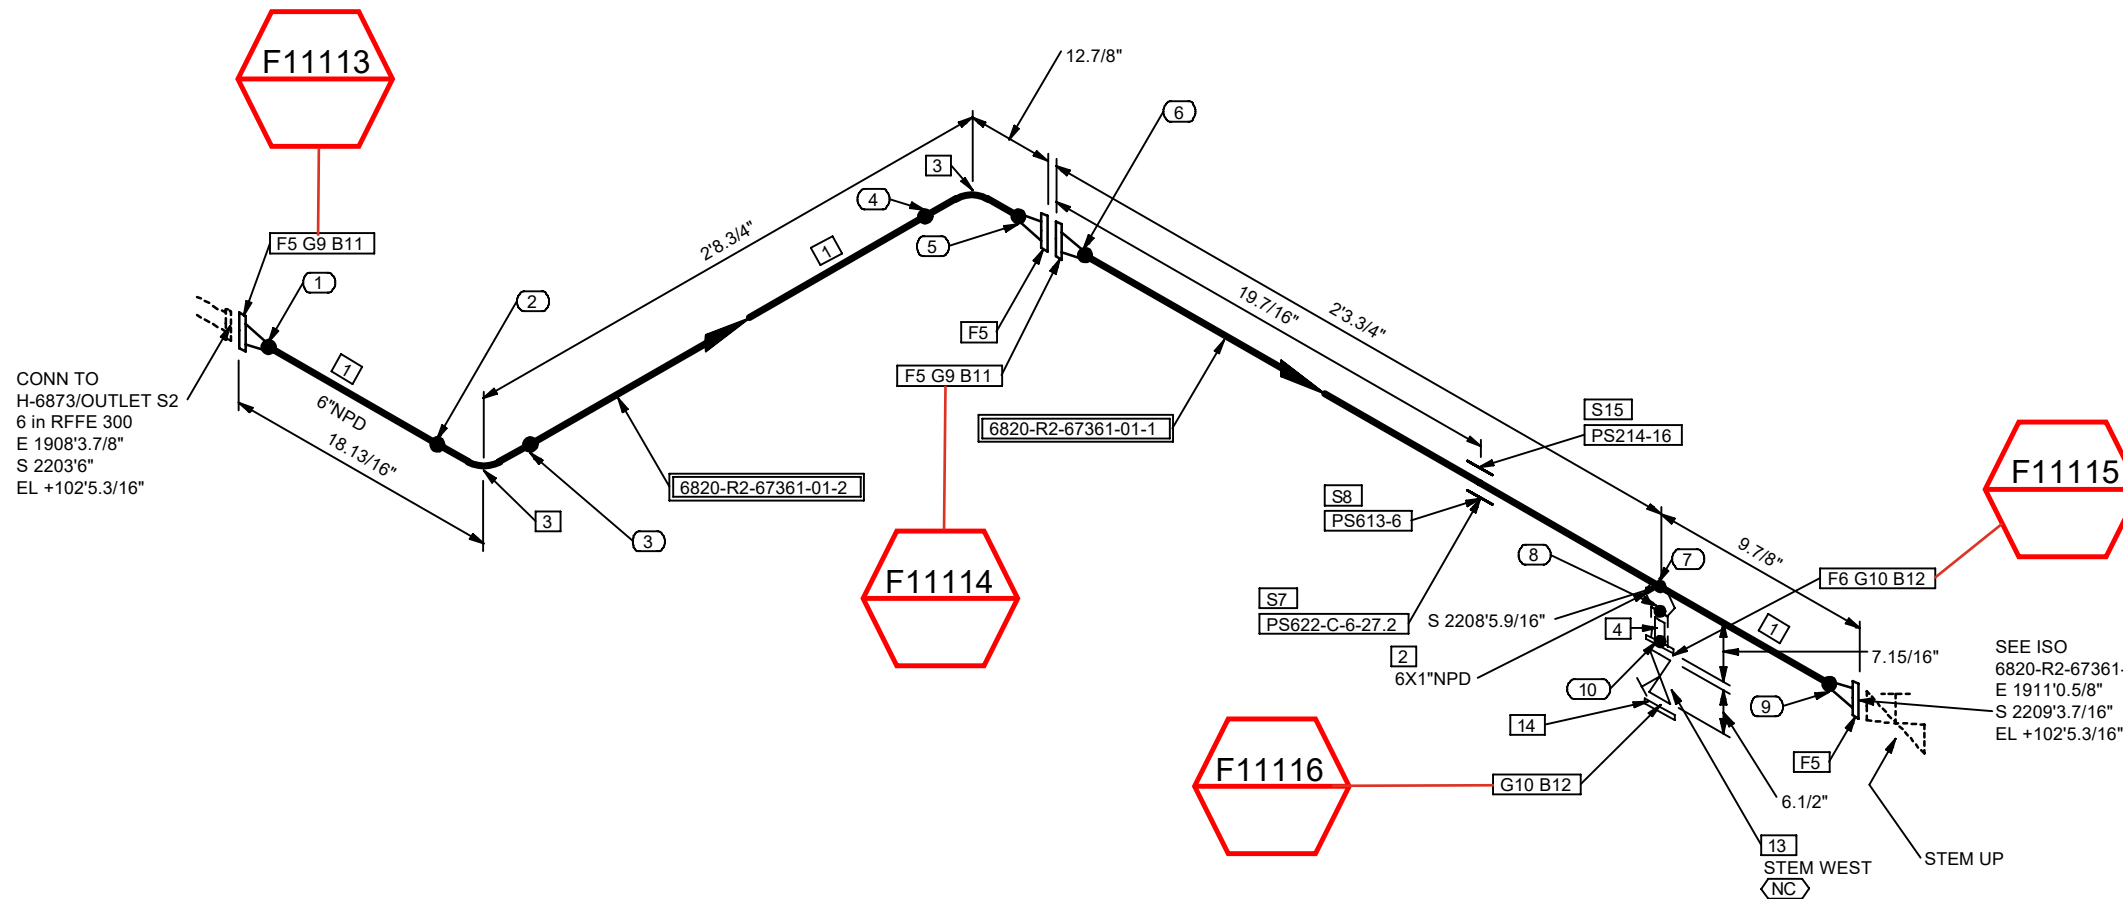

Filler Material Requisition

Date: 12-3-24

Line Class: SCXL-CS02

WPS: 10245

Electrode: ER70S-2

Signature: *Glenn Sumrall Jr*



0	2024-11-15	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APPRVD

OTHER THAN SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
9	6	NM Flat Gk, Barium Sulfate filled PTFE, 300 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -	C7CX7CST	2
10	1	NM Flat Gk, Barium Sulfate filled PTFE, 300 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -	C7W3AL3L	2
11	3/4	SBlT 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 5 in. Length	C6S4K8BF	24
12	5/8	SBlT 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3 in. Length	C6S4K88N	8
13	1	Gat Flg, -, API 602, ASTM A105N, 300 Lbs, RF, Ends as per ASME B16.5, HO, -, Valve Tag: GA-1127	C99ZZ9DE	1
14	1	Bld Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF, -	CFG6WM6Z	1
<u>PIPE SUPPORTS</u>				
15	6	PS214-16	PS214	1

PIECE MARKS

Turner Industries Group, LLC
Received
DECEMBER 03, 2024
DOCUMENT CONTROL

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

SERVICE: R2	VAPOR/LIQUID: L	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -
				P&ID: 202998C-001-PID-0021-0325			
				UNIT#: 6800	SWP AREA: 6820	SPEC: SCXL-CS02	STRESS CALC #: CN-0394
				LINE No. 6"-R2-67361-SCXL-CS02-H			
				OxyChem Redstone Battleground PROJECT			DRAWING NUMBER 6820-R2-67361-01