



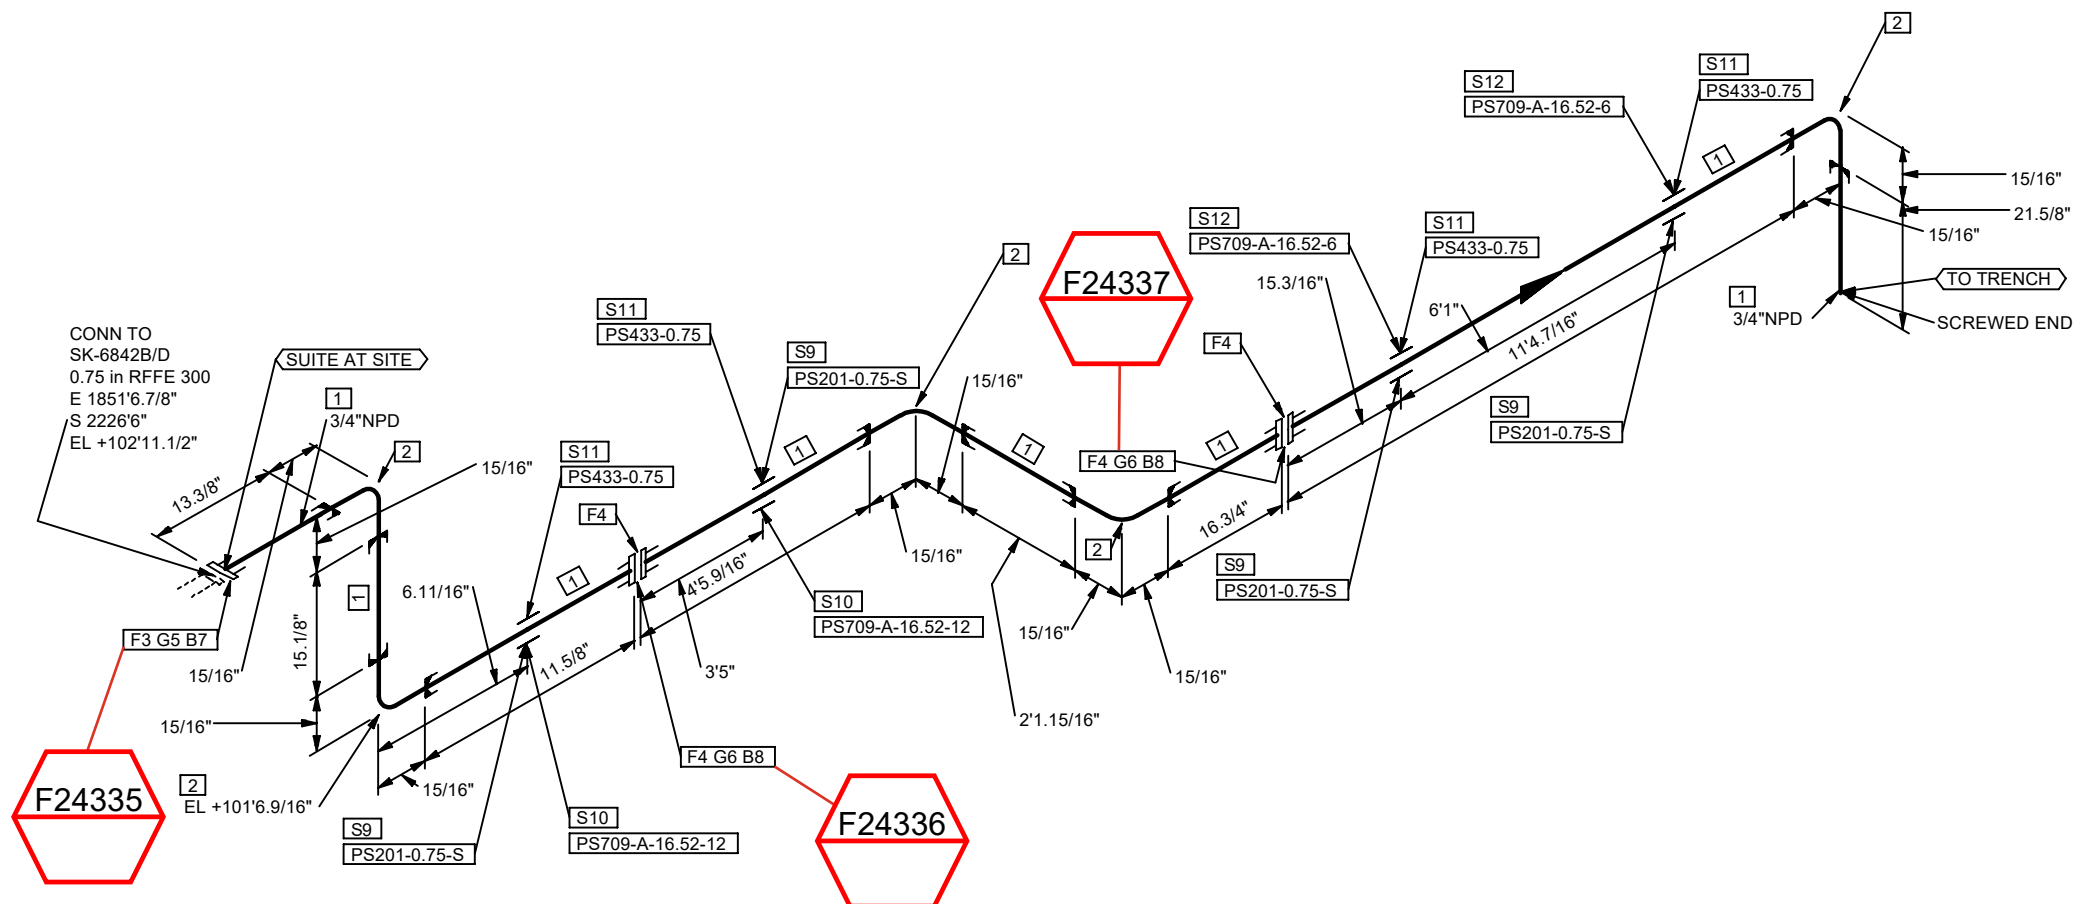

Signature: Glenn Sumrall, C

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



0	2025-02-28	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRV

OTHER THAN SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
1	3/4	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP304L, NPTM Ends, w/ coupling, -, S-80S	C76KFFSD	24.5
2	3/4	90° Elb, ASME B16.11, ASTM A182 Gr.F304L, 3000 Lbs, NPTF Ends, Annealed,	C7BP5GGV	5
3	3/4	THD Flg, ASME B16.5, ASTM A182 Gr.F304L, 300 Lbs, RF/NPTF End, Annealed,	C7W2U48S	1
4	3/4	THD Flg, ASME B16.5, ASTM A182 Gr.F304L, 150 Lbs, RF/NPTF End, Annealed,	C7W2U48K	4
5	3/4	NM Flat Gk, Barium Sulfate filled PTFE, 300 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C7W3AL3K	1
6	3/4	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C7CT1ZFG	2
7	5/8	SBlT 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3 in. Length	C6S4K88N	4
8	1/2	SBlT 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 2.75 in. Length	C6S4K87U	8
<u>PIPE SUPPORTS</u>				
9	3/4	PS201-0.75-S	PS201	4
10	3/4	PS709-A-16.52-12	PS709	2
11	3/4	PS433-0.75	PS433	4
12	3/4	PS709-A-16.52-6	PS709	2

