


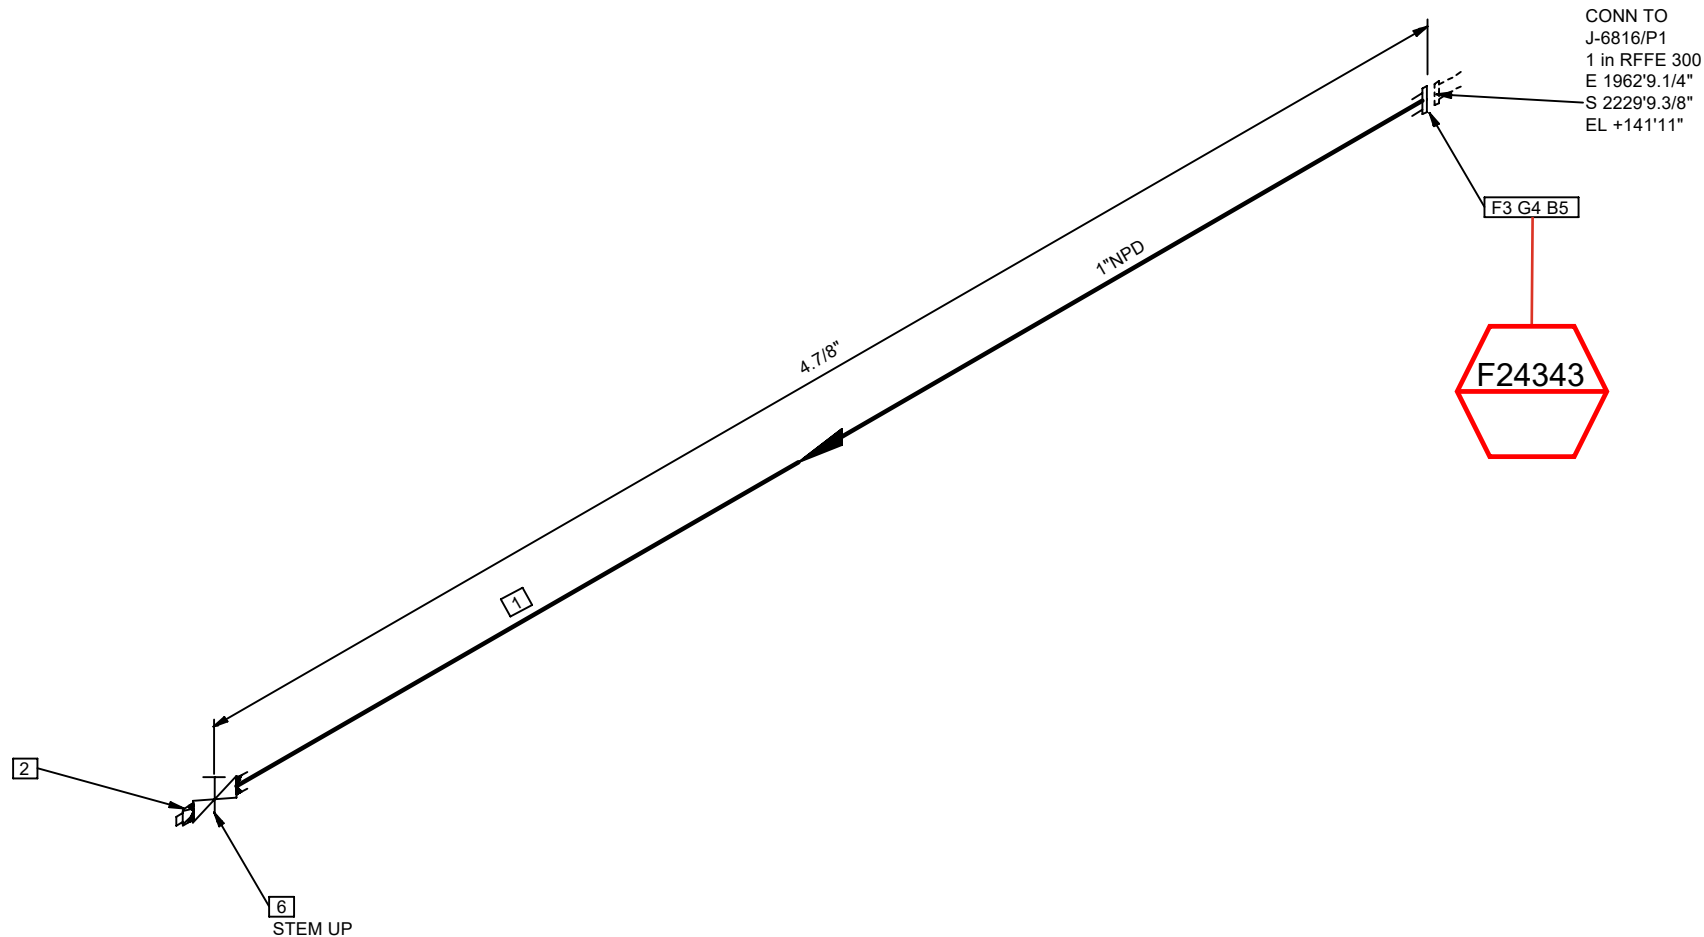

COORDINATE SYSTEM : PLANTCOORDINATES

TEFLON TAPE

Filler Material Requisition

Date: 3-5-25

Line Class: EPCW-CS01

WPS: N/A

Electrode: N/A

Signature: *Glenn Sumrall, Jr.*

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	1	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, NPTM Ends, w/ coupling, -, S-XS	CEZCLUC	0.3 '
2	1	Plug, Solid Round Head Type, ASME B16.11, ASTM A105N, NPTM End, -	CBBPLK4	1
3	1	THD Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/NPTF End, -,	CFG8U743	1
4	1	NM Flat Gk, Barium Sulfate filled PTFE, 300 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C7W3AL3L	1
5	5/8	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3 in. Length	C6S4K88N	4
6	1	Gat Fem, API 602, ASTM A105N,800 Lbs, NPTF Ends, HO,-, Valve Tag: GA-0120	C76SPABV	1

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

0	2025-02-26	RVA	ISSUED FOR CONSTRUCTION			SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION			CHKD	MTO	STRESS	APRVD

SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:
R2	V	Per LDT	Per LDT	N	Y	Per LDT	-
				P&ID: 202998C-001-PID-0021-0327			
				UNIT#:	EWPA AREA:	SPEC:	STRESS CALC #:
				6800	6820	EPCW-CS01	-
				LINE No. 1"-R2-67376-EPCW-CS01-N			
OxyChem Redstone Battleground PROJECT				DRAWING NUMBER			REV.
				6820-R2-67376-01			0

