




COORDINATE SYSTEM : PLANTCOORDINATES

NOTES:

- FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
- FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
- FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
- FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
- ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
- FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
- REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

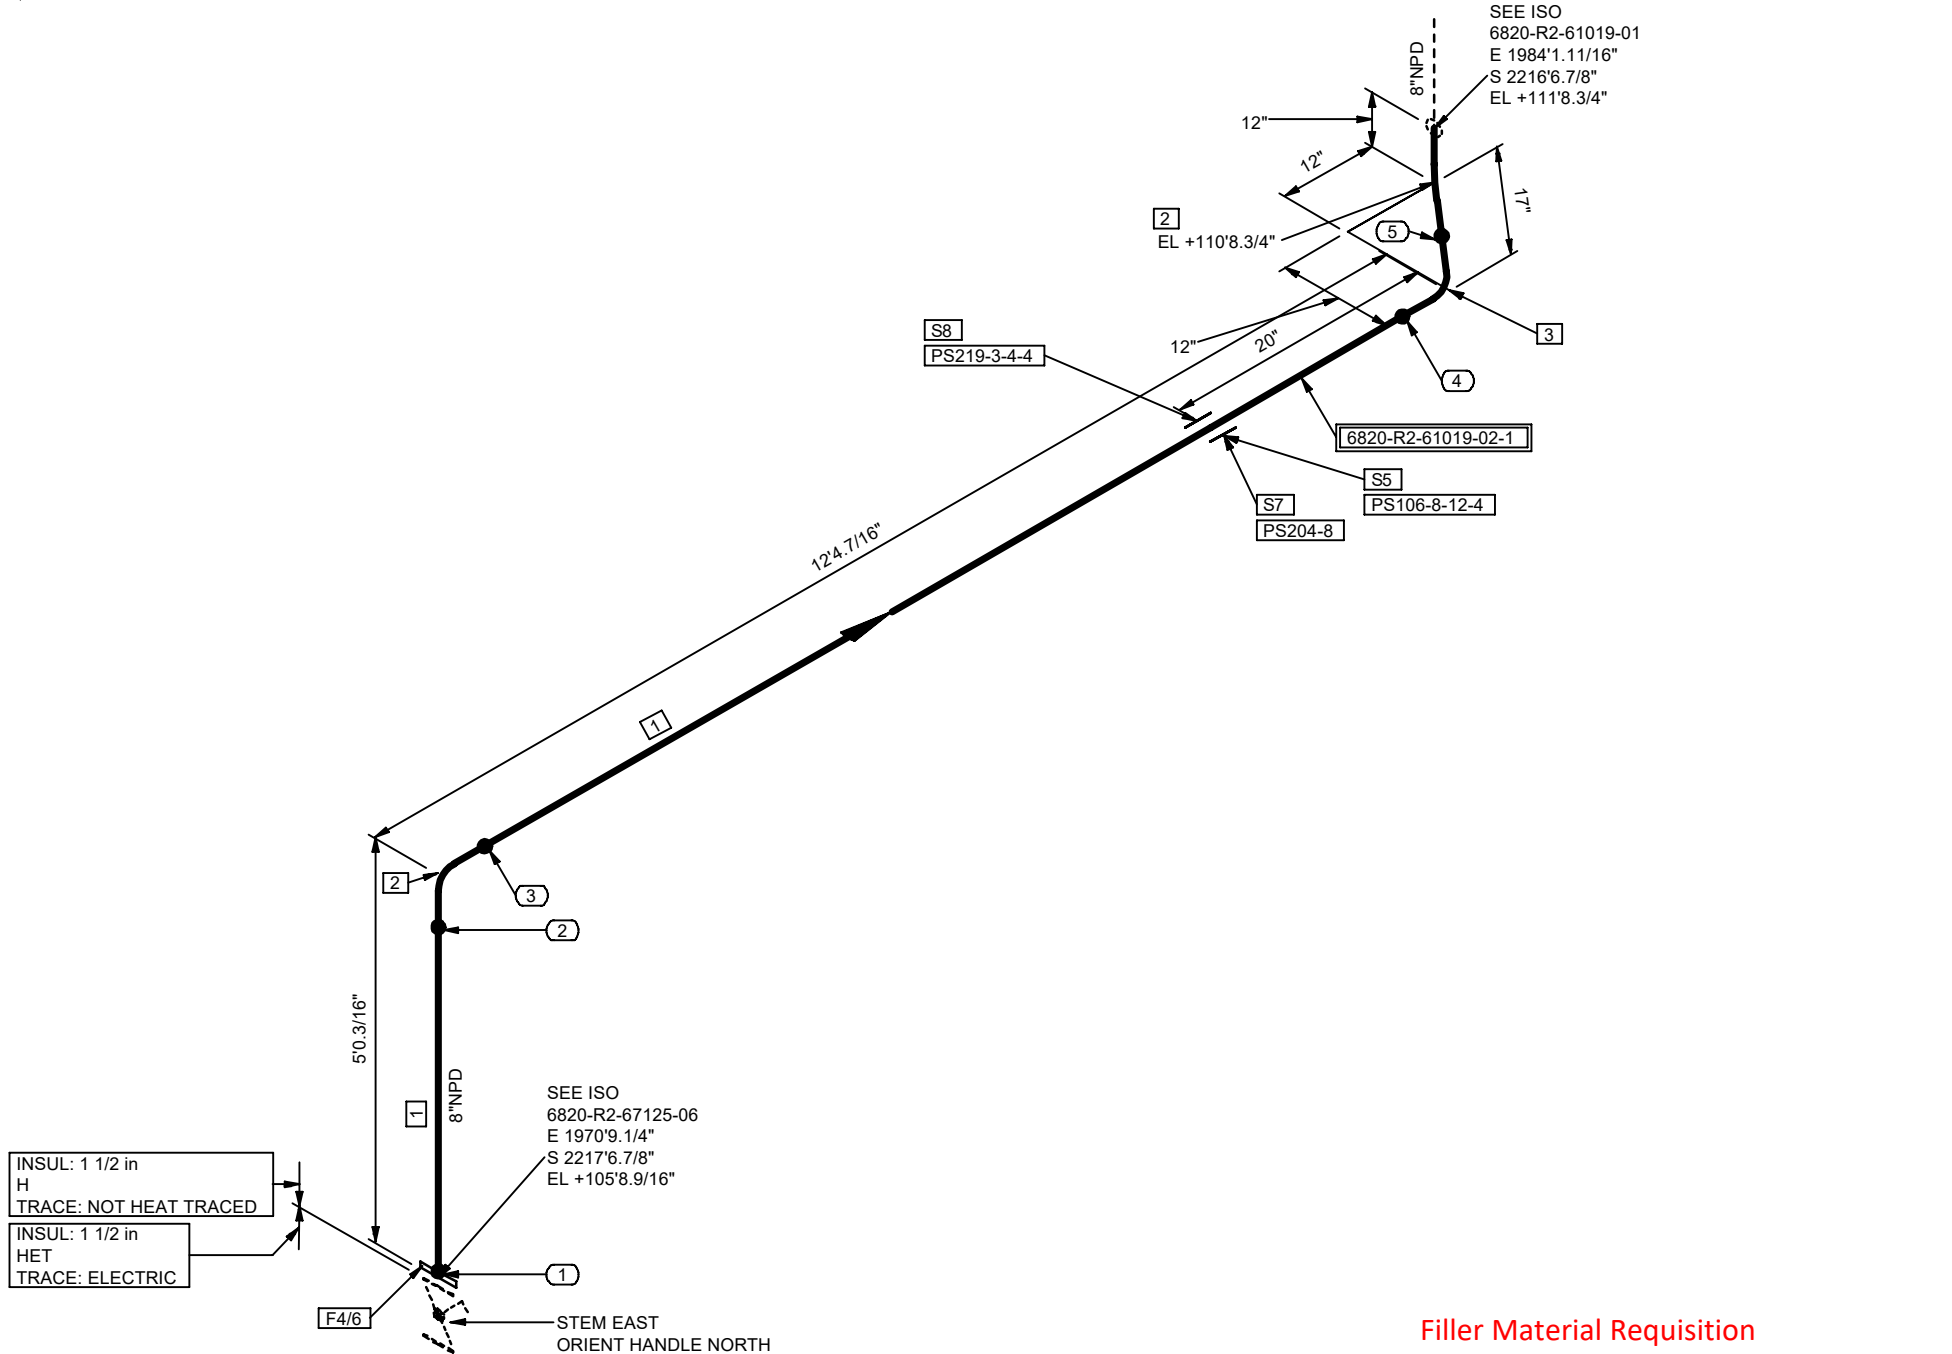

Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

0	2024-07-25	RVA	ISSUED FOR CONSTRUCTION			SAD	KJK	BRD	GR
REV	DATE	BY	DESCRIPTION			CHKD	MTO	STRESS	APRVD

Filler Material Requisition

Date: 8-2-24

Line Class: NOHD-SS01

WPS: 802

Electrode: ER316L

Signature: *Glenn Sumrall Jr*

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	8	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP316L, BE, -, -, S-10S	CPPFEGLE	14.7'
2	8	90° Elb LR, Seamless, ASME B16.9, ASTM A403 Gr.WP316L, BW Ends, -, Annealed, S-10S	C6SDP2WP	2
3	8	45° Elb LR, Seamless, ASME B16.9, ASTM A403 Gr.WP316L, BW Ends, -, Annealed, S-10S	C6SDNS85	1
4	8	LJ Flg, ASME B16.5, ASTM A105 Galv. as per ASTM A153, 150 Lbs, FF, -,	C26WFFFR	1

PIPE SUPPORTS

5	8	PS106-8-12-4	PS106	1
---	---	--------------	-------	---

MISCELLANEOUS COMPONENTS

6	8	Stub SP, Seamless, ASME B16.9, ASTM A403 Gr.WP316L, BW Ends, -, Annealed, x S-10S	C8A57S3L	1
---	---	---	----------	---

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
PIPE SUPPORTS				
7	8	PS204-8	PS204	1
8	8	PS219-3-4-4	PS219	1

PIECE MARKS

6820-R2-61019-02-1



SERVICE: R2	VAPOR/LIQUID: L	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -	
				P&ID: 202998C-001-PID-0021-0305				
				UNIT#: 6800	EWPA AREA: 6820	SPEC: NOHD-SS01	STRESS CALC #: CN-0392	
				LINE No. 8"-R2-61019-NOHD-SS01-H				
				DRAWING NUMBER 6820-R2-61019-02			REV. 0	
				OxyChem Redstone Battleground PROJECT				

