


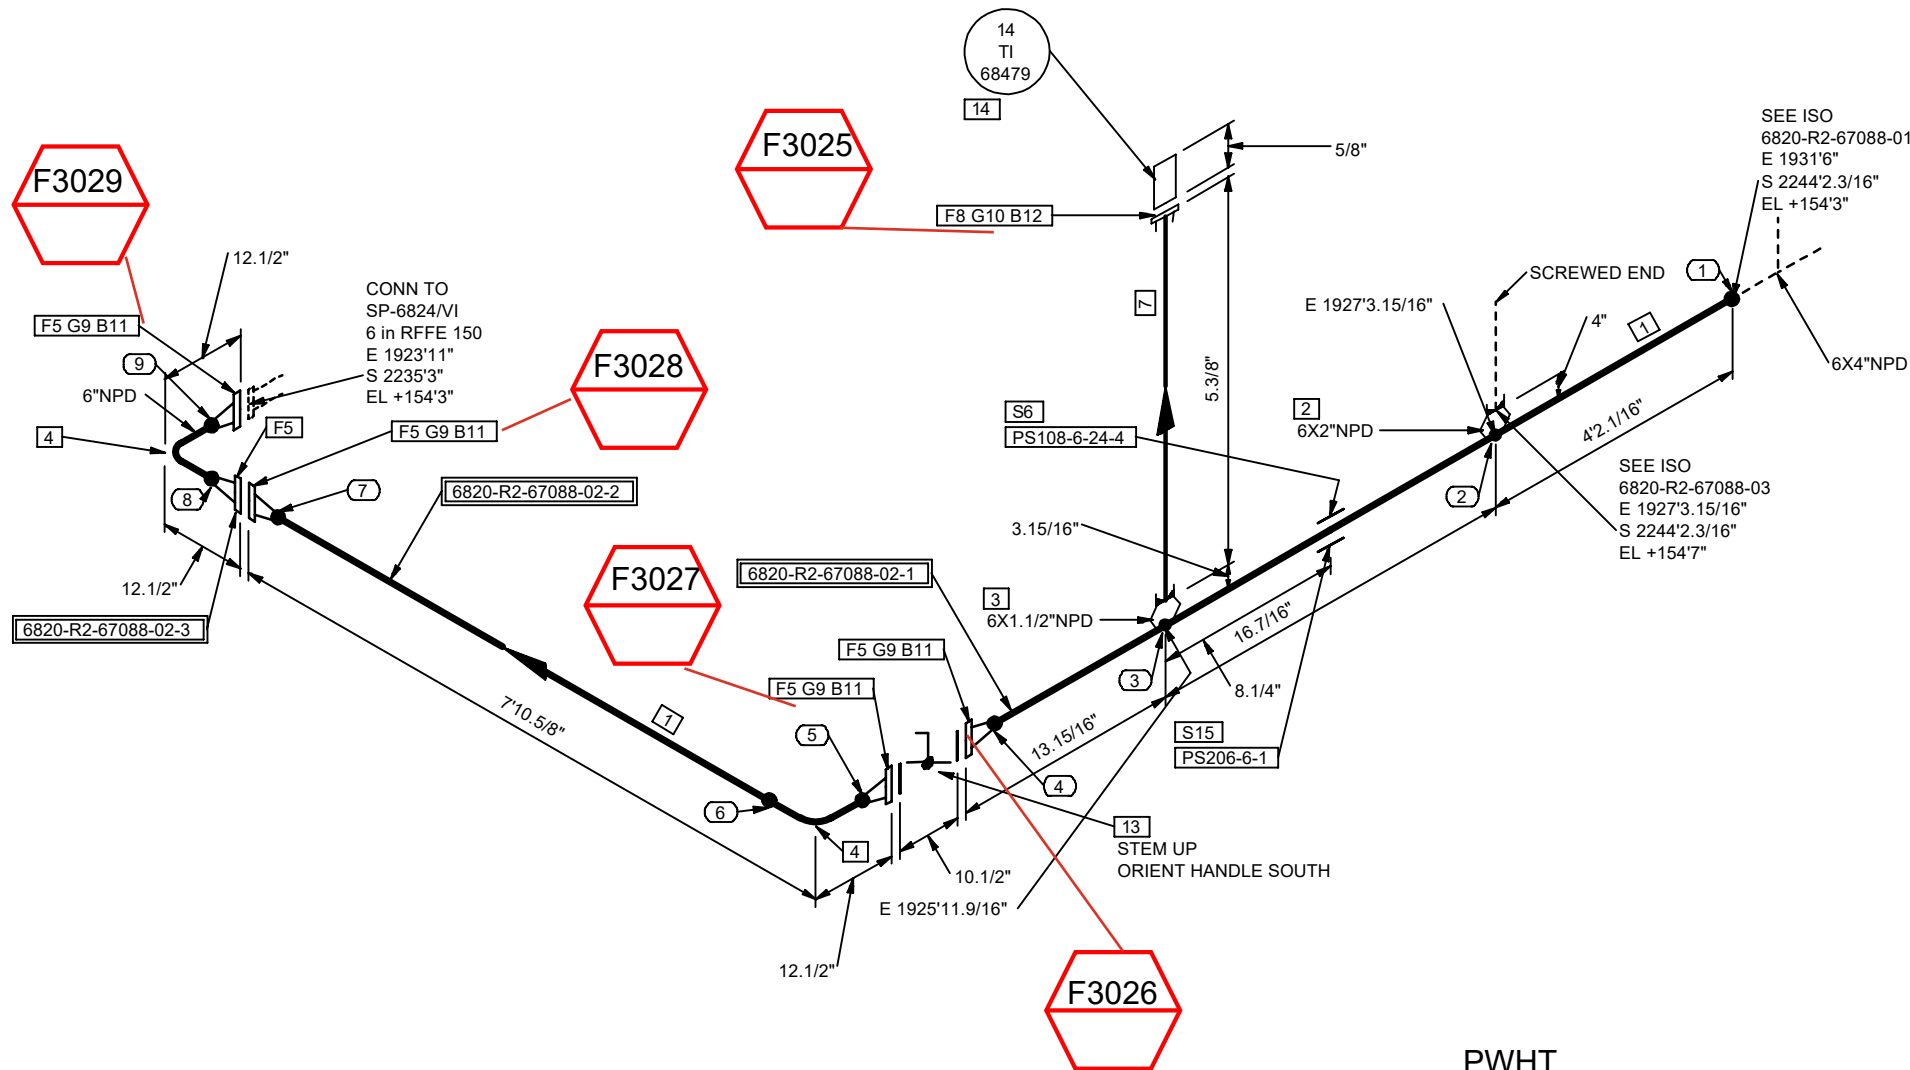

Filler Material Requisition
Date: 8/23/24
Line Class: EPCW-CS01
WPS: 166
Electrode: ER70S-2
Signature: *Glenn Sumrall Jr*

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	6	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP00336	13.3
2	6X2	Thredolet, ASTM A105N, 3000 Lbs, NPTF Ends, -, -	C6UKTX1	1
3	6X1.1/2	Thredolet, ASTM A105N, 3000 Lbs, NPTF Ends, -, -	CLT8TVM0	1
4	6	90° Elb LR, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, -, S-STD	CDB66GNP	2
5	6	WN Flg, ASME B16.5, ASTM A105N, 150 Lbs, RF/BW End, -, S-STD	CFG6WJH2	5

PIPE SUPPORTS

6	6	PS108-6-24-4	PS108	1
---	---	--------------	-------	---

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
7	1.1/2	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, NPTM Ends, w/ coupling, -, S-XS	CEZCLVN	0.5
8	1.1/2	THD Flg, ASME B16.5, ASTM A105N, 150 Lbs, RF/NPTF End, -	CFG8U740	1
9	6	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -	C7CT1ZG1	4
10	1.1/2	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -	C7CT1ZFK	1
11	3/4	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 4.25 in. Length	C6S4K8BC	32
12	1/2	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3 in. Length	C6S4K87V	4
13	6	But Flg,LP, API 609 Cat.B, ASTM A216 Gr.WCB,150 Lbs, RF, Ends as per ASME B16.5, GO,-, Valve Tag: BU-0807	C84MWBH0	1

INSTRUMENTS

14	1.1/2	14-TI-68479	14-TI-68479	1
----	-------	-------------	-------------	---

PIPE SUPPORTS

15	6	PS206-6-1	PS206	1
----	---	-----------	-------	---

PIECE MARKS

6820-R2-67088-02-1 6820-R2-67088-02-2 6820-R2-67088-02-3

COORDINATE SYSTEM : PLANTCOORDINATES

NOTES:

- FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
- FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
- FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
- FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
- ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
- FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
- REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
0	2024-08-17	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR

SERVICE: R2	VAPOR/LIQUID: L	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -	
				P&ID: 202998C-001-PID-0021-0326				
				UNIT#: 6800	EWPA AREA: 6820	SPEC: EPCW-CS01	STRESS CALC #: CN-0398	
				LINE No. 6"-R2-67088-EPCW-CS01-H				
				DRAWING NUMBER 6820-R2-67088-02				REV. 0
				OxyChem Redstone Battleground PROJECT				

OxyChem Redstone Battleground PROJECT

