



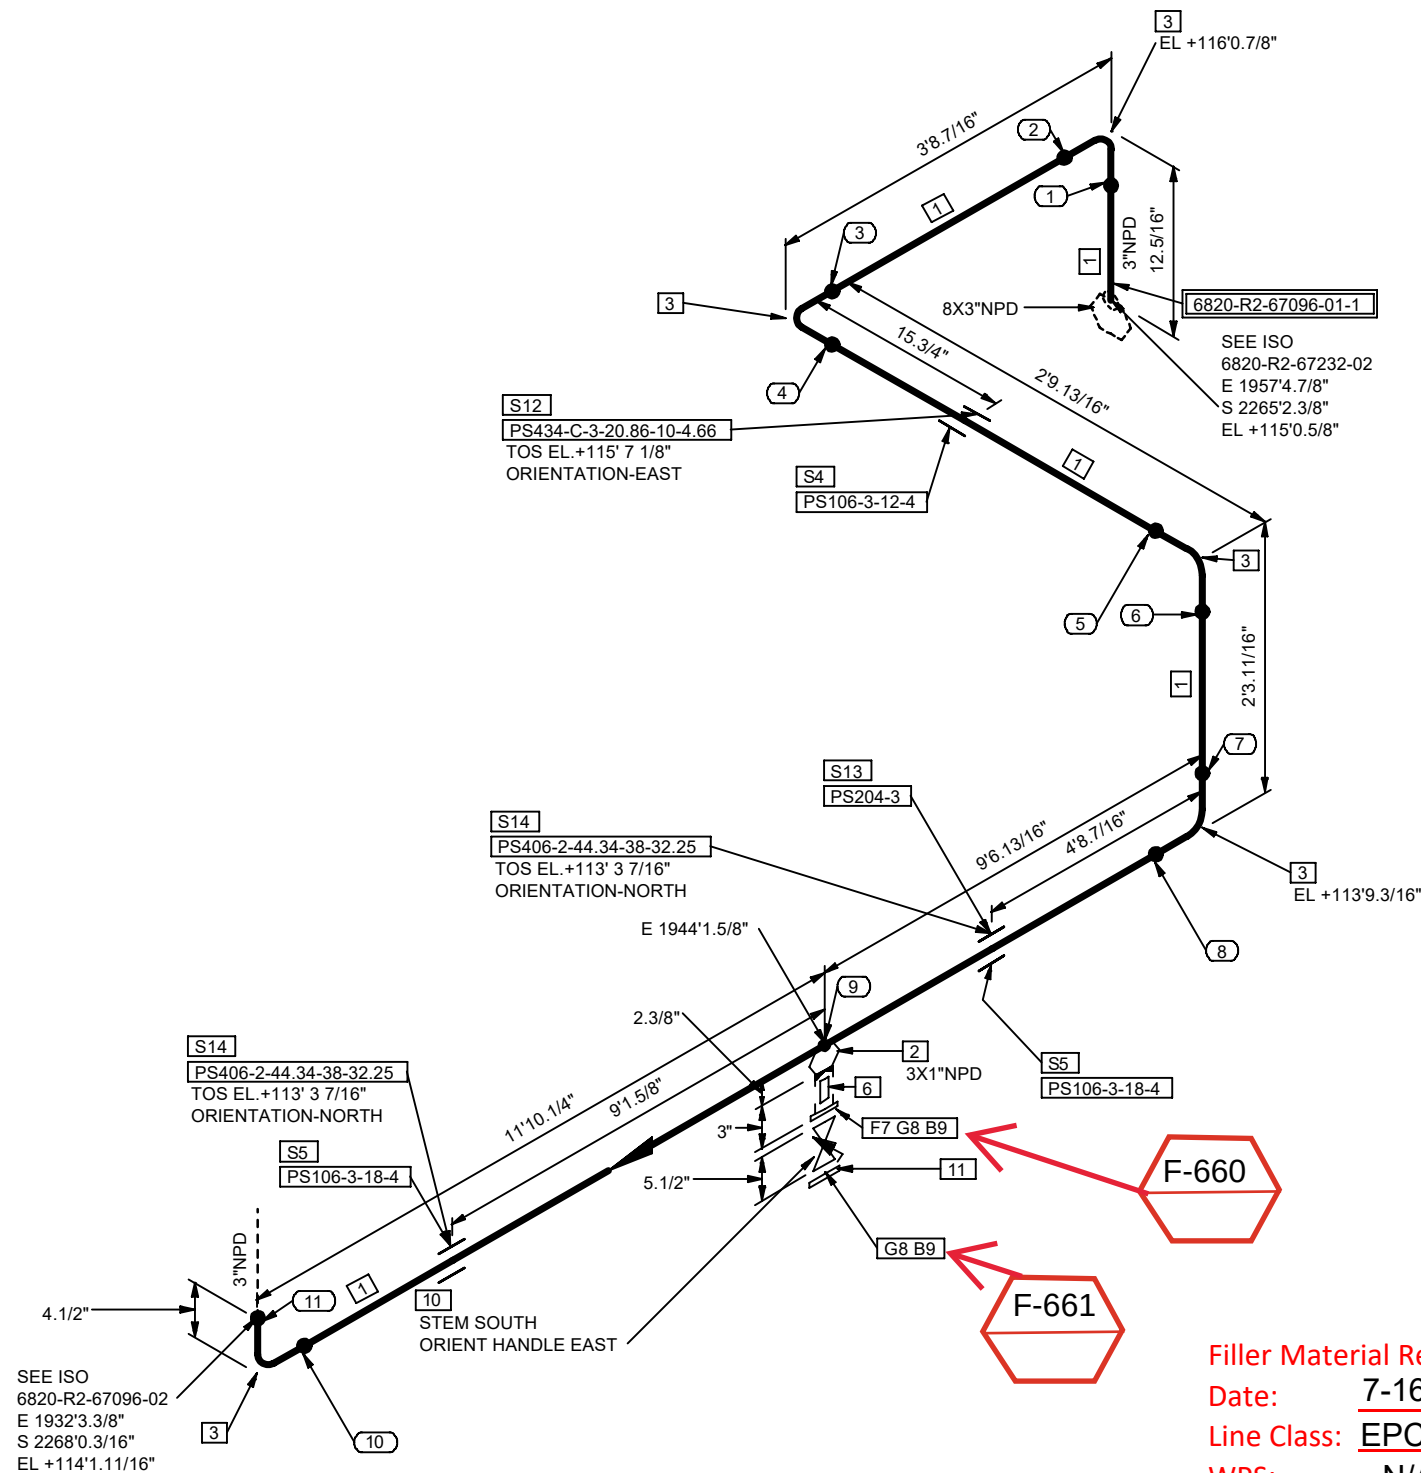

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



0	2024-07-12	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	BRD	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD


Date: 7-16-24

Line Class: EPCL-SS01

WPS: N/A

Electrode: NO FIELD WELDS

Signature: *Pedro Morin*

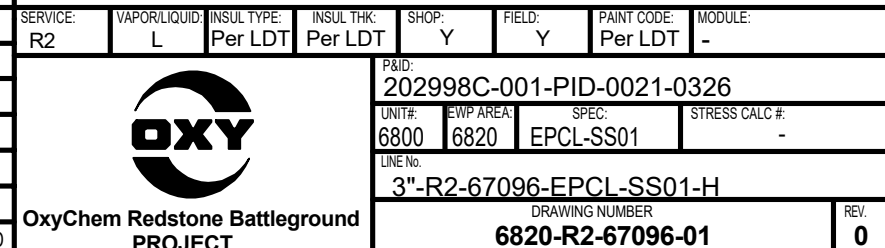

SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
1	3	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP304L, BE, -, -, S-10S	CPP6WN1S	28.0
2	3X1	Threadolet, ASTM A182 Gr.F304L, 3000 Lbs, NPTF Ends, -, Annealed,	C7BP7RMA	1
3	3	90° Elb LR, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -,Annealed, S-10S	C6SEUJG7	5
<u>PIPE SUPPORTS</u>				
4	3	PS106-3-12-4	PS106	1
5	3	PS106-3-18-4	PS106	2
<u>OTHER THAN SHOP MATERIALS</u>				
NO	NPD	DESCRIPTION	IDENT	QTY
6	1	Nipple, ASTM A312 Gr.TP304L, NPTM Ends, L = 3in, -, S-80S	CEZMKL0	1
7	1	THD Flg, ASME B16.5, ASTM A182 Gr.F304L, 150 Lbs, RF/NPTF End, Annealed,	C7W2U48L	1
8	1	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C7CT1ZFH	2
9	1/2	SBit 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 2.75 in. Length	C6S4K87U	8
10	1	Plug Flg,SP, Tapered Plug, Non Lubricated, API 599, ASTM A351 Gr.CF8M, 150 Lbs, RF, Ends as per ASME B16.5, -, LO,-, -, Valve Tag: PL-0548	C76KHSRR	1
11	1	Bld Flg, ASME B16.5, ASTM A182 Gr.F304L, 150 Lbs, RF, Annealed,	C7W2U478	1
<u>PIPE SUPPORTS</u>				
12	3	PS434-C-3-20.86-10-4.66	PS434	1
13	3	PS204-3	PS204	1
14	3	PS406-2-44.34-38-32.25	PS406	2