


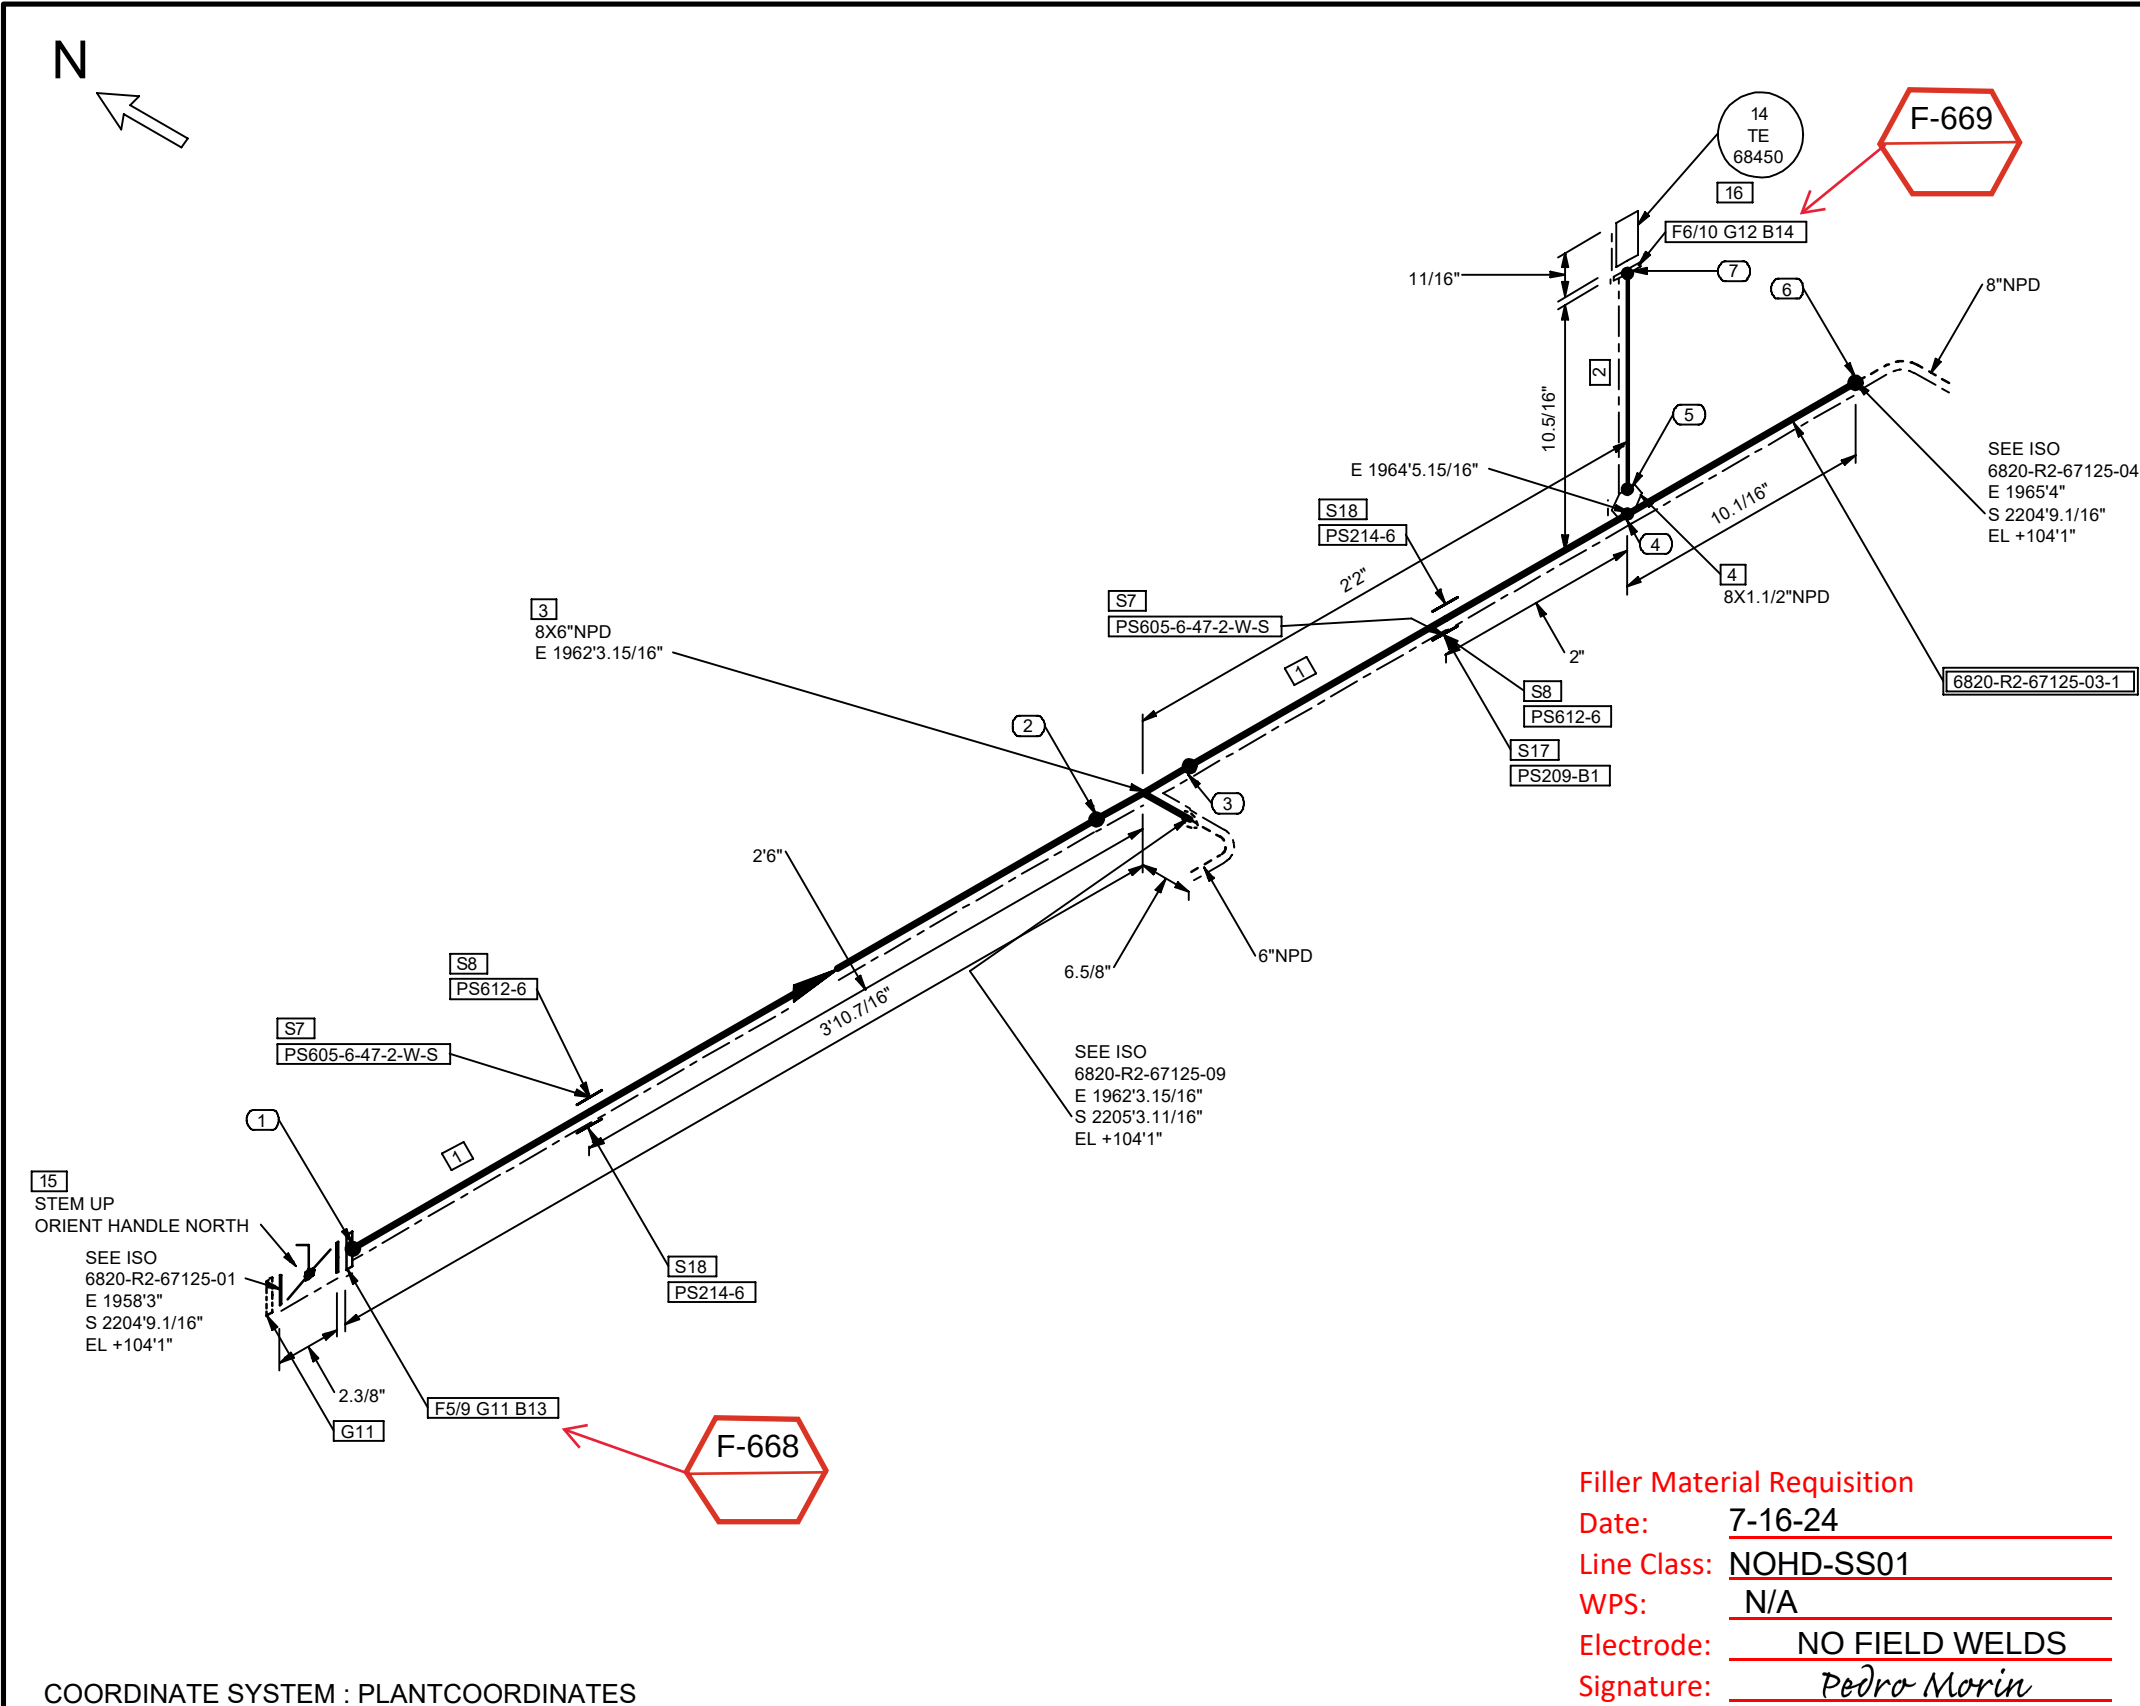

Filler Material Requisition

Date: 7-16-24
Line Class: NOHD-SS01
WPS: N/A
Electrode: NO FIELD WELDS
Signature: Pedro Morin

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	8	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP316L, BE, -, -, S-10S	CPPFEGLE	5.4 '
2	1.1/2	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP316L, BE, -, -, S-40S	CYLECR2	0.3 '
3	8X6	Red Te, Seamless, ASME B16.9, ASTM A403 Gr.WP316L, BW Ends, -,Annealed, S-10S	C6SDNT84	1
4	8X1.1/2	Weldolet, MSS SP-97, ASTM A182 Gr.F316L, BW Ends, Annealed, S-10S x S-40S	C80R6C3P	1
5	8	LJ Flg, ASME B16.5, ASTM A105 Galv. as per ASTM A153, 150 Lbs, FF, -,	C26WFFFR	1
6	1.1/2	LJ Flg, ASME B16.5, ASTM A105 Galv. as per ASTM A153, 150 Lbs, FF, -,	C26WFFF9	1

PIPE SUPPORTS

7	8	PS605-6-47-2-W-S	PS605	2
8	8	PS612-6	PS612	2

MISCELLANEOUS COMPONENTS

9	8	Stub SP, Seamless, ASME B16.9, ASTM A403 Gr.WP316L, BW Ends, -,Annealed, x S-10S	C8A57S3L	1
10	1.1/2	Stub SP, Seamless, ASME B16.9, ASTM A403 Gr.WP316L, BW Ends, -,Annealed, x S-40S	C8A57RPB	1

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
11	8	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -,	C6SBWZF4	2
12	1.1/2	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -,	C6S4K87H	1
13	3/4	SBlit 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 7.25 in. Length	C6S4K8BR	8
14	1/2	SBlit 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 2.75 in. Length	C6S4K87U	4
15	8	But Waf, API 609 Cat.A, ASTM A395 Gr.60-40-18 PFA Lined and Epoxy Coated,150 Lbs, Lug-type RF, Ends as per ASME B16.5, GO,-, Valve Tag: BU-0808	C7CT0BXY	1

INSTRUMENTS

16	1.1/2	14-TE-68450	14-TE-68450	1
----	-------	-------------	-------------	---

PIPE SUPPORTS

17	8	PS209-B1	PS209	1
18	8	PS214-6	PS214	2

PIECE MARKS

6820-R2-67125-03-1



COORDINATE SYSTEM : PLANTCOORDINATES

NOTES:
1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFWD DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

TECHNIP ENERGIES

Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
0	2024-07-13	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	BRD	GR

OxyChem Redstone Battleground PROJECT

SERVICE: R2	VAPOR/LIQUID: L	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -
P&ID: 202998C-001-PID-0021-0328							
UNIT#: 6800	EWPA AREA: 6820	SPEC: NOHD-SS01	STRESS CALC #: CN-0392				
LINE No: 8"-R2-67125-NOHD-SS01-HET							
DRAWING NUMBER 6820-R2-67125-03							REV. 0

