


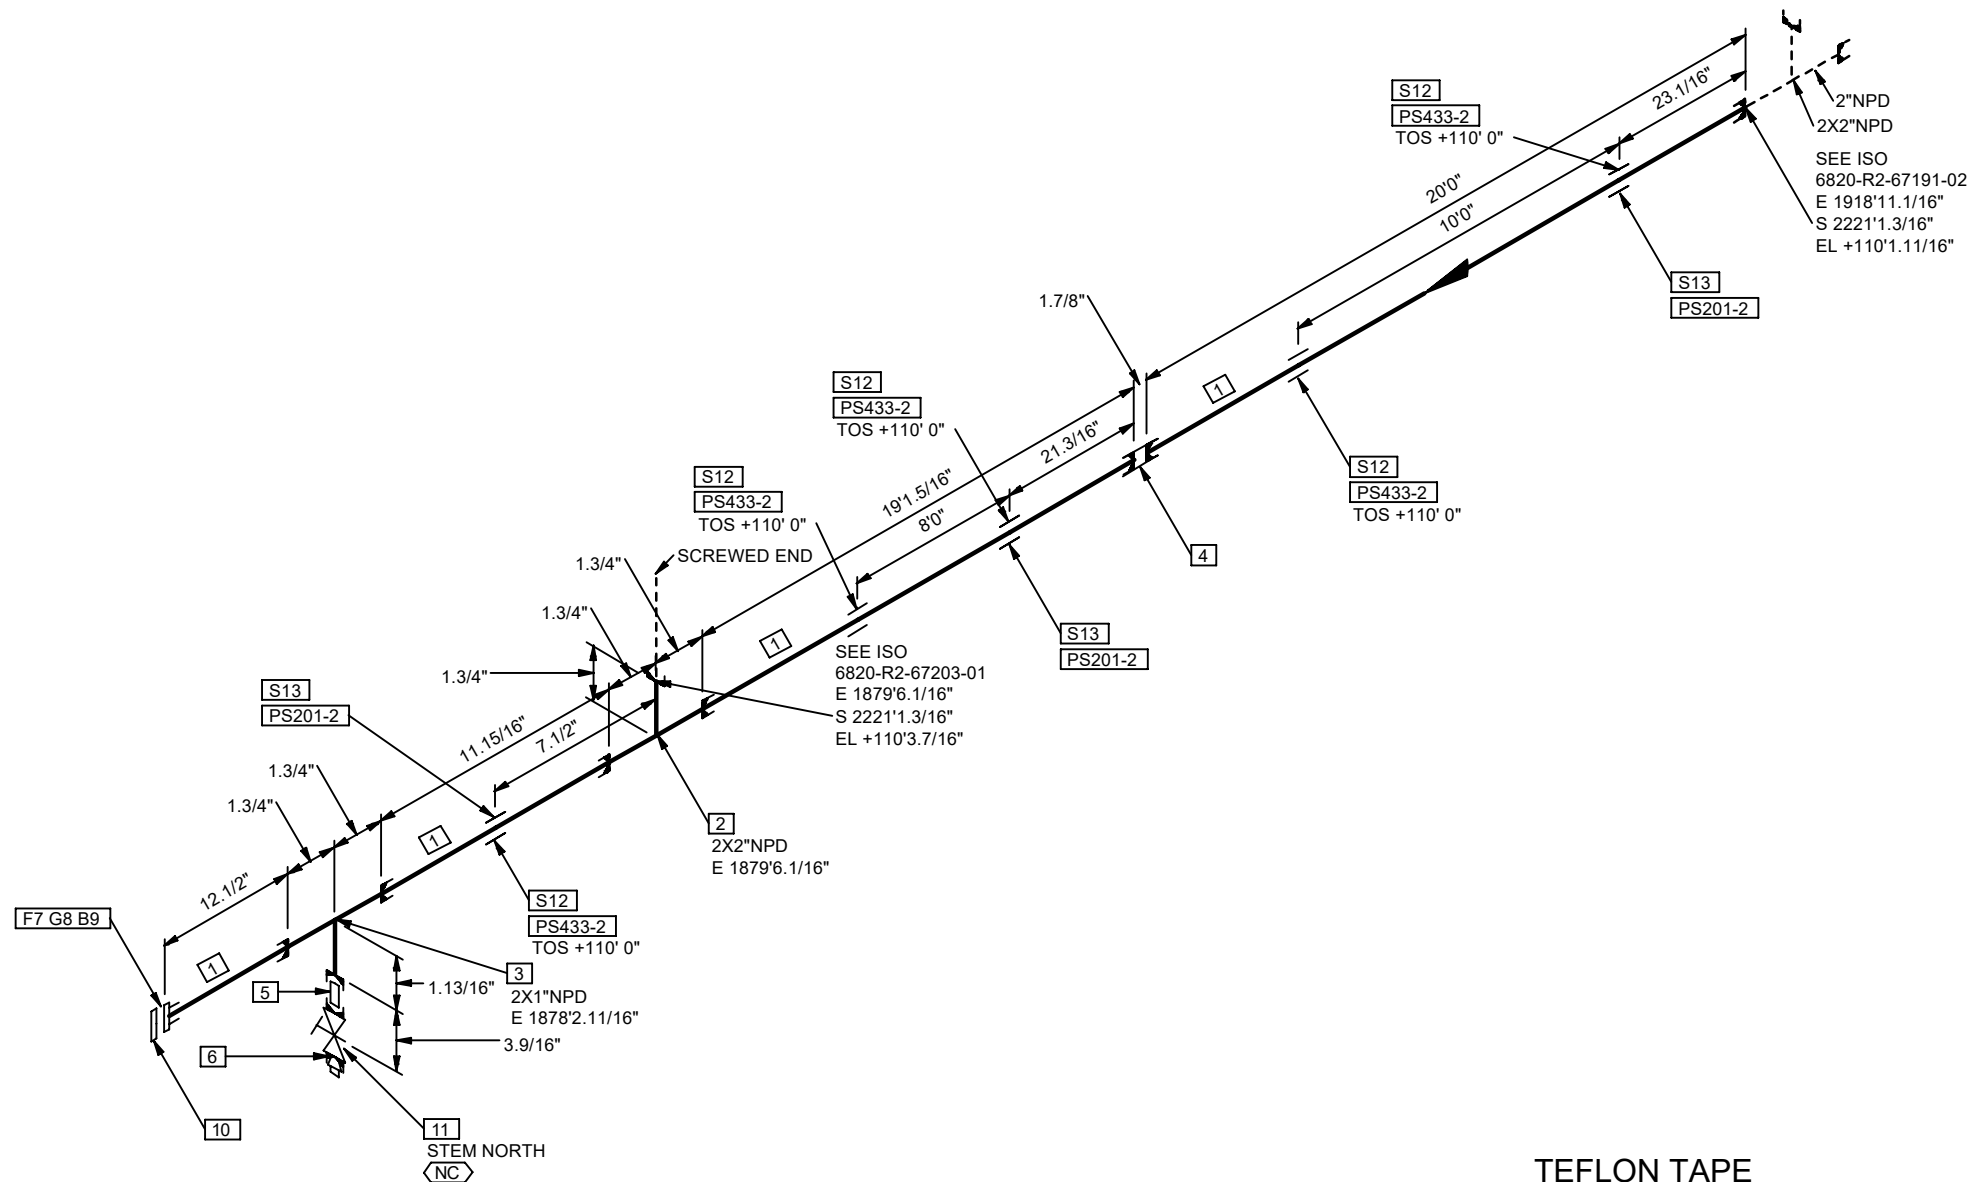

TEFLON TAPE
Filler Material Requisition
Date: 1-7-25
Line Class: ARDG-XX01
WPS: N/A
Electrode: N/A
Signature: Pedro Morin

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	2	Pipes, Seamless, ASME B36.10, ASTM A53 Gr.B Galv. as per ASTM A153, NPTM Ends, w/ coupling, -, S-XS	C8GWJY7T	41.2
2	2X2	Eq Te, ASME B16.11, ASTM A105N Galv. as per ASTM A153, 3000 Lbs, NPTF Ends, -	C1DR2HX	1
3	2X1	Red Te, ASME B16.11, ASTM A105N Galv. as per ASTM A153, 3000 Lbs, NPTF Ends, -	C1DR2J7	1
4	2	Full Coup, ASME B16.11, ASTM A105N Galv. as per ASTM A153, 3000 Lbs, NPTF Ends, -	CZ2LEZH	1
5	1	Nipple, ASTM A53 Gr.B Galv. as per ASTM A153, NPTM Ends, L = 3in, -, S-XS	C926162	1
6	1	Plug, Solid Round Head Type, ASME B16.11, ASTM A105N Galv. as per ASTM A153, NPTM End, -	C1NJUHLY	1
7	2	THD Flg, ASME B16.5, ASTM A105N Galv. as per ASTM A153, 150 Lbs, RF/NPTF End, -	C1DR2JR	1
8	2	NM Flat Gk, Aramid Fiber Reinforced SBR, 150 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -	C7SM1YGR	1
9	5/8	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3.5 in. Length	C6S4K88R	4
10	2	Bld Flg, ASME B16.5, ASTM A105N Galv. as per ASTM A153, 150 Lbs, RF, -	C1DR2JY	1
11	1	Gat Fem, MSS SP-80, ASTM B62 UNS C83600, 125 Lbs, NPTF Ends, HO, -, Valve Tag: GA-0110	C76KHVWU	1

PIPE SUPPORTS

12	2	PS433-2	PS433	5
13	2	PS201-2	PS201	3

COORDINATE SYSTEM : PLANTCOORDINATES

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

0	2024-12-27	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD

SERVICE: R2	VAPOR/LIQUID: V	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: N	FIELD: Y	PAINT CODE: Per LDT	MODULE: -
P&ID: 202998C-001-PID-0031-1001				UNIT#: 6800	LEWP AREA: 6820	SPEC: ARDG-XX01	STRESS CALC #: -
LINE No. 2"-R2-67191-ARDG-XX01-N				DRAWING NUMBER 6820-R2-67191-03			
OxyChem Redstone Battleground PROJECT				REV. 0			

