
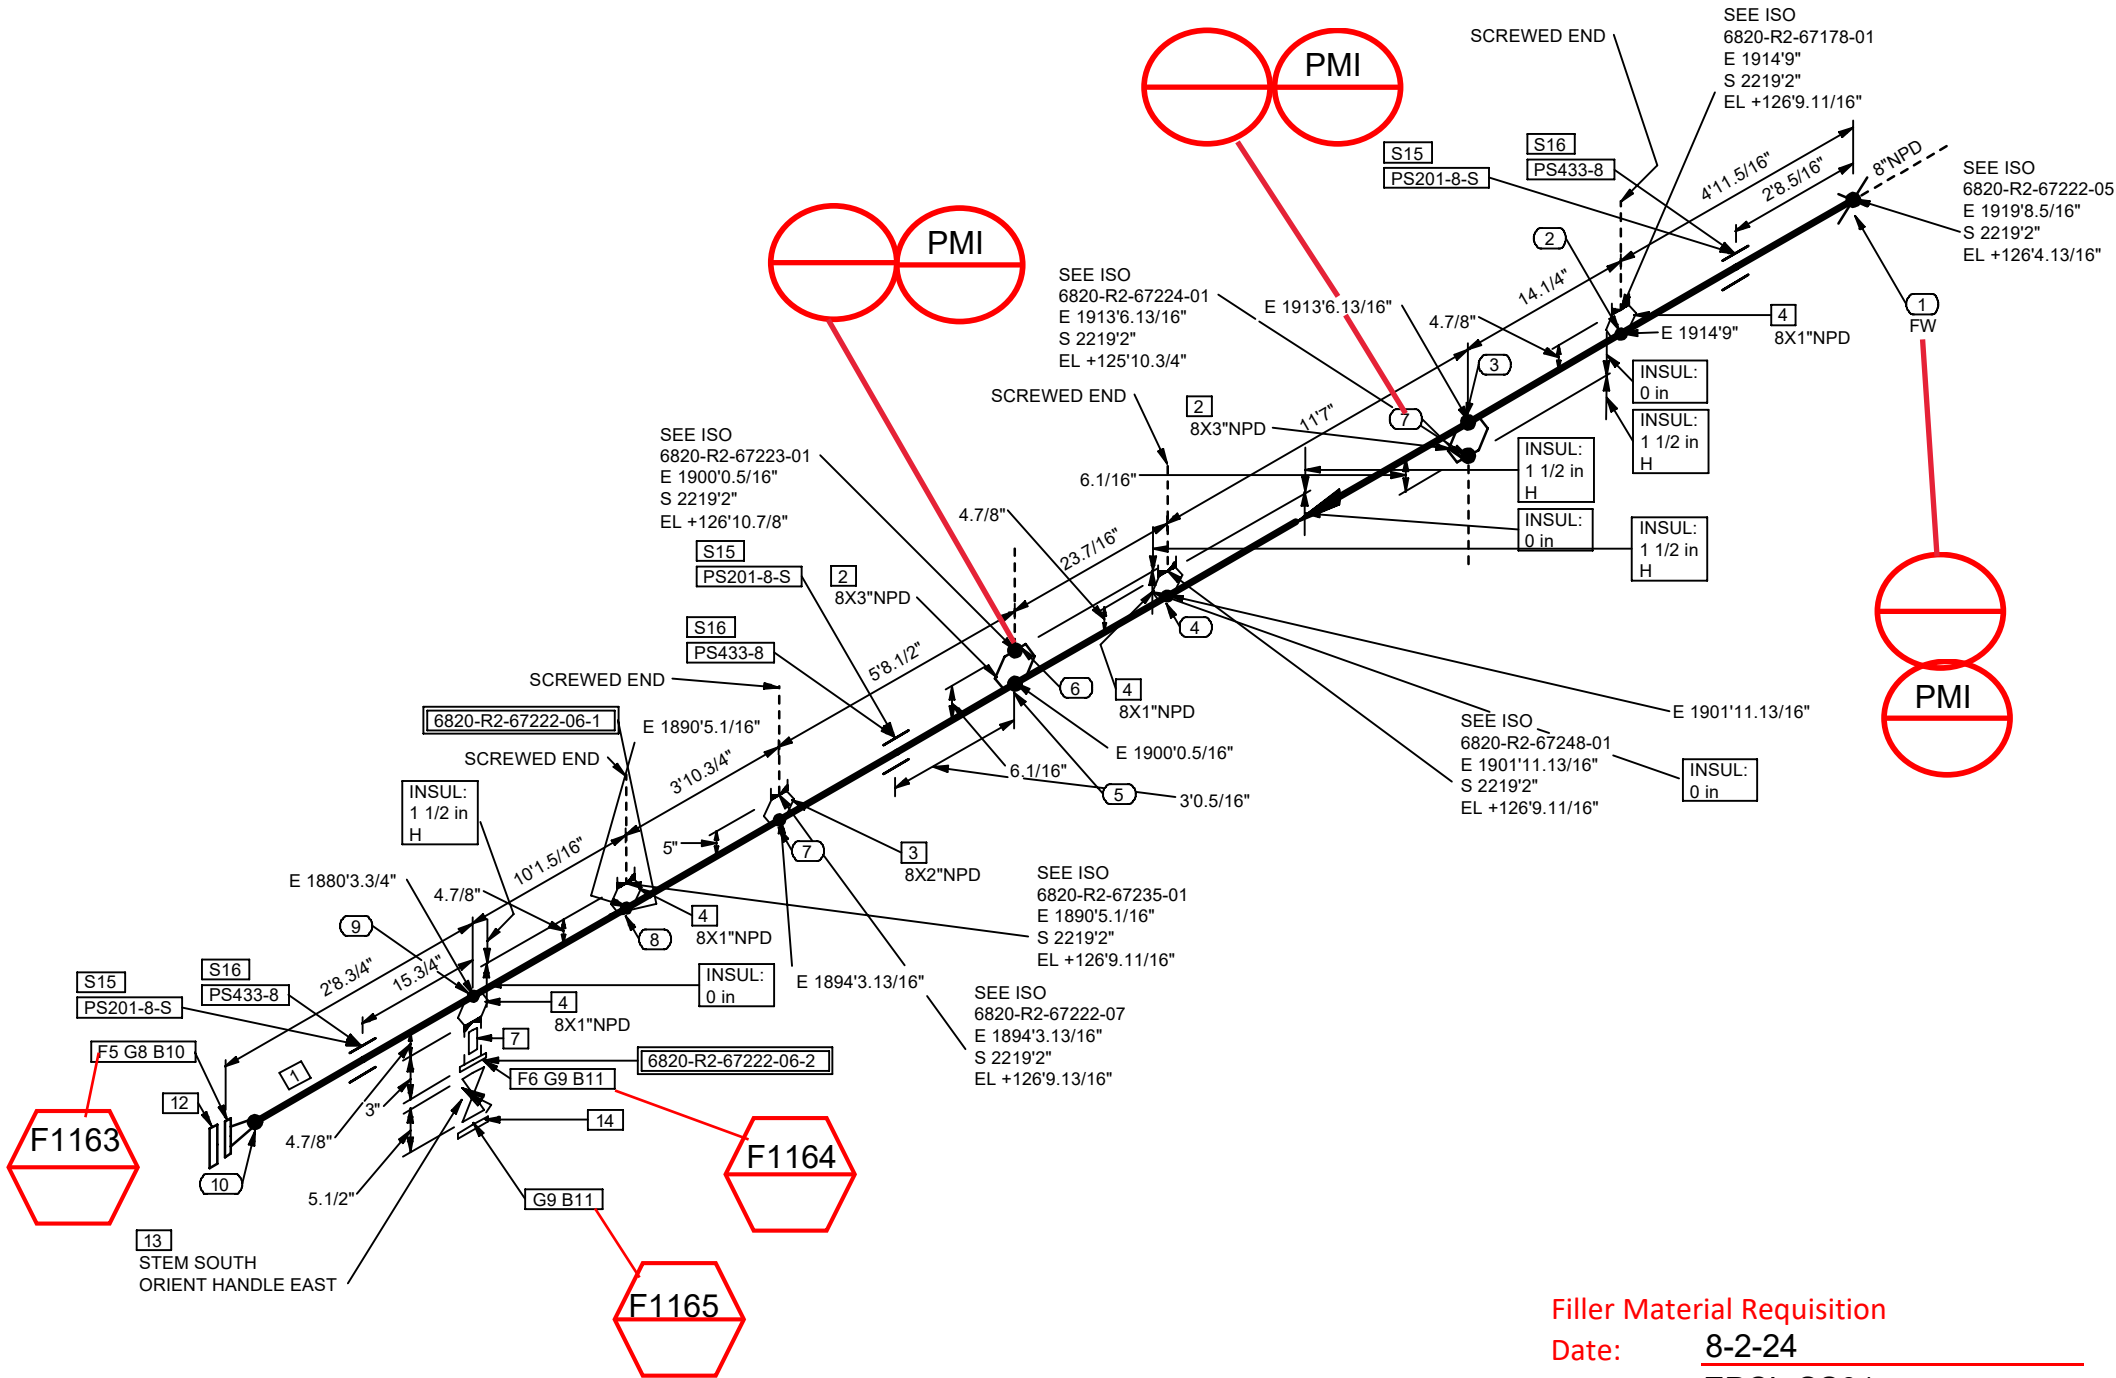




COORDINATE SYSTEM : PLANTCOORDINATES

Filler Material Requisition

Date: 8-2-24
Line Class: EPCL-SS01
WPS: 802
Electrode: ER308L
Signature: *Glenn Sumrall Jr*

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	8	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP304L, BE, -, -, S-10S	C7FCT25	41.8
2	8X3	Weldolet, MSS SP-97, ASTM A182 Gr.F304L, BW Ends, Annealed, S-10S	C7BP7VPP	2
3	8X2	Thredolet, ASTM A182 Gr.F304L, 3000 Lbs, NPTF Ends, -, Annealed,	C7BP7RNA	1
4	8X1	Thredolet, ASTM A182 Gr.F304L, 3000 Lbs, NPTF Ends, -, Annealed,	C7BP7RN7	4
5	8	WN Flg, ASME B16.5, ASTM A182 Gr.F304L, 150 Lbs, RF/BW End, Annealed, S-10S	C7W2U6T4	1
6	1	THD Flg, ASME B16.5, ASTM A182 Gr.F304L, 150 Lbs, RF/NPTF End, Annealed,	C7W2U48L	1

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
7	1	Nipple, ASTM A312 Gr.TP304L, NPTM Ends, L = 3in, -, S-80S	CEZMKL0	1
8	8	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C7CT1ZG2	1
9	1	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C7CT1ZFH	2
10	3/4	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 4.5 in. Length	C6S4K8BD	8
11	1/2	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 2.75 in. Length	C6S4K87U	8
12	8	Bld Flg, ASME B16.5, ASTM A182 Gr.F304L, 150 Lbs, RF, Annealed,	C7W2U47N	1
13	1	Plug Flg,SP, Tapered Plug, Non Lubricated, API 599, ASTM A351 Gr.CF8M, 150 Lbs, RF, Ends as per ASME B16.5, -, LO,-, -, Valve Tag: PL-0548	C76KHSRR	1
14	1	Bld Flg, ASME B16.5, ASTM A182 Gr.F304L, 150 Lbs, RF, Annealed,	C7W2U478	1

PIPE SUPPORTS


15	8	PS201-8-S	PS201	3
16	8	PS433-8	PS433	3

PIECE MARKS

6820-R2-67222-06-1 6820-R2-67222-06-2

NOTES:

- FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
- FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
- FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
- FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
- ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
- FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
- REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTD	STRESS	APRVD
0	2024-07-25	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	BRD	GR

SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:	
R2	L	Per LDT	Per LDT	Y	Y	Per LDT	-	
				P&ID:				
				202998C-001-PID-0021-0331				
				UNIT#:	EW P AREA:	SPEC:	STRESS CALC #:	
				6800	6820	EPCL-SS01	-	
				LINE No.				
OxyChem Redstone Battleground PROJECT				8"-R2-67222-EPCL-SS01-N				
				DRAWING NUMBER				
				6820-R2-67222-06				

OxyChem Redstone Battleground PROJECT

