


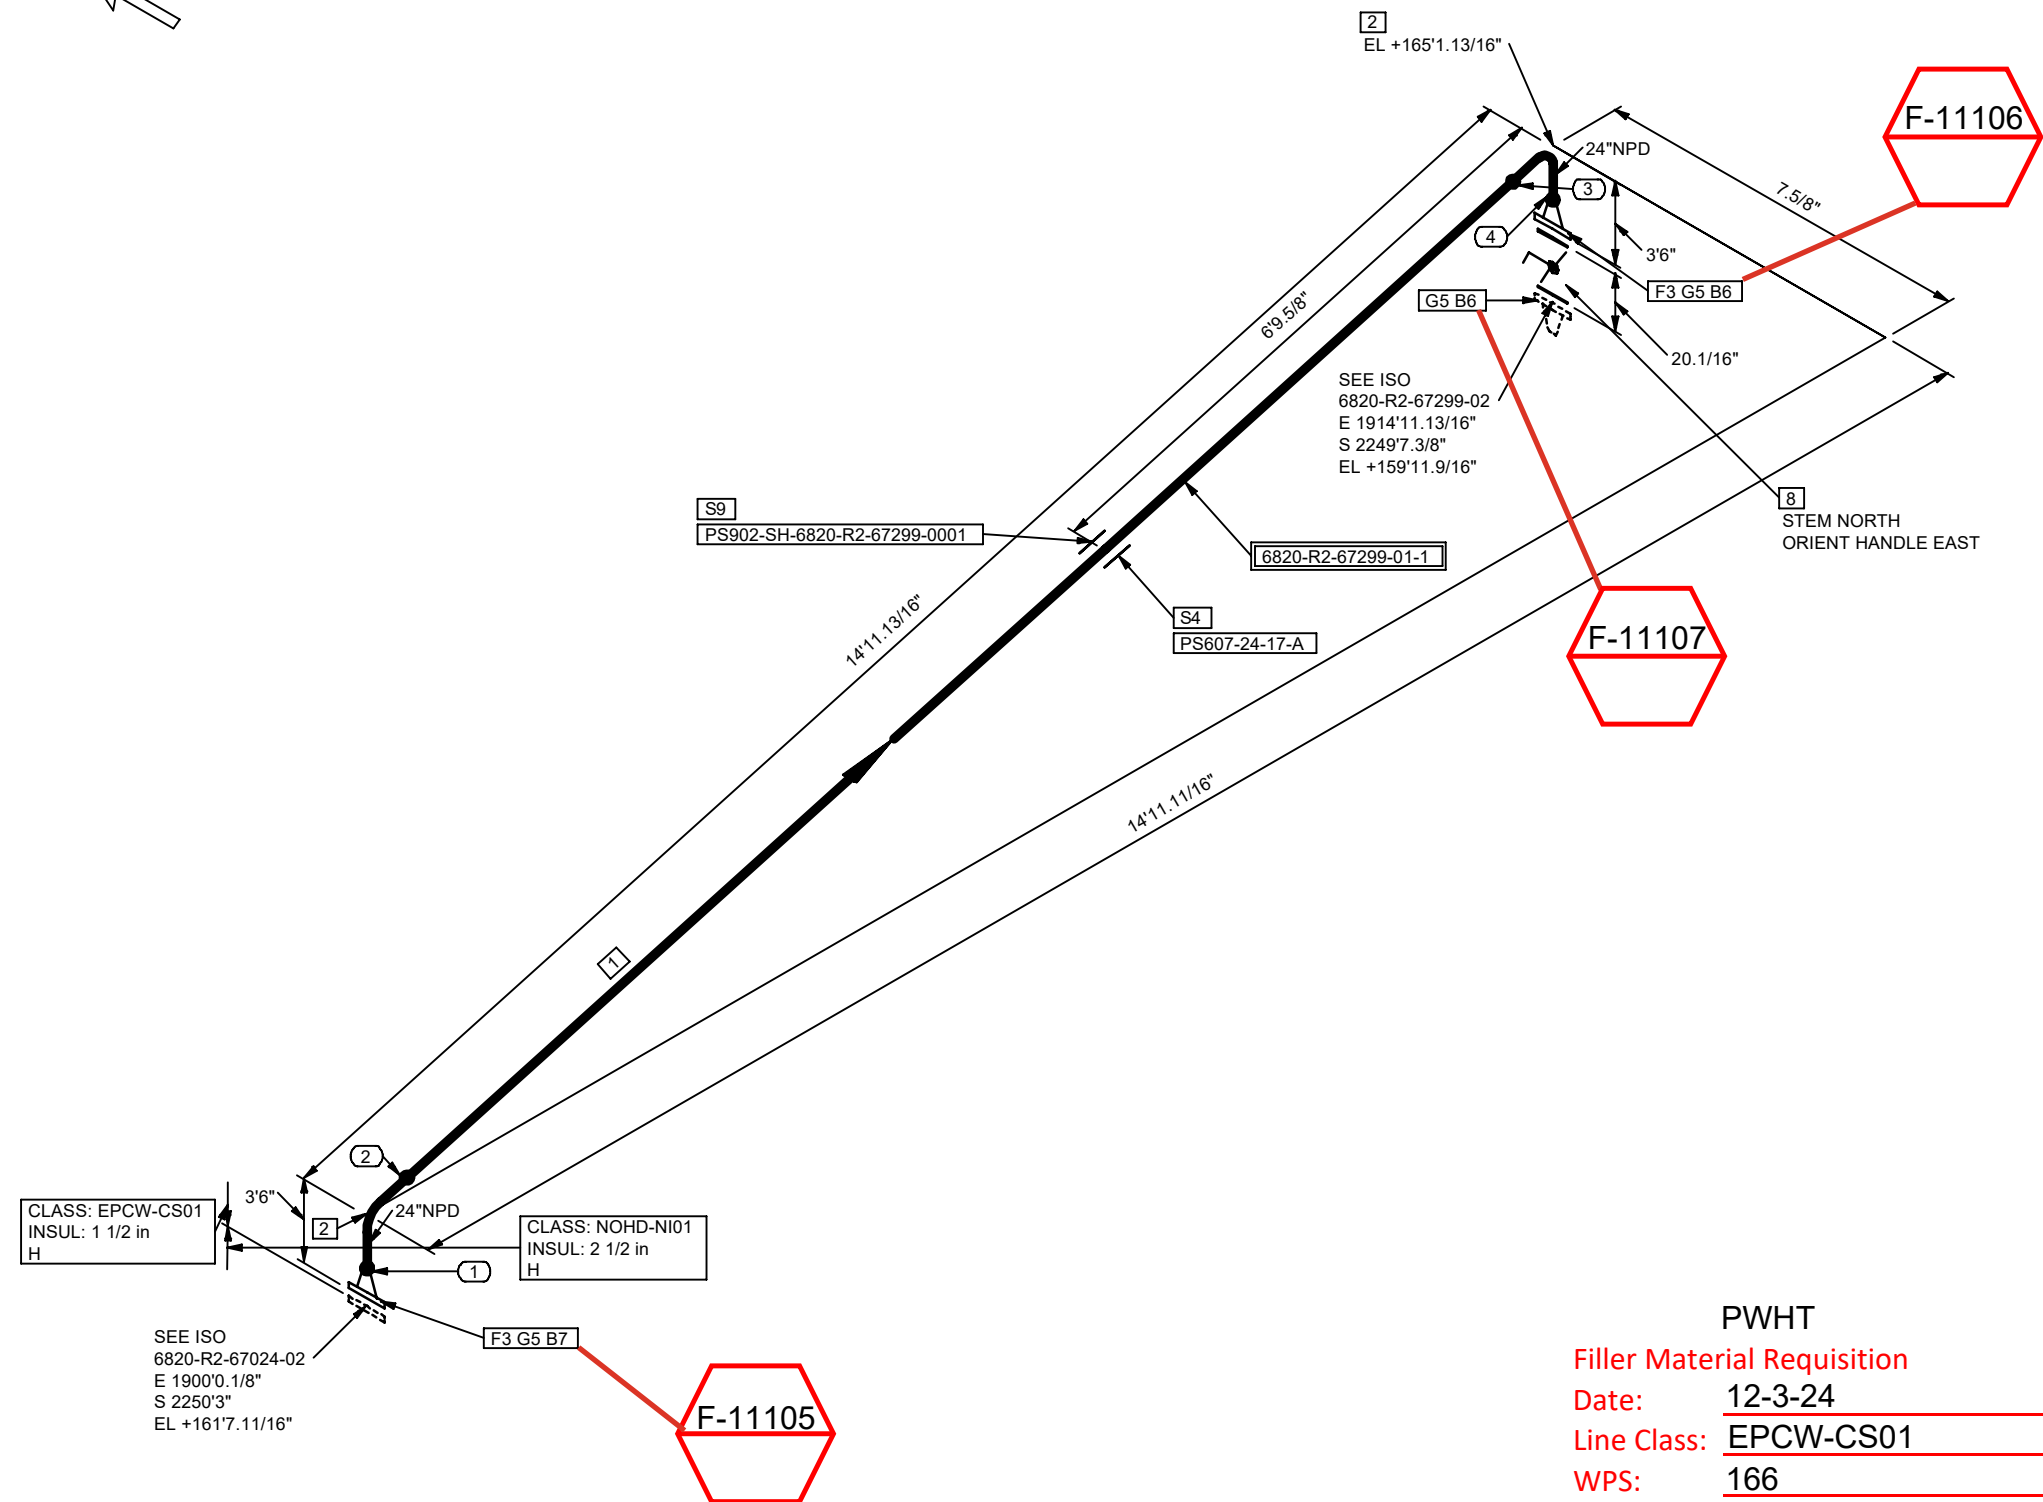

NOTES:

FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC.
REFER TO LATEST REVISION OF LDT.

FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.


FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.

FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.

ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.

FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD
9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.

REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



0	2024-11-22	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD

PWHT
 Filler Material Requisition
 Date: 12-3-24
 Line Class: EPCW-CS01
 WPS: 166
 Electrode: ER70S-2
 Signature: *Glenn Sumrall Jr*

Turner Industries Group, LLC
Received
DECEMBER 03, 2024
DOCUMENT CONTROL

SERVICE: R2	VAPOR/LIQUID: V	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -	
				P&ID: 202998C-001-PID-0021-0322				
				UNIT#: 6800	EWP AREA: 6820	SPEC: EPCW-CS01	STRESS CALC #: CN-0386	
				LINE No. 24"-R2-67299-EPCW-CS01-H				
				DRAWING NUMBER 6820-R2-67299-01				REV. 0
				OxyChem Redstone Battleground PROJECT				