




Filler Material Requisition
Date: 8-14-24
Line Class: SCXL-CS02
WPS: 10245
Electrode: ER70S-2
Signature: *Glenn Sumrall Jr*
COORDINATE SYSTEM : PLANTCOORDINATES

SHOP MATERIALS					
NO	NPD	DESCRIPTION	IDENT	QTY	
1	4	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP0AAXH	6.0	'
2	8X4	Ecc Reducer, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, -, S-STD	CDB6DMUB	1	
3	4	WN Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/BW End, -, S-STD	CFG6WKS9	5	
PIPE SUPPORTS					
4	4	PS607-4-26.06-A	PS607	1	
5	4	PS109-4-8-B	PS109	1	
OTHER THAN SHOP MATERIALS					
NO	NPD	DESCRIPTION	IDENT	QTY	
6	4	SP-6804	SP-6804	1	
7	4	NM Flat Gk, Barium Sulfate filled PTFE, 300 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -, SBlit 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 4.5 in. Length	C7CX7CSR	4	
8	3/4		C6S4K8BD	16	
9	3/4	SBlit 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 4.75 in. Length	C6S4K8BE	8	
PIPE SUPPORTS					
10	4	PS218-B	PS218	1	
11	4	PS214-16	PS214	1	
12	4	PS209-D2	PS209	1	
PIECE MARKS					
6820-R2-67327-02-1 6820-R2-67327-02-2 6820-R2-67327-02-3					

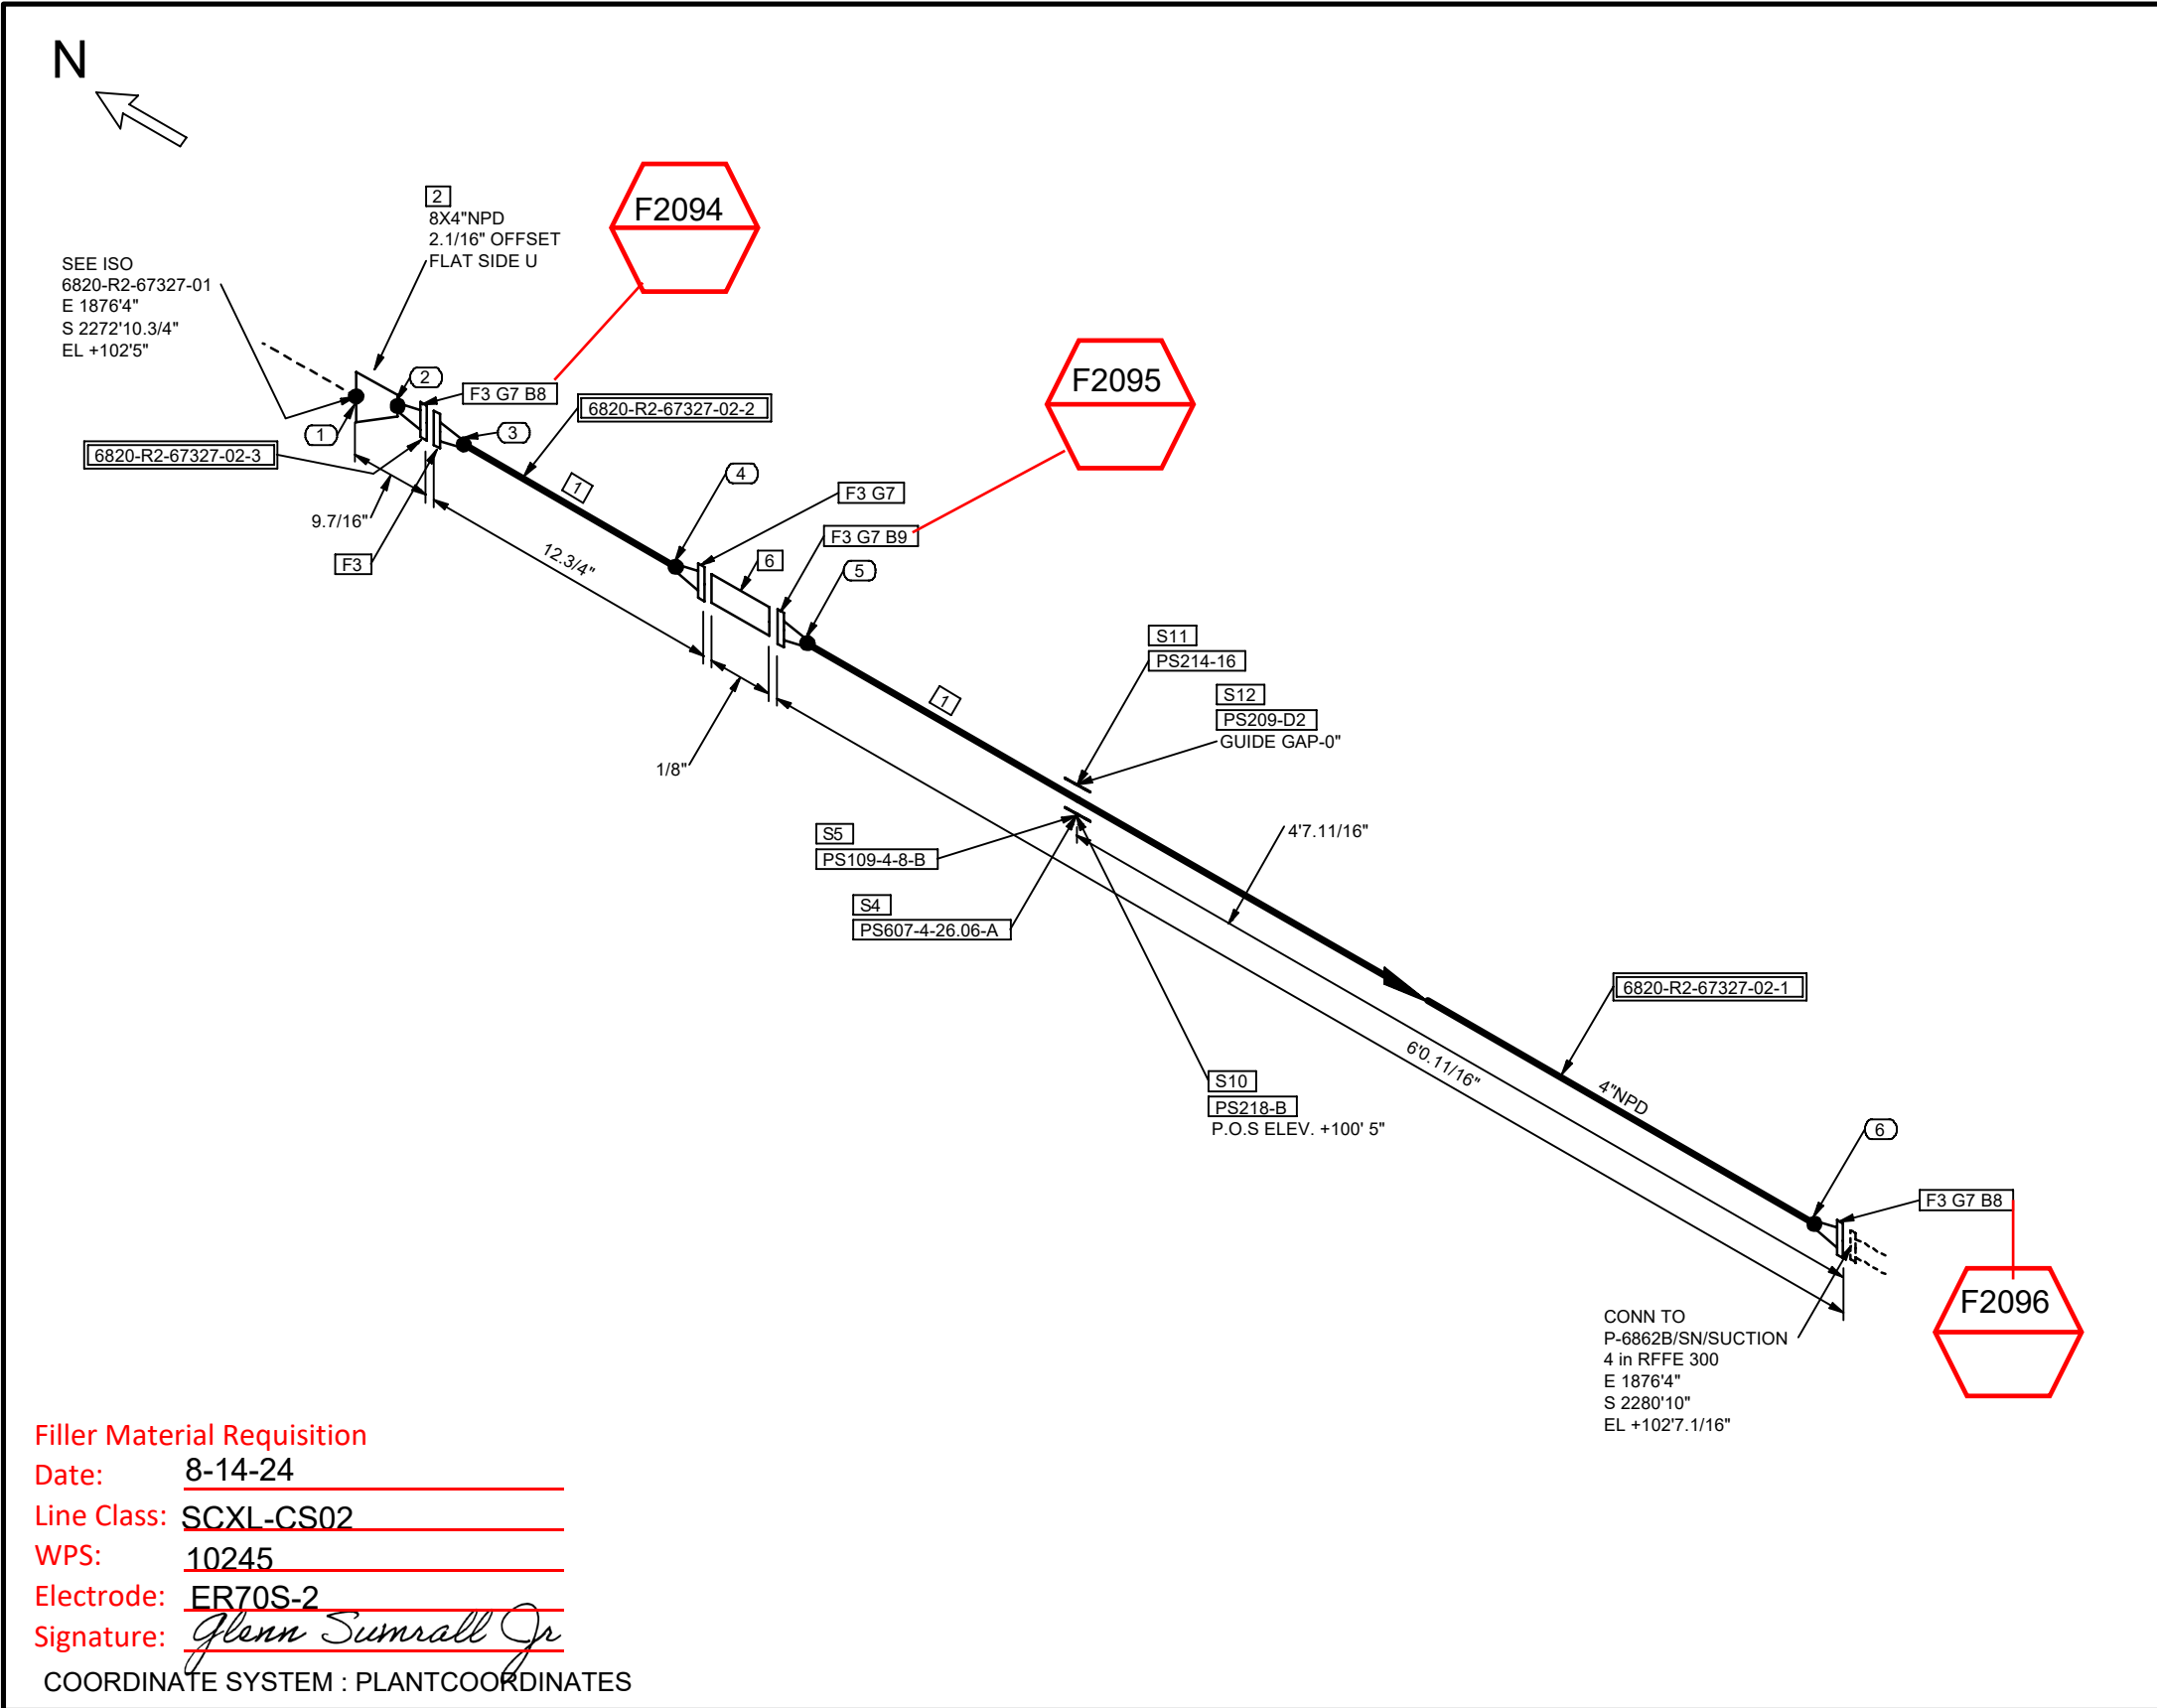

NOTES:				T.EN TECHNIP ENERGIES Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract. THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED				SERVICE: R2		VAPOR/LIQUID: L		INSUL TYPE: Per LDT		INSUL THK: Per LDT		SHOP: Y		FIELD: Y		PAINT CODE: Per LDT		MODULE: -	
1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.								OXY OxyChem Redstone Battleground PROJECT P&ID: 202998C-001-PID-0021-0321 UNIT#: 6800 EWP AREA: 6820 SPEC: SCXL-CS02 STRESS CALC #: CN-0384 LINE No. 8"-R2-67327-SCXL-CS02-H DRAWING NUMBER 6820-R2-67327-02 REV. 0															
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.																							
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.																							
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.																							
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.																							
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.								0		2024-08-09		RVA		ISSUED FOR CONSTRUCTION				SAD		KJK		SMR	
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.				REV		DATE		BY		DESCRIPTION				CHKD		MTO		STRESS		APRVD			

