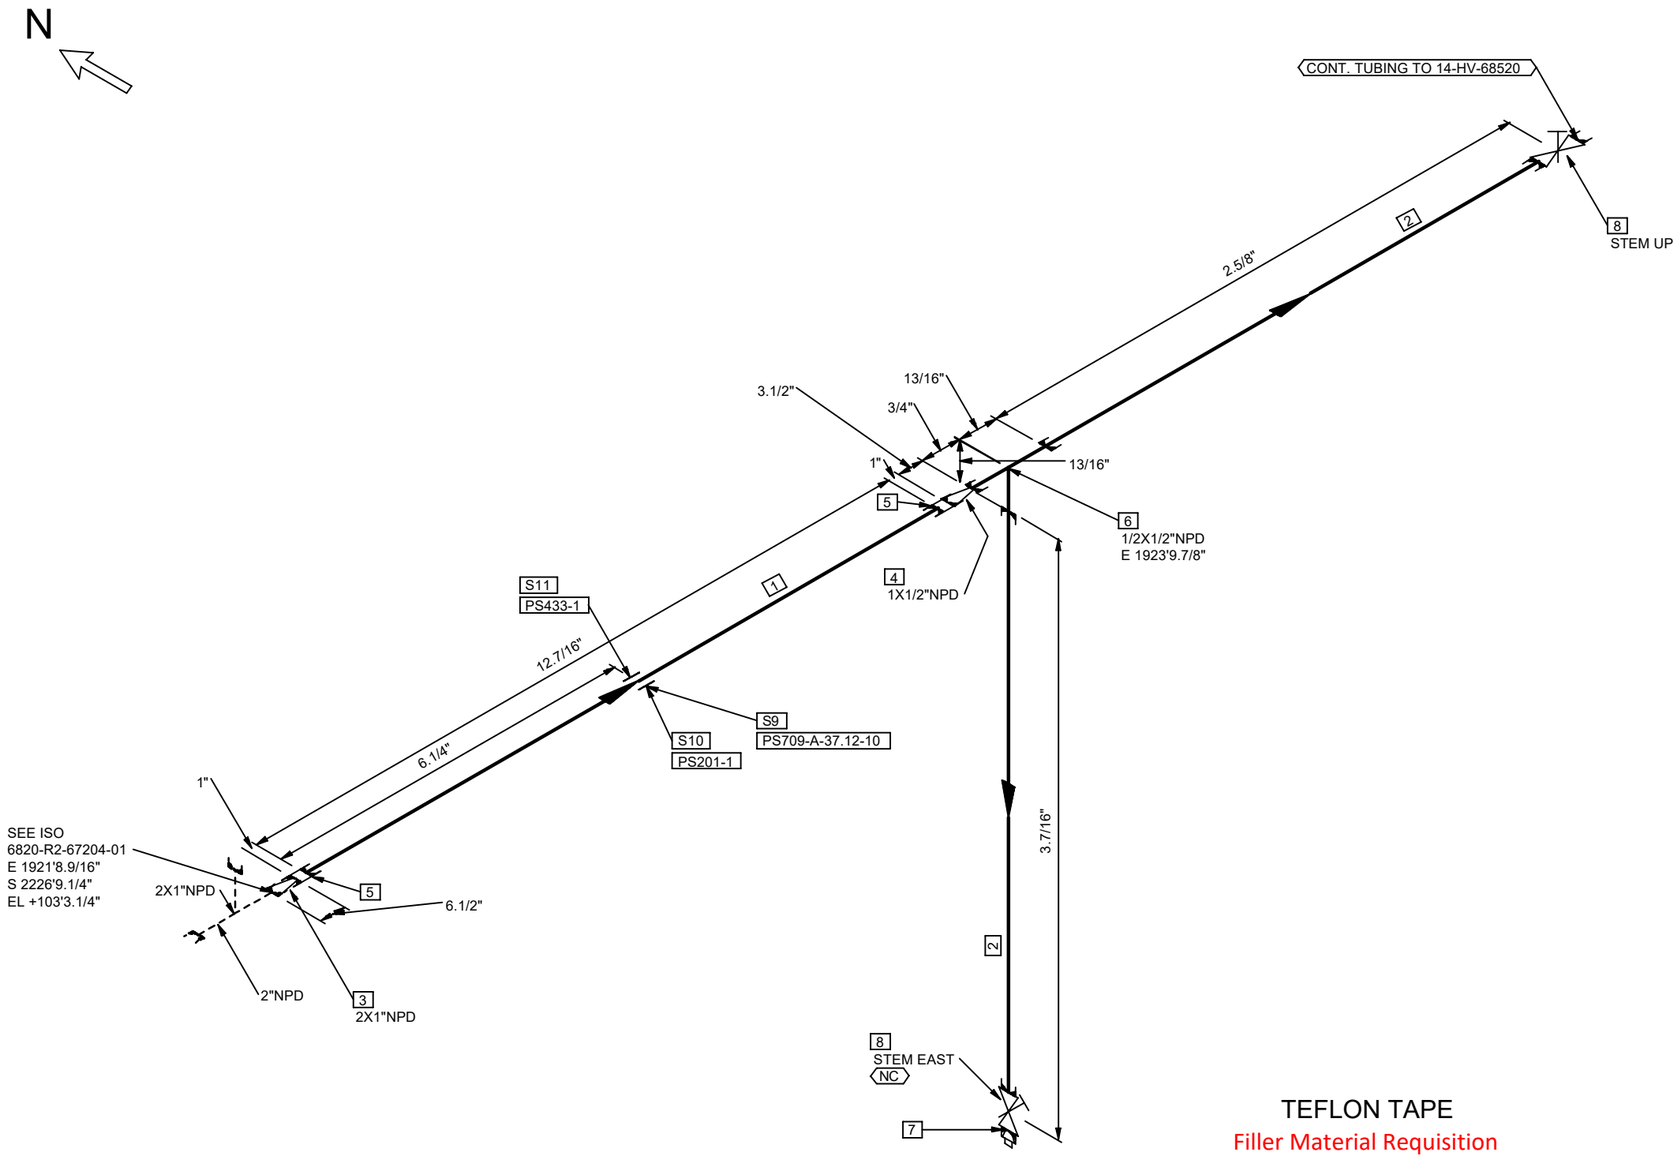


COORDINATE SYSTEM : PLANTCOORDINATES

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	1	Pipes, Seamless, ASME B36.10, ASTM A53 Gr.B Galv. as per ASTM A153, NPTM Ends, w/ coupling, -, S-XS	C6SBR43V	1.1 '
2	1/2	Pipes, Seamless, ASME B36.10, ASTM A53 Gr.B Galv. as per ASTM A153, NPTM Ends, w/ coupling, -, S-XS	C6SBR422	0.5 '
3	2X1	Concentric swage, MSS SP-95, ASTM A234 Gr.WPB Galv. as per ASTM A153,NPTM Ends,-, -, S-XS	C53S7A7	1
4	1X1/2	Concentric swage, MSS SP-95, ASTM A234 Gr.WPB Galv. as per ASTM A153,NPTM Ends,-, -, S-XS	CDFD3U7Y	1
5	1	Full Coup, ASME B16.11, ASTM A105N Galv. as per ASTM A153, 3000 Lbs, NPTF Ends, -,	CZ2LEZE	2
6	1/2X1/2	Eq Te, ASME B16.11, ASTM A105N Galv. as per ASTM A153, 3000 Lbs, NPTF Ends, -,	C5FX9CE	1
7	1/2	Plug, Solid Round Head Type, ASME B16.11, ASTM A105N Galv. as per ASTM A153, NPTM End, -,	C1NJUHLW	1
8	1/2	Gat Fem, MSS SP-80, ASTM B62 UNS C83600,125 Lbs, NPTF Ends, HO,-, Valve Tag: GA-0110	C76KHVWS	2
		PIPE SUPPORTS		
9	1	PS709-A-37.12-10	PS709	1
10	1	PS201-1	PS201	1
11	1	PS433-1	PS433	1

TEFLON TAPE

Filler Material Requisition

Date: 1-25-25

Line Class: ARDG-XX01

WPS: N/A

Electrode: N/A

Signature: Glenn Sumrall Jr

Turner Industries Group, LLC
Received
January 24,2025
DOCUMENT CONTROL

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

T.EN TECHNIP ENERGIES

Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client.use of this information is restricted in accordance with conditions specified by the contract.Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
0	2025-01-17	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR

SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:
R2	V	Per LDT	Per LDT	N	Y	Per LDT	-

OXY

OxyChem Redstone Battleground
PROJECT

P&ID: 202998C-001-PID-0021-0336

UNIT#:	EWP AREA:	SPEC:	STRESS CALC #:
6800	6820	ARDG-XX01	-

LINE No.: 1"-R2-67202-ARDG-XX01-N

DRAWING NUMBER: 6820-R2-67202-01

REV.: 0

17 JAN 2025 04:40