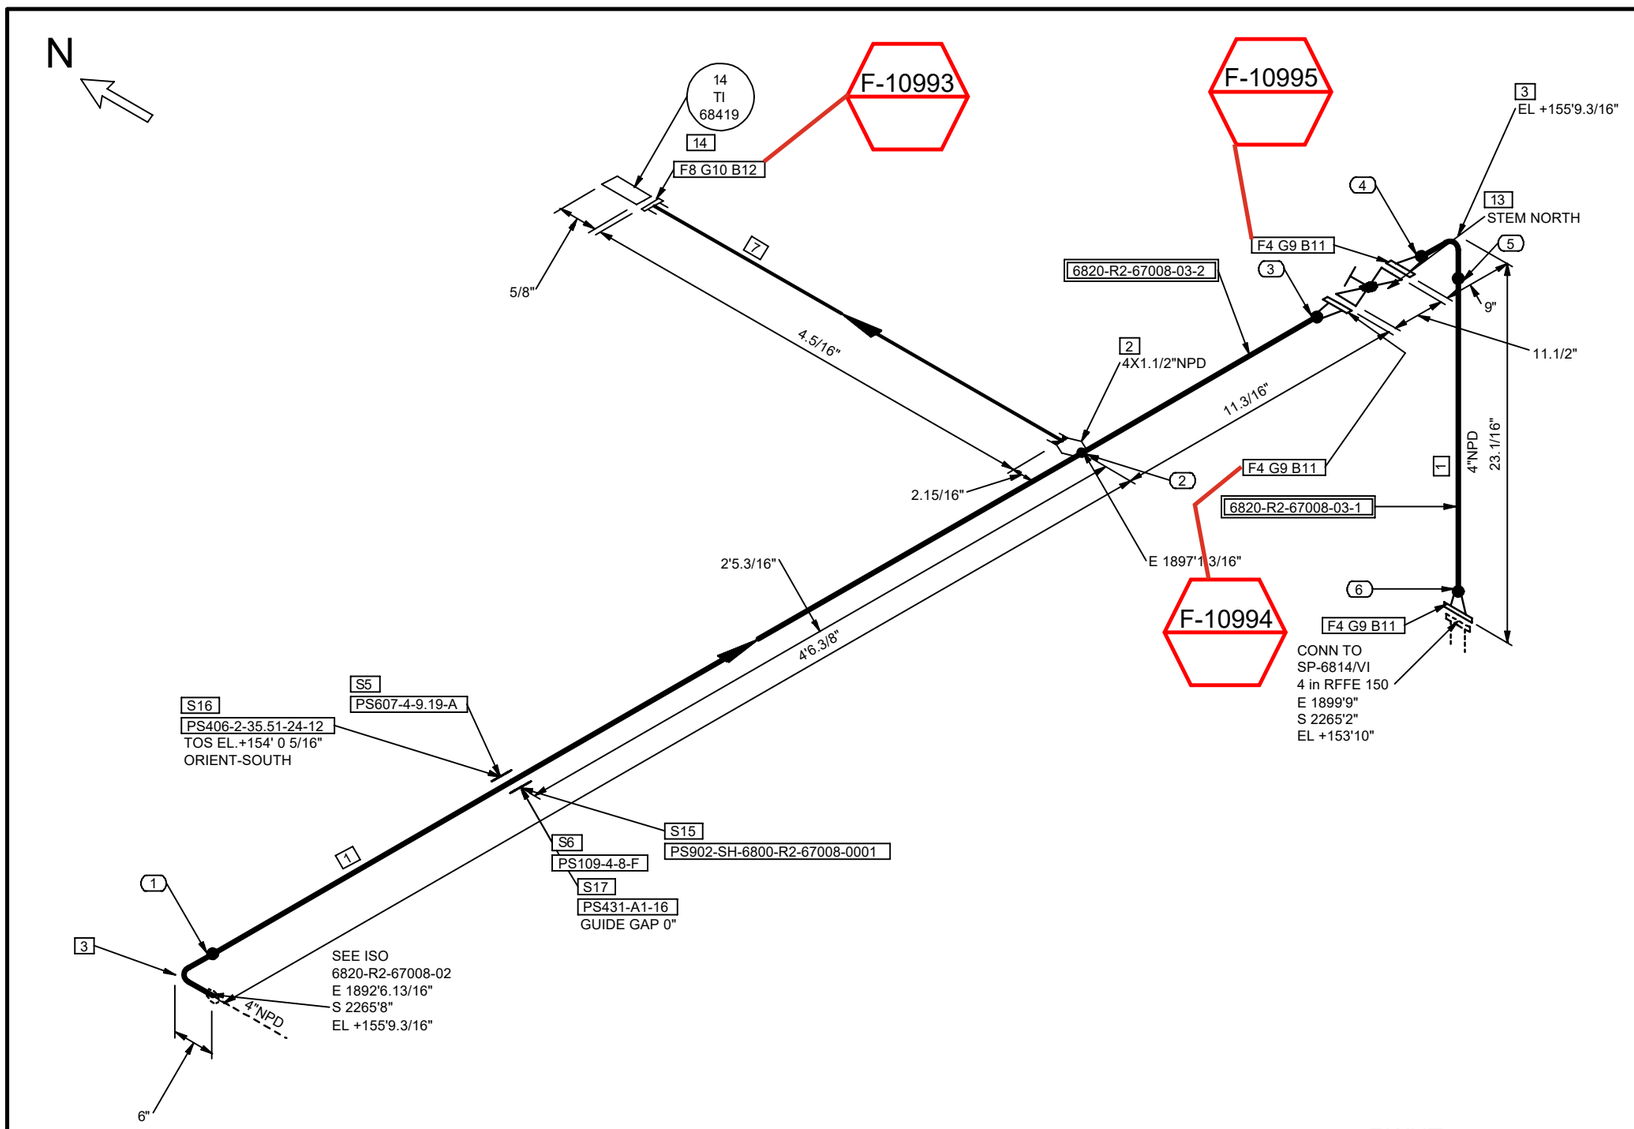


SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	4	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP0AAXH	5.9 '
2	4X1.1/2	Threadolet, ASTM A105N, 3000 Lbs, NPTF Ends, -, -,	CLT8TVLU	1
3	4	90° Elb LR, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -,-, S-STD	CDB66GLS	2
4	4	WN Flg, ASME B16.5, ASTM A105N, 150 Lbs, RF/BW End, -, S-STD	CFG6WJF4	3

PIPE SUPPORTS

5	4	PS607-4-9.19-A	PS607	1
6	4	PS109-4-8-F	PS109	1

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
7	1.1/2	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, NPTM Ends, w/ coupling, -, S-XS	CEZCLVN	0.4 '
8	1.1/2	THD Flg, ASME B16.5, ASTM A105N, 150 Lbs, RF/NPTF End, -,	CFG8U740	1
9	4	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C7CT1ZFZ	3
10	1.1/2	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C7CT1ZFK	1
11	5/8	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3.75 in. Length	C6S4K88S	24
12	1/2	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3 in. Length	C6S4K87V	4
13	4	Glo Flg, API 623, ASTM A216 Gr.WCB,150 Lbs, RF, Ends as per ASME B16.5, HO,-, Valve Tag: GL-0627	C84KV7D0	1

INSTRUMENTS

14	1.1/2	14-TI-68419	14-TI-68419	1

PIPE SUPPORTS

15	4	PS902-SH-6800-R2-67008-0001	PS902	1
16	4	PS406-2-35.51-24-12	PS406	1
17	4	PS431-A1-16	PS431	1

PIECE MARKS

6820-R2-67008-03-1 6820-R2-67008-03-2

PWHT

Filler Material Requisition

Date: 12-3-24

Line Class: EPCW-CS01

WPS: 166

Electrode: ER70S-2

Signature: Glenn Sumrall Jr

Turner Industries Group, LLC
Received
DECEMBER 03,2024
DOCUMENT CONTROL

COORDINATE SYSTEM : PLANTCOORDINATES

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

T.EN TECHNIP ENERGIES

Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client.use of this information is restricted in accordance with conditions specified by the contract.Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
0	2024-11-15	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR

SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:
R2	V	Per LDT	Per LDT	Y	Y	Per LDT	-

OXY

OxyChem Redstone Battleground
PROJECT

P&ID: 202998C-001-PID-0021-0320

UNIT#:	EWP AREA:	SPEC:	STRESS CALC #:
6800	6820	EPCW-CS01	CN-0383

LINE No. 4"-R2-67008-EPCW-CS01-H

DRAWING NUMBER: **6820-R2-67008-03**

REV.: **0**

16 NOV 2024 06:55