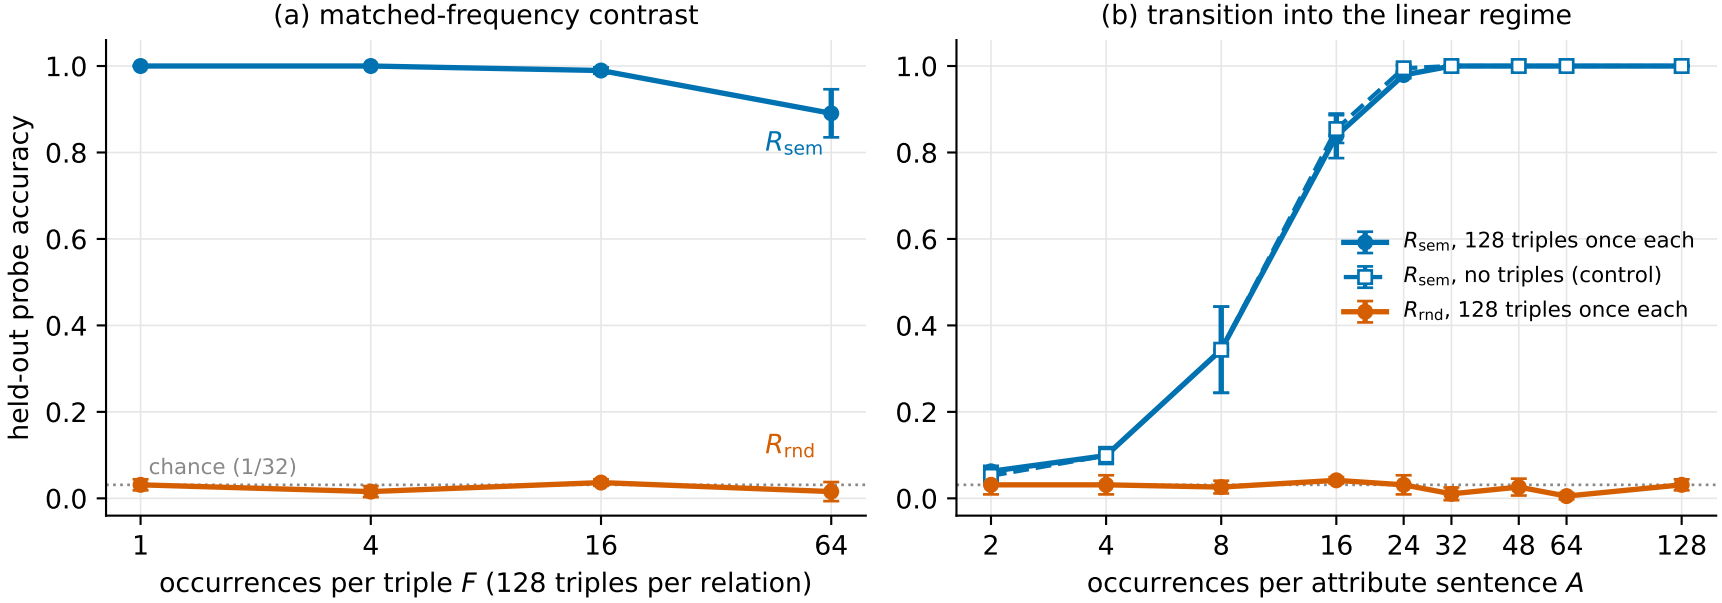
(a) matched-frequency contrast
held-out probe accuracy
1.0
0.8
0.6
0.4
0.2
0.0
R_{sem}
R_{rnd}
chance (1/32)
1
4
16
64
occurrences per triple F (128 triples per relation)
(b) transition into the linear regime
R_{sem}, 128 triples once each
R_{sem}, no triples (control)
R_{rnd}, 128 triples once each
2
4
8
16
24
32
48
64
128
occurrences per attribute sentence A