



24GA (MIN) ML150 OVER 15/32" (MIN) PLYWOOD

FL 38763.02 R2 | HVHZ



10877 NW 33RD ST | DORAL, FL 33172

786-349-4009



Product Description:

Mechanical standing seam panel with 16" maximum coverage and a nominal rib height of 1.5"



Product Material:

24ga (min) steel Corrosion resistant per FBC 1507.4.3 where required



Fastener:

#10 x 1-inch pancake style fastener, 2 per clip Compliant with FBC 1506.6 where required.



Substrate/Deck:

15/32" (min) plywood or 3/4" (min) thick wood plank (min S.G. of 0.42)



Maximum Allowable Loads & Installation Requirements:


90° seam & (2) #10 x 1" fasteners per clip with clips at 24" max.

<u>Clip spacing:</u>	<u>24"</u>	<u>20"</u>	<u>16"</u>	<u>12"</u>	<u>6"</u>
<u>Max allowable uplift (PSF):</u>	<u>86</u>	<u>106</u>	<u>126</u>	<u>146</u>	<u>176</u>

A factor of safety of 2 has been applied. Further interpolation between 24" and 6" is permitted.



ML 150

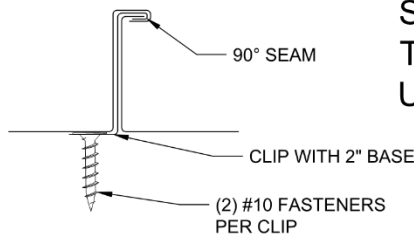

SELECT MAX CLIP SPACING
TO ACHIEVE REQUIRED
UPLIFT PRESSURE



Clip:

24ga, 2" long fixed clip




Evaluated by:

David Eng, PE | Timberlake Cove, LLC | 1317 Edgewater Dr Ste 2339 | Orlando FL
FL PE 81377 | FL CA 33344 | www.TimberLakeCove.com

David E. Eng

Digitally signed
by David E Eng
Date: 2023.08.24
09:07:39-04'00'

This item has been digitally signed and sealed by D.E. Eng, PE, on the date indicated. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

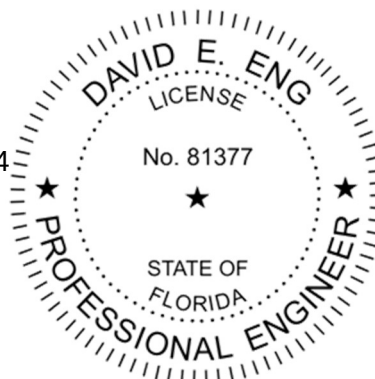

Underlayment: Comply with local building code or FBC 1507.1.1/1518.2 where required.

Slope: Comply with local building code or FBC 1507.4.2/FBC 1515.2 where required.

In the HVHZ, this panel has been tested to ASTM E-2140 and may be installed at 1:12 – 2:12 slope, with a continuous bead of a Miami Dade Approved Sealant applied along the entire male rib before attaching the adjacent panel. Slopes at 2:12 or above do not require sealant. Installation outside of HVHZ does not require sealant unless compliance with ASTM E-2140 is otherwise required.

Re-Roofing: This panel may be installed over a single layer of existing shingles as permitted by local building code or FBC 1511/1521, provided the existing roof meets the conditions required by the applicable code.

Fire Barrier: Comply with FBC 1516.1 and 1516.2 where required.

Technical Documentation:

This product has been tested to the following standards by Intertek Testing (TST 1527):

- TAS 125 & UL580/UL1897: report L2072.01-450-18 R0
- TAS 100: report L2072.02-450-18 R0
- ASTM E-2140: report L2072.07-450-18 R0

Compliance Statement:

This product as described has demonstrated compliance with Florida Building Code 2023, 1504.3.2 (non-HVHZ) and 1518.9.1/1523.6.5.2.4 (HVHZ), as required by FL Rule 61G20-3, method 1D; subject to the exclusions/limitations noted below.

Design Process:

The load tables in this report provides one prescriptive option for the fastening requirement for the applicable wind loads for roofs within the parameters described. For roofs outside of the listed parameters, design wind loads shall be determined as required by FBC 1609, ASCE 7, or other design code in force, using allowable stress. These load tables are based on ASCE 7-22. Use of these tables assumes that the structure is:

- Enclosed and conforms to wind-borne debris provisions and is a regular shaped building
- Is not subject to across-wind loading, vortex shedding, or instability; nor does it have a site location for which channeling or buffeting warrant consideration

Engineering analysis may be completed by other licensed engineers for project specific approval by local authorities having jurisdiction.

Certification of Independence:


David Eng, PE and Timberlake Cove, LLC do not have, nor will they acquire a financial interest in any company manufacturing or distributing products under this evaluation. The same entities do not have, nor will they acquire, a financial interest in any other entity involved in the approval or testing process of the product.

Exclusions and Limitations:

Design of deck and roof structure (to include deck attachment) shall be completed by others. Fire classification and shear diaphragm design are outside the scope of this evaluation. Accelerated weathering/salt spray is outside the scope of this evaluation. Static water leakage is outside the scope of this evaluation.

This report is limited to compliance with structural wind load requirements of FBC 1504.3.2, as required by Rule 61G20-3. Neither Timberlake Cove nor the manufacturer shall be responsible for any conclusions, interpretations, or designs made by others based on this evaluation report. This report is limited solely to documenting compliance with Rule 61G20-3, and makes no express or implied warranty regarding performance of this product.

ML 150

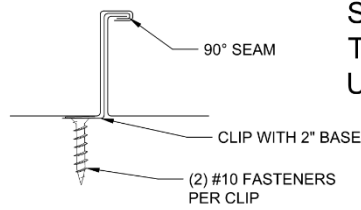

SELECT MAX CLIP SPACING TO ACHIEVE REQUIRED UPLIFT PRESSURE

Use this load table for structures which meet the following criteria:
 Are located in **Exposure B** area
 Have either a **flat roof**, or **gable/hip roof** with **max slope of 45°**
 Have a mean Roof Height of **30 feet or less**

FL38763.02: 24ga 150MS on 15/32" plywood

Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
Zone 2:	24"	24"	24"	24"	24"	24"	24"	24"	24"	20"	20"
Zone 3:	24"	24"	24"	24"	24"	24"	20"	20"	16"	16"	12"

Use this load table for structures which meet the following criteria:
 Are located in **Exposure B** area
 Have either a **flat roof less than 7°**, **hip roof** with **max slope of 45°**, or **gable roof** with **slope between 20° and 45°**
 Have a mean Roof Height of **30 feet or less**

FL38763.02: 24ga 150MS on 15/32" plywood

Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
Zone 2:	24"	24"	24"	24"	24"	24"	24"	24"	24"	20"	20"
Zone 3:	24"	24"	24"	24"	24"	24"	24"	20"	20"	16"	16"

Use this load table for structures which meet the following criteria:
 Are located in **B, C, or D exposure** area
 Have either a **flat roof**, or **gable/hip roof** with **max slope of 45°**
 Have a mean Roof Height of **30 feet or less**


FL38763.02: 24ga 150MS on 15/32" plywood

Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	24"	24"	24"	24"	24"	24"	24"	20"	16"	16"	12"
Zone 2:	24"	24"	24"	24"	24"	20"	16"	12"	12"	6"	6"
Zone 3:	24"	24"	24"	20"	16"	12"	6"	6"	NR	NR	NR

Use this load table for structures which meet the following criteria:
 Are located in **B, C, or D exposure** area
 Have either a **flat roof less than 7°**, **hip roof** with **max slope of 45°**, or **gable roof** with **slope between 20° and 45°**
 Have a mean Roof Height of **30 feet or less**

FL38763.02: 24ga 150MS on 15/32" plywood

Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	24"	24"	24"	24"	24"	24"	24"	20"	20"	16"	16"
Zone 2:	24"	24"	24"	24"	24"	20"	20"	16"	12"	6"	6"
Zone 3:	24"	24"	24"	20"	20"	16"	12"	6"	6"	NR	NR

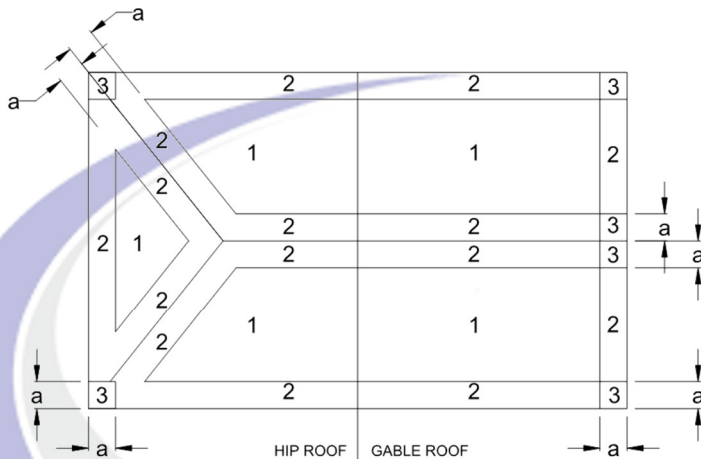

a: 10% OF LEAST HORIZONTAL DIMENSION OR 0.4h, WHICHEVER IS SMALLER, BUT NOT LESS THAN EITHER 4% OF LEAST HORIZONTAL DIMENSION OR 3FT (0.9M), OR AS DETERMINED BY DESIGN OR OTHER APPLICABLE CODE.

ROOF ZONES FOR GENERIC BUILDING