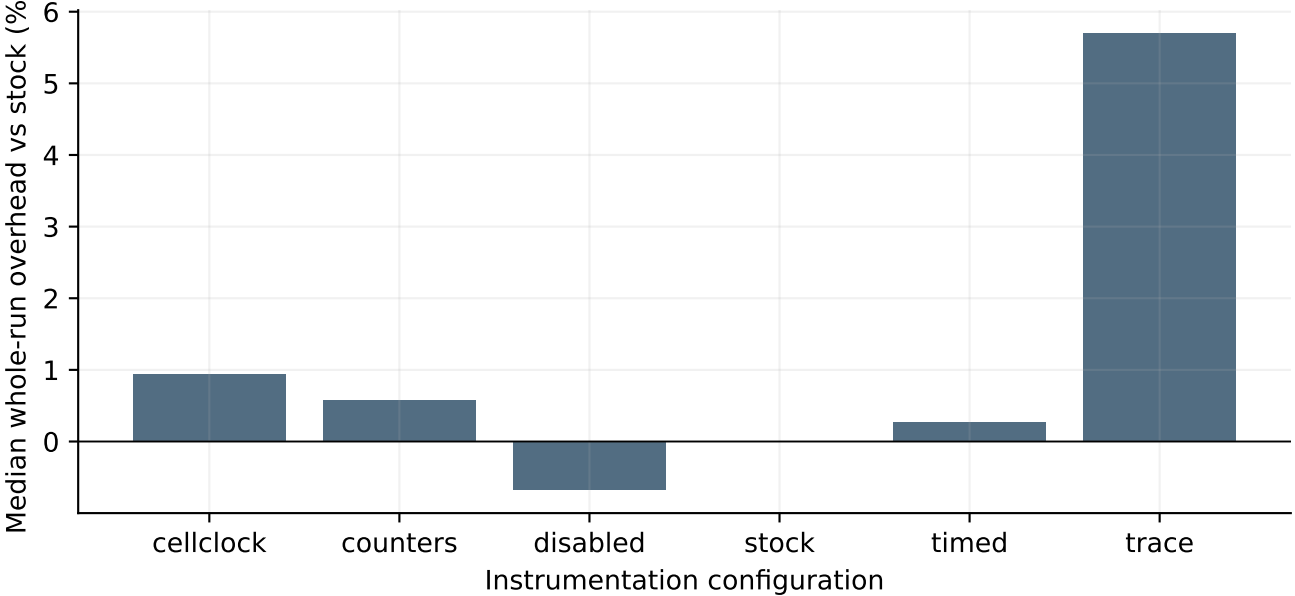
Median whole-run overhead vs stock (%)
6
5
4
3
2
1
0
cellclock
counters
disabled
stock
timed
trace
Instrumentation configuration