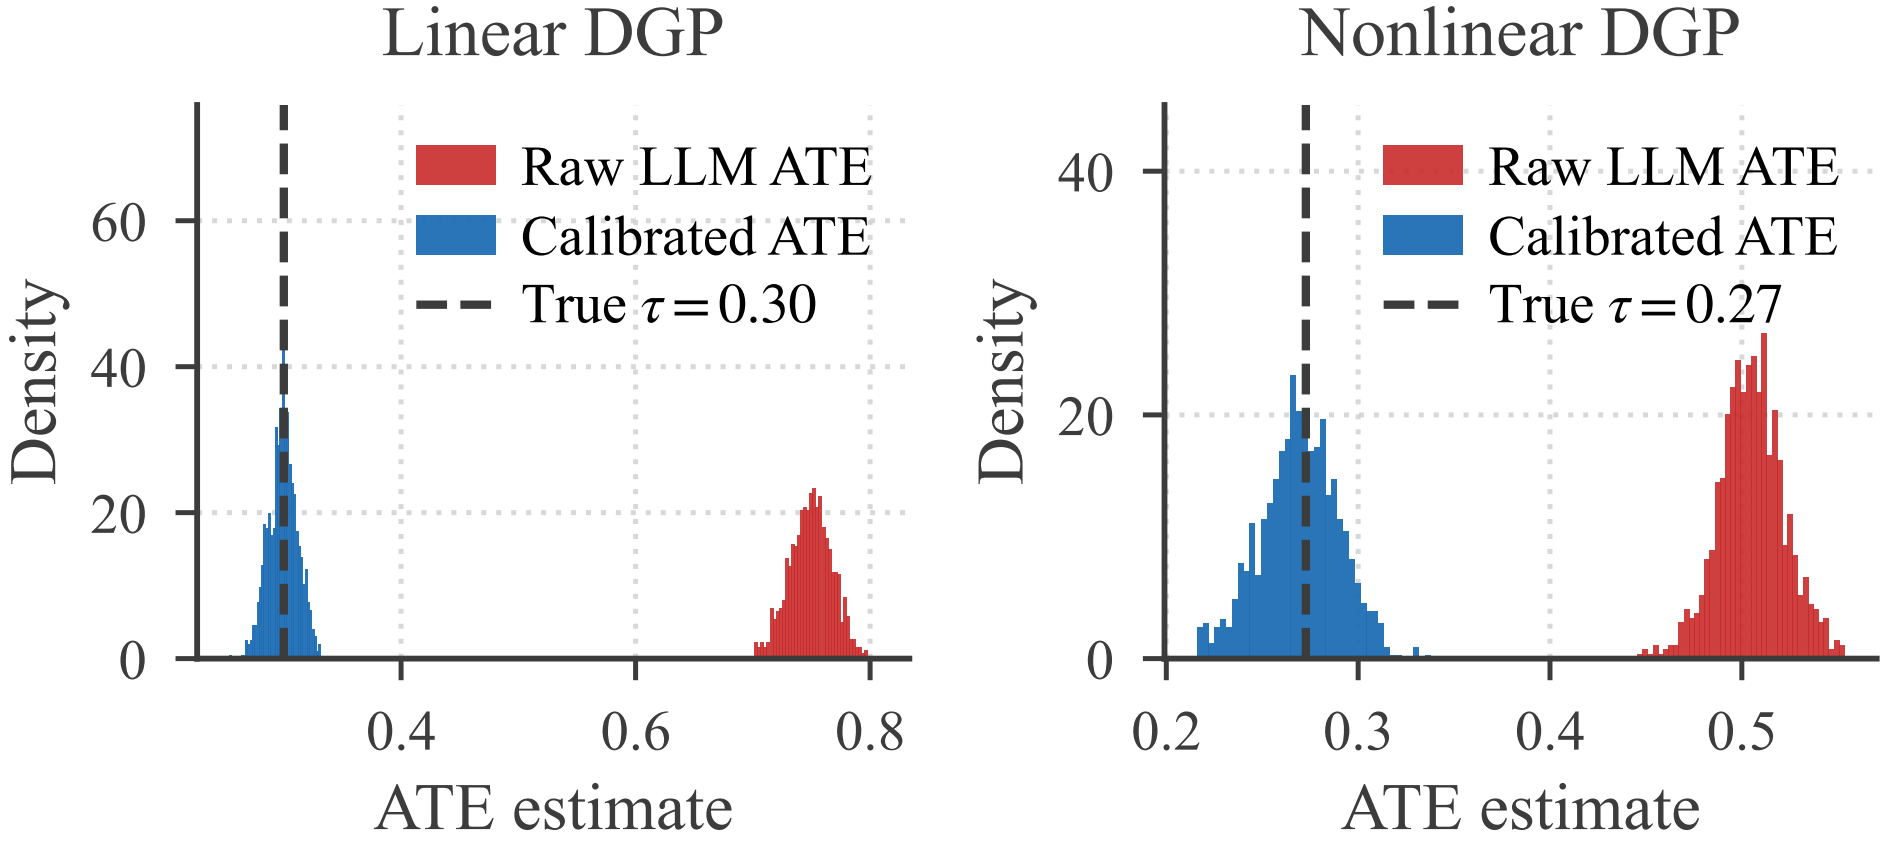
Linear DGP
Raw LLM ATE
Calibrated ATE
True $\tau = 0.30$
Density
ATE estimate
0
20
40
60
0.4
0.6
0.8
Nonlinear DGP
Raw LLM ATE
Calibrated ATE
True $\tau = 0.27$
Density
ATE estimate
0
20
40
0.2
0.3
0.4
0.5