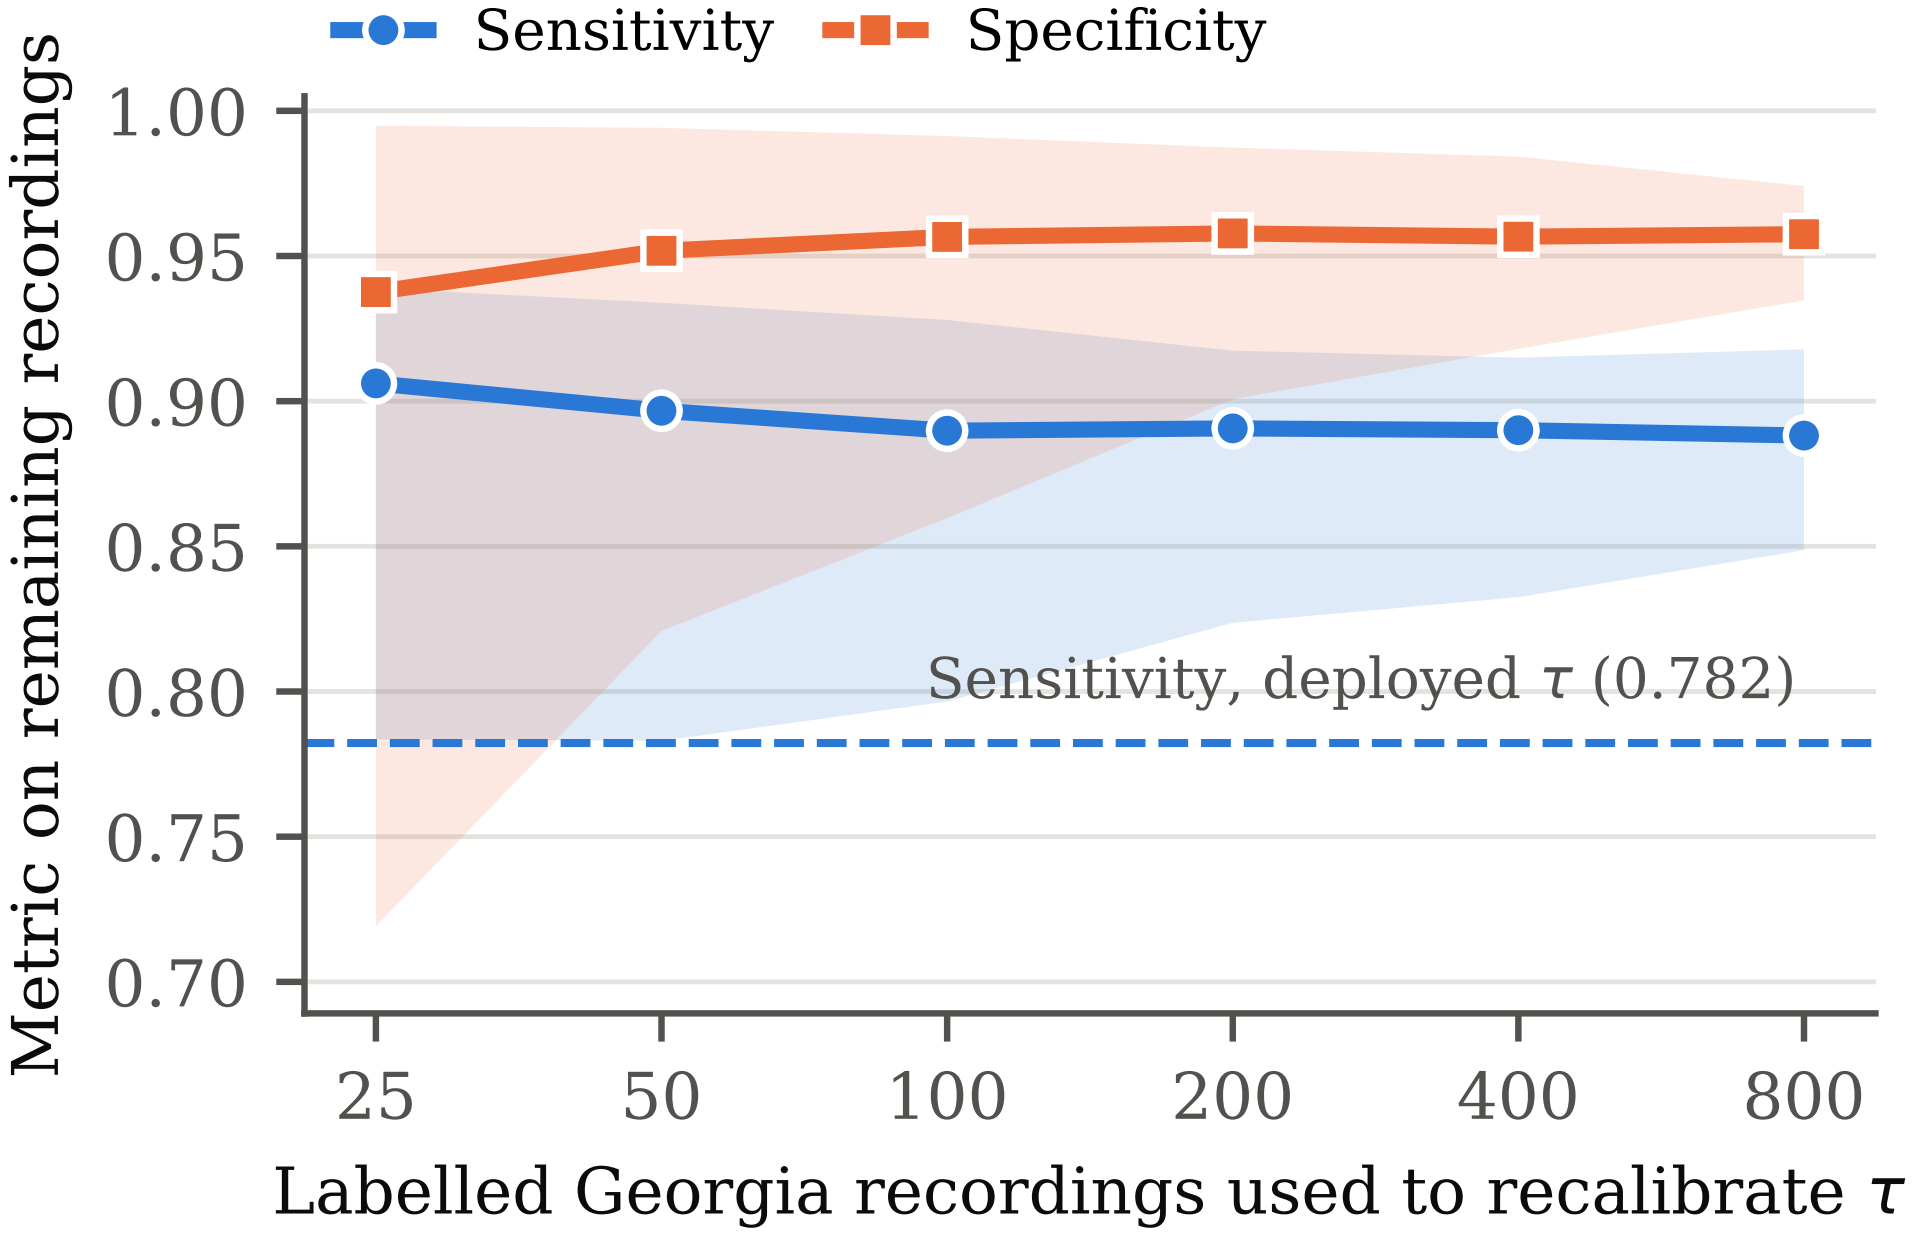
Sensitivity
Specificity
Metric on remaining recordings
1.00
0.95
0.90
0.85
0.80
0.75
0.70
Sensitivity, deployed τ (0.782)
25
50
100
200
400
800
Labelled Georgia recordings used to recalibrate τ