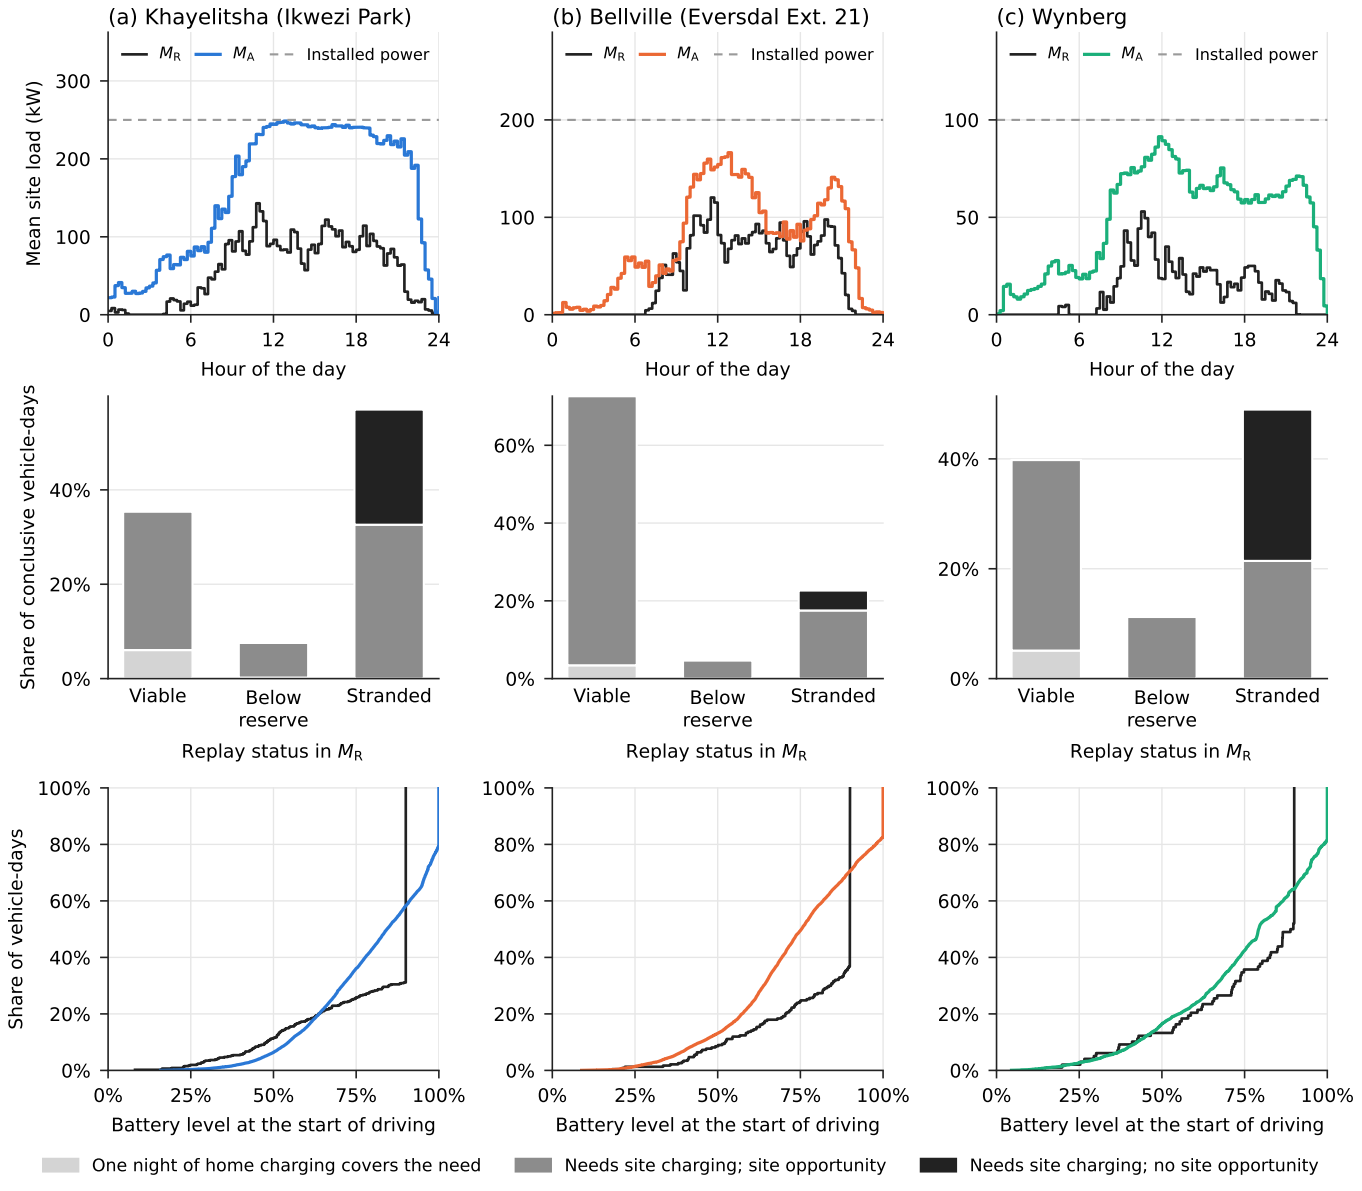
(a) Khayelitsha (Ikwezi Park)
(b) Bellville (Eversdal Ext. 21)
(c) Wynberg
M_R
M_A
Installed power
Mean site load (kW)
Hour of the day
Share of conclusive vehicle-days
Viable
Below reserve
Stranded
Replay status in M_R
Share of vehicle-days
Battery level at the start of driving
One night of home charging covers the need
Needs site charging; site opportunity
Needs site charging; no site opportunity