Suffolk Construction Company, Inc.
65 Allerton Street
Boston, Massachusetts 02119
P: (617) 445-3500
F: (617) 541-2128

Project: 226052 DFCI-BIDMC New Cancer Hospital - 1 Joslin Place - Construction
1 Joslin Place
Boston, Massachusetts 02215

RFI #0-PB-133: Missing Architectural Allowances Referenced on Structural Drawings for Facade Support

Revision	0	**Status**	Closed on 03/12/26
To	Mollica Manandhar (Payette Associates, Inc. (BOSTON)) Jensen Ying (Payette Associates, Inc. (BOSTON)) Emilio Cardarelli (PAYETTE) Hyunsuk Yun (Payette Associates, Inc. (BOSTON)) Jeff Abramson (Payette Associates, Inc. (BOSTON)) Jessica Hoctor (Payette Associates, Inc. (BOSTON))	**From**	Devin DiManno (Suffolk Construction) 65 Allerton St. Boston, Massachusetts 02119
Date Initiated	Mar 3, 2026	**Due Date**	Mar 10, 2026
Location		**Project Stage**	Bidding
Cost Impact	Yes (Unknown)	**Schedule Impact**	
Spec Section	051200 - STRUCTURAL STEEL FRAMING	**Cost Code**	
Drawing Number	S6.20 & S6.21	**Reference**	
Linked Drawings			
Received From	Devin DiManno (Suffolk Construction)	**Sub Job**	
Copies To	Jeff Abramson (Payette Associates, Inc. (BOSTON)), Elisa Arriaga (Vanasse Hangen Brustlin, Inc. (BOSTON)), Craig Blanchet (Lemessurier Consultants, Inc. (BOSTON)), Emilio Cardarelli (PAYETTE), Joy Clark (Leggat McCall Properties LLC), JP Connors (Suffolk Construction), Nathan Crowley (Suffolk Construction), Emil Giordano (Suffolk Construction), Kevin Griffin (Leggat McCall Properties LLC), Benjamin Hedges (Suffolk Construction), Jessica Hoctor (Payette Associates, Inc. (BOSTON)), Emily Jacobsen (Lemessurier Consultants, Inc. (BOSTON)), Avinash Jadhav (Lemessurier Consultants, Inc. (BOSTON)), Silas Mackey (Suffolk Construction), Mithila Madhavan (Lemessurier Consultants, Inc. (BOSTON)), Kevin Malenchini (Suffolk Construction) , Mollica Manandhar (Payette Associates, Inc. (BOSTON)), Rick Medeiros (Suffolk Construction), Rob Morsi (Suffolk Construction), Steve Mulligan (St. Onge Company (YORK)), Christopher O'Neil (Suffolk Construction), Kaitlyn Palmer (Lemessurier Consultants, Inc. (BOSTON)), Joel Perry (Suffolk Construction), Kyle Reilly (Suffolk Construction), Henry Sniezek (Suffolk Construction), Ben Stanton (Leggat McCall Properties LLC), Dan Sullivan (Leggat McCall Properties LLC), Sabrina Torchia (Suffolk Construction), Bob Walsh (Leggat McCall Properties LLC), Benjamin Watkins (Suffolk Construction), Jensen Ying (Payette Associates, Inc. (BOSTON)), Hyunsuk Yun (Payette Associates, Inc. (BOSTON))		

ADDITIONAL FIELDS

Required Reviewers

Urgency Low

Activity

Question

Question from Devin DiManno Suffolk Construction *on Tuesday, Mar 3, 2026 at 10:37 AM EST*

Structural drawings 6.20 and 6.21 include Note 3 stating:

"See architectural drawings for additional allowances required for façade support steel."
There are no corresponding allowances shown in the architectural drawings. Please advise whether a future architectural issuance will provide these allowances, or if Note 3 will be removed from the structural drawings in an upcoming revision.

Attachments
RFI 0-PB-132 - Missing Architectural Allowances Referenced on Structural Drawings for Facade Support.pdf

Official Response

Response from Jensen Ying Payette Associates, Inc. (BOSTON) *on Thursday, Mar 12, 2026 at 03:20 PM EDT*

Please see attached for PAI response.

Attachments
RFI 0-PB-133_Missing Arch Allowances Ref on Struct Dwgs for Facade Supports - PAI.pdf

All Replies

Response from JP Connors Suffolk Construction *on Thursday, Mar 12, 2026 at 03:27 PM EDT*

PAYETTE RESPONSE (3/12/2026):

There are no additional allowances on the architectural drawings for façade support steel. Note 3 will be removed from the structural drawings in an upcoming revision.

JYING

Response from Jensen Ying Payette Associates, Inc. (BOSTON) *on Thursday, Mar 12, 2026 at 03:20 PM EDT*

Please see attached for PAI response.

Attachments
RFI 0-PB-133_Missing Arch Allowances Ref on Struct Dwgs for Facade Supports - PAI.pdf

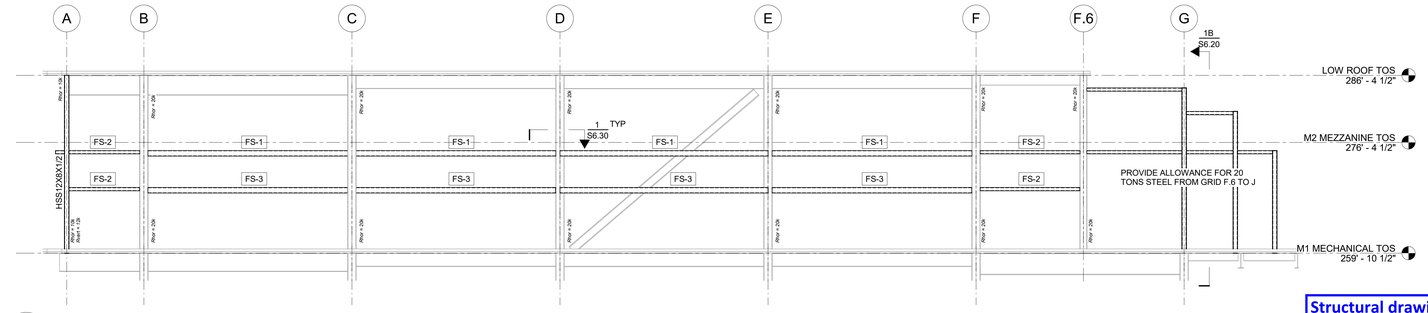

1 FACADE SUPPORT FRAMING ELEVATION - SOUTH - M1 MECHANICAL

SCALE: 1/8" = 1'-0"

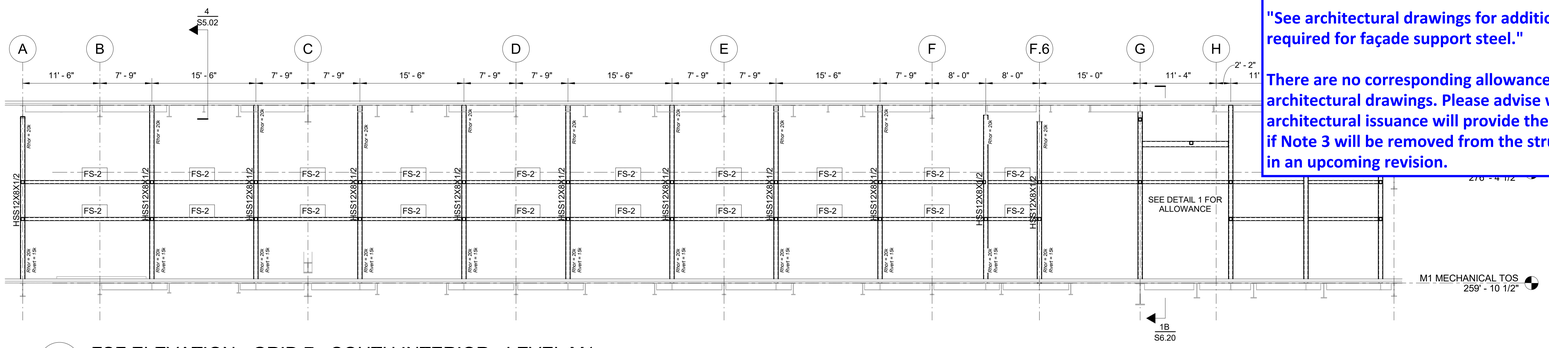

1A FSF ELEVATION - GRID 7 - SOUTH INTERIOR - LEVEL M1

SCALE: 1/8" = 1'-0"

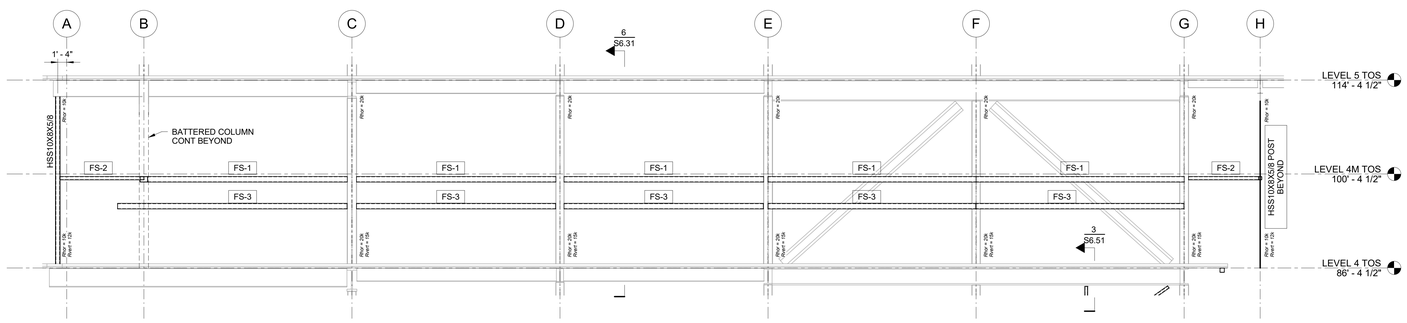

3 FACADE SUPPORT FRAMING ELEVATION - SOUTH - LEVEL 4 (A TO H)

SCALE: 1/8" = 1'-0"

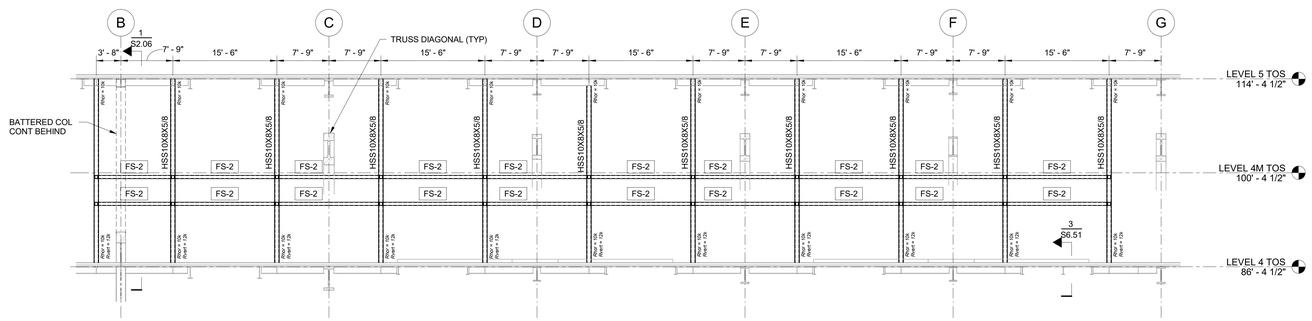

3A FSF ELEVATION - GRID 7 - SOUTH INTERIOR - LEVEL 4

SCALE: 1/8" = 1'-0"

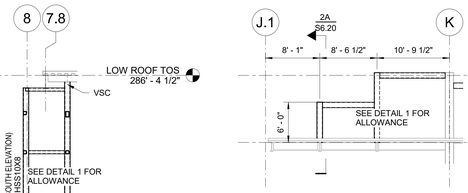

2 FACADE SUPPORT FRAMING ELEVATION - SOUTH - J.1 TO K

SCALE: 1/8" = 1'-0"

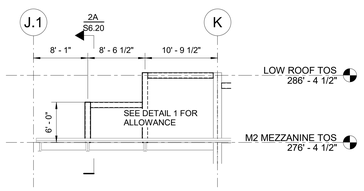

2A FACADE FRAMING NEAR J.1

SCALE: 1/8" = 1'-0"



Structural drawings 6.20 and 6.21 include Note 3 stating:

"See architectural drawings for additional allowances required for façade support steel."

There are no corresponding allowances shown in the architectural drawings. Please advise whether a future architectural issuance will provide these allowances, or if Note 3 will be removed from the structural drawings in an upcoming revision.

FACADE SUPPORT NOTES:

1. A. SEE PLANS FOR STRUT BACK TO BASE BUILDING STRUCTURE (BEYOND).
   B. SEE PLANS FOR STRUT BACK TO FACADE LATERAL SUPPORT FRAMING (BEYOND).
2. SEE ARCHITECTURAL DRAWINGS FOR AESS LOCATIONS AND LEVELS.
3. SEE ARCHITECTURAL DRAWINGS FOR ADDITIONAL ALLOWANCES REQUIRED FOR FACADE SUPPORT STEEL.

FACADE SUPPORT MEMBERS:

FS-1 INDICATES HSS14x10x1/2 LSH WITH REACTIONS:
Mhor = 140 kft
Mvert = 90 kft
Mtor = 25 kft
Rhor = 35k
Rvert = 25k
P = 40k

FS-2 INDICATES HSS6x6x1/2 WITH REACTIONS:
Mhor = 40 kft
Mvert = 30 kft
Mtor = 15 kft
Rhor = 20k
Rvert = 15k
P = 20k

FS-3 INDICATES HSS10x6x1/2 LSV WITH REACTIONS:
Mvert = 30 kft
Rvert = 6k

FS-4 INDICATES HSS8x8x1/2 WITH REACTIONS:
Mhor = 80 kft
Mvert = 60 kft
Mtor = 30 kft
Rhor = 30k
Rvert = 25k
P = 30k

FS-5 INDICATES HSS6x6x3/8 WITH REACTIONS:
Mtor = 5kft
Rhor = 10k
Rvert = 10k

FS-6 INDICATES HSS8x8x3/8 WITH REACTIONS:
Mtor = 20kft
Rhor = 20k
Rvert = 20k

FS-7 INDICATES HSS12x12x3/4 LSV WITH REACTIONS:
Mtor = 10kft
Rhor = 15k
Rvert = 20k

FS-8 INDICATES HSS14x6x5/8 WITH REACTIONS:
Mtor = 20kft
Rhor = 20k
Rvert = 20k

FS-9 INDICATES HSS12x8x3/8 WITH REACTIONS:
Mtor = 10kft
Rhor = 15k
Rvert = 15k

Architect

Payette Associates Inc.
290 Congress Street, Fifth Floor
Boston, MA 02210-1005
Tel: 617-895-1000
Fax: 617-895-1002

PAYETTE

Civil and Transportation Engineer
Vanasse Hangen Brustlin, Inc.
99 High Street, 13th Flr.
Boston, MA 02110
Tel: 617-607-2971
www.vhb.com

Landscape Architect
Michael Van Valkenburgh Associates, Inc.
231 Concord Avenue
Cambridge, MA 02138
Tel: 617-864-2076
www.mvvainc.com

Structural Engineer
LeMessurier
1380 Soldiers Field Road
Boston, MA 02135
Tel: 617-868-1200
www.lemessurier.com

Structural Engineer (Dana-Mayer)
Simon Design Engineering
49 Walnut Park, Bldg. #2
Wellesley, MA 02481
Tel: 781-237-2226
www.sde-us.com

MEPFP Tel/Data Engineer and Lighting
Bard, Rao + Athanas Consulting Engineers
10 Guest Street, 4th Flr.
Boston, MA 02135
Tel: 617-254-0016
www.brplusa.com

Vertical Transportation and Materials Management
St. Onge
1400 Williams Road
York, PA 17402
Tel: 717-840-8181
www.stonge.com

Life Safety Consultant
Code Red Consultants
123 Turnpike Road, Suite 320
Southborough, MA 01772
Tel: 617-500-7633
www.coderedconsultants.com

Medical Equipment
C/W Design Group
57 Bedford Street, Suite 207
Lexington, MA 02420
Tel: 781-274-7275
www.cwdesigngroup.com

Hardware Consultant
Allegion
77 Wexford Street
Needham Heights, MA 02494
Tel: 781-453-5300
www.allegion.com

Wind/Air Entrainment Consultant
RWDI
600 Southgate Drive
Guelph, Ontario, N1G 4P6
519-823-1311
https://rwdi.com

Building Facade Consultant
Studio NYL 129
Kingston Street, Ground Floor
Boston, MA 02111
Tel: 303-558-3145
www.studionyl.com

Building Enclosure Consultant
Simpson Gumpertz & Heger
480 Totten Pond Road
Waltham, MA 02451
Tel: 781-907-9000
www.sgh.com

Parking Consultant
Walker Consultants
1075 Main St., Suite 410
Waltham, MA 02451
Tel: 617-350-5040
www.walkerconsultants.com

Acoustics Engineer
Acentech
33 Moulton Street
Cambridge, MA 02138
Tel: 617-499-8031
www.acentech.com

Food Services Consultant
Kaizen
1525 Cornwall Road
Unit 14
Oakville, ON L6J 0B2
Tel: 905-338-3222
www.kaizenfood.com

Radiation Shielding Consultant
Nelco/Trapani
2 Burlington Woods Drive, Suite 300
Burlington, MA 01803
Tel: 781-331-0429
www.nelcoworldwide.com

RF Shielding Consultant
PDC Facilities, Inc.
700 Walnut Ridge Drive
Hartland, WI 53029
Tel: 262-367-7944
www.pdcbiz.com

Issues

Number	Date	Description
00	10-30-25	FACADE AND INFRASTRUCTURE PACKAGE
01	02-05-26	FACADE AND INFRASTRUCTURE PACKAGE ADDENDUM 2

Revisions

Number	Date	Description

NOT FOR CONSTRUCTION



Dana-Farber Cancer Institute
Beth Israel Lahey Health
Beth Israel Deaconess Medical Center

FUTURE CANCER HOSPITAL

1 JOSLIN PLACE, BOSTON MA 02115

Drawing Scale
As indicated

Project Number
17000.00

Date Issued
10/30/2025

FACADE SUPPORT ELEVATIONS - SOUTH

S6.20

©2025 Payette Associates Inc.

Autodesk Docs://DFC/Cancer_Hosp/STR_LeM_DFC_Cancer_Hospital_23-0320_R24.rvt
24/02/26 8:06:19 PM

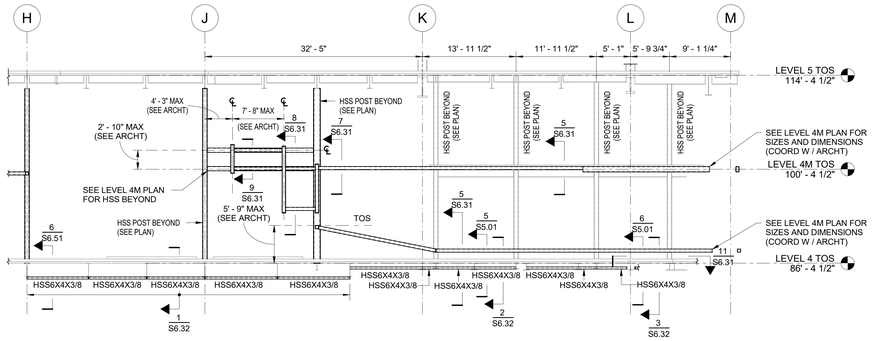

1 FACADE SUPPORT FRAMING ELEVATION - SOUTH - LEVEL 4M (J TO M)

SCALE: 1/8" = 1'-0"

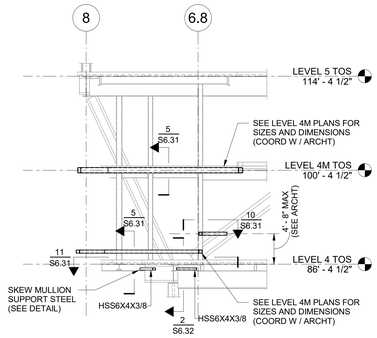

2 FACADE SUPPORT ELEVATION - EAST - LEVEL 4M (8 TO 6.8)

SCALE: 1/8" = 1'-0"

Structural drawings 6.20 and 6.21 include Note 3 stating:

"See architectural drawings for additional allowances required for façade support steel."

There are no corresponding allowances shown in the architectural drawings. Please advise whether a future architectural issuance will provide these allowances, or if Note 3 will be removed from the structural drawings in an upcoming revision.

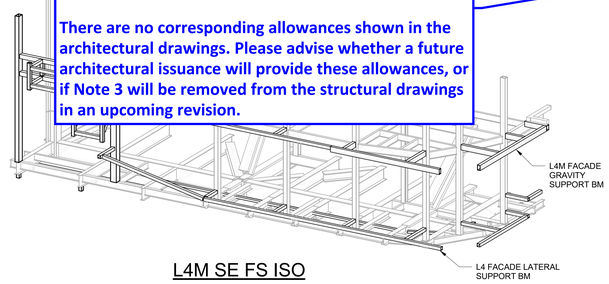

L4M SE FS ISO

FACADE SUPPORT NOTES:

1. A. SEE PLANS FOR STRUT BACK TO BASE BUILDING STRUCTURE (BEYOND).
   B. SEE PLANS FOR STRUT BACK TO FACADE LATERAL SUPPORT FRAMING (BEYOND).
2. SEE ARCHITECTURAL DRAWINGS FOR AESS LOCATIONS AND LEVELS.
3. SEE ARCHITECTURAL DRAWINGS FOR ADDITIONAL ALLOWANCES REQUIRED FOR FACADE SUPPORT STEEL.

FACADE SUPPORT MEMBERS:

FS-1 INDICATES HSS14x10x1/2 LSH WITH REACTIONS:
Mhor = 140 kft
Mvert = 90 kft
Mtor = 25 kft
Rhor = 35k
Rvert = 25k
P = 40k

FS-2 INDICATES HSS6x6x1/2 WITH REACTIONS:
Mhor = 40 kft
Mvert = 30 kft
Mtor = 15 kft
Rhor = 20k
Rvert = 15k
P = 20k

FS-3 INDICATES HSS10x6x1/2 LSV WITH REACTIONS:
Mvert = 30 kft
Rvert = 6k

FS-4 INDICATES HSS8x8x1/2 WITH REACTIONS:
Mhor = 80 kft
Mvert = 60 kft
Mtor = 30 kft
Rhor = 30k
Rvert = 25k
P = 30k

FS-5 INDICATES HSS6x6x3/8 WITH REACTIONS:
Mtor = 5kft
Rhor = 10k
Rvert = 10k

FS-6 INDICATES HSS8x8x3/8 WITH REACTIONS:
Mtor = 20kft
Rhor = 20k
Rvert = 20k

FS-7 INDICATES HSS12x12x3/4 LSV WITH REACTIONS:
Mtor = 10kft
Rhor = 15k
Rvert = 20k

FS-8 INDICATES HSS14x6x5/8 WITH REACTIONS:
Mtor = 20kft
Rhor = 20k
Rvert = 20k

FS-9 INDICATES HSS12x8x3/8 WITH REACTIONS:
Mtor = 10kft
Rhor = 15k
Rvert = 15k

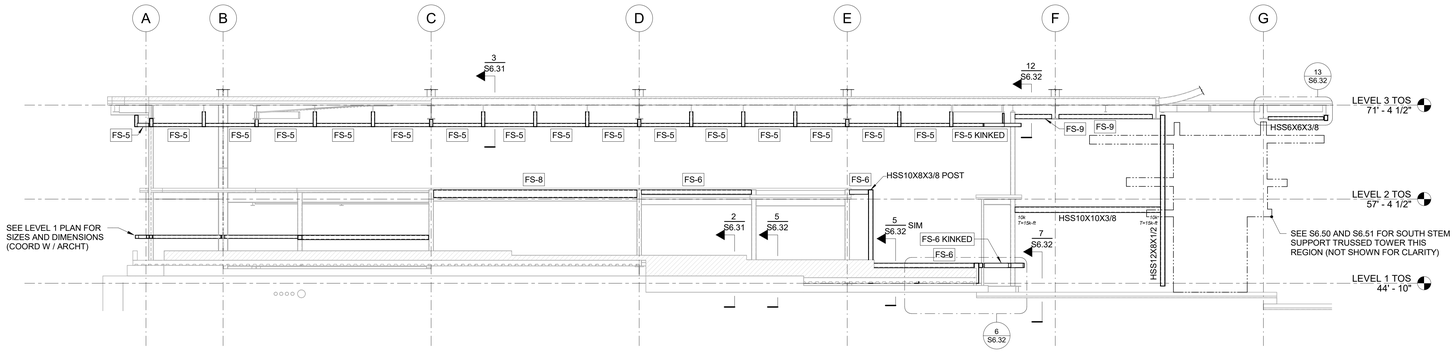

3 FACADE SUPPORT ELEVATION - SOUTH - LEVEL 1 (A TO G)

SCALE: 1/8" = 1'-0"

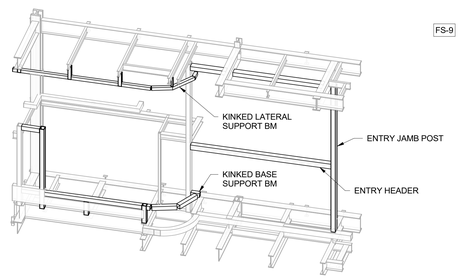

L1 SOUTH ENTRY ISO

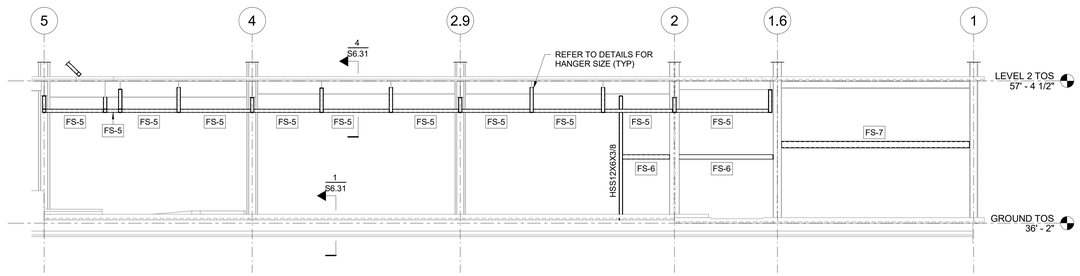

4 FACADE SUPPORT ELEVATION - EAST - GROUND (5 TO 1)

SCALE: 1/8" = 1'-0"

Architect

Payette Associates Inc.
290 Congress Street, Fifth Floor
Boston, MA 02210-1005
Tel: 617-895-1000
Fax: 617-895-1002

PAYETTE

Civil and Transportation Engineer
Vanasse Hangen Brustlin, Inc.
99 High Street, 13th Flr.
Boston, MA 02110
Tel: 617-607-2971
www.vhb.com

Landscape Architect
Michael Van Valkenburgh Associates, Inc.
231 Concord Avenue
Cambridge, MA 02138
Tel: 617-864-2076
www.mvvainc.com

Structural Engineer
LeMessurier
1380 Soldiers Field Road
Boston, MA 02135
Tel: 617-868-1200
www.lemessurier.com

Structural Engineer (Dana-Mayer)
Simon Design Engineering
49 Walnut Park, Bldg. #2
Wellesley, MA 02481
Tel: 781-237-2226
www.sde-us.com

MEPFP Tel/Data Engineer and Lighting
Bard, Rao + Athanas Consulting Engineers
10 Guest Street, 4th Flr.
Boston, MA 02135
Tel: 617-254-0016
www.brplusa.com

Vertical Transportation and Materials Management
St. Onge
1400 Williams Road
York, PA 17402
Tel: 717-840-8181
www.stonge.com

Life Safety Consultant
Code Red Consultants
123 Turnpike Road, Suite 320
Southborough, MA 01772
Tel: 617-500-7633
www.coderedconsultants.com

Medical Equipment
C/W Design Group
57 Bedford Street, Suite 207
Lexington, MA 02420
Tel: 781-274-7275
www.cwdesigngroup.com

Hardware Consultant
Allegion
77 Wexford Street
Needham Heights, MA 02494
Tel: 781-453-5300
www.allegion.com

Wind/Air Entrainment Consultant
RWDI
600 Southgate Drive
Guelph, Ontario, N1G 4P6
519-823-1311
https://rwdi.com

Building Facade Consultant
Studio NYL 129
Kingston Street, Ground Floor
Boston, MA 02111
Tel: 303-558-3145
www.studionyl.com

Building Enclosure Consultant
Simpson Gumpertz & Heger
480 Totten Pond Road
Waltham, MA 02451
Tel: 781-907-9000
www.sgh.com

Parking Consultant
Walker Consultants
1075 Main St., Suite 410
Waltham, MA 02451
Tel: 617-350-5040
www.walkerconsultants.com

Acoustics Engineer
Acentech
33 Moulton Street
Cambridge, MA 02138
Tel: 617-499-8031
www.acentech.com

Food Services Consultant
Kaizen
1525 Cornwall Road
Unit 14
Oakville, ON L6J 0B2
Tel: 905-338-3222
www.kaizenfood.com

Radiation Shielding Consultant
Nelco/Trapani
2 Burlington Woods Drive, Suite 300
Burlington, MA 01803
Tel: 781-331-0429
www.nelcoworldwide.com

RF Shielding Consultant
PDC Facilities, Inc.
700 Walnut Ridge Drive
Hartland, WI 53029
Tel: 262-367-7944
www.pdcbiz.com

Issues

Number	Date	Description
00	02-05-26	FACADE AND INFRASTRUCTURE PACKAGE ADDENDUM 2

Revisions

Number	Date	Description

NOT FOR CONSTRUCTION



Dana-Farber Cancer Institute
Beth Israel Lahey Health
Beth Israel Deaconess Medical Center

FUTURE CANCER HOSPITAL

1 JOSLIN PLACE, BOSTON MA 02115

Drawing Scale
As indicated

Project Number
17000.00

Date Issued
02/05/2026

FACADE SUPPORT ELEVATIONS - SOUTH & EAST

S6.21

©2025 Payette Associates Inc.

Autodesk Docs://DFCI-Cancer_Hosp/STR_LeM_DFCI_Cancer Hospital_23-020_R24.rvt
2/4/2026 8:08:22 PM

Suffolk Construction Company, Inc.
65 Allerton Street
Boston, Massachusetts 02119
P: (617) 445-3500
F: (617) 541-2128

Project: 226052 DFCI-BIDMC New Cancer Hospital - 1 Joslin Place - Construction
1 Joslin Place
Boston, Massachusetts 02215

RFI #0-PB-133: Missing Architectural Allowances Referenced on Structural Drawings for Facade Support

Revision	0	**Status**	Open
To	Emilio Cardarelli (PAYETTE) Hyunsuk Yun (Payette Associates, Inc. (BOSTON)) Jeff Abramson (Payette Associates, Inc. (BOSTON)) Jensen Ying (Payette Associates, Inc. (BOSTON)) Jessica Hoctor (Payette Associates, Inc. (BOSTON)) Mollica Manandhar (Payette Associates, Inc. (BOSTON))	**From**	Devin DiManno (Suffolk Construction) 65 Allerton St. Boston, Massachusetts 02119
Date Initiated	Mar 3, 2026	**Due Date**	Mar 10, 2026
Location		**Project Stage**	Bidding
Cost Impact	Yes (Unknown)	**Schedule Impact**	
Spec Section	051200 - STRUCTURAL STEEL FRAMING	**Cost Code**	
Drawing Number	S6.20 & S6.21	**Reference**	
Linked Drawings			
Received From	Devin DiManno (Suffolk Construction)	**Sub Job**	
Copies To	Jeff Abramson (Payette Associates, Inc. (BOSTON)), Elisa Arriaga (Vanasse Hangen Brustlin, Inc. (BOSTON)), Craig Blanchet (Lemessurier Consultants, Inc. (BOSTON)), Emilio Cardarelli (PAYETTE), Joy Clark (Leggat McCall Properties LLC), Johnpatrick Connors (Suffolk Construction), Nathan Crowley (Suffolk Construction), Emil Giordano (Suffolk Construction), Kevin Griffin (Leggat McCall Properties LLC), Benjamin Hedges (Suffolk Construction), Jessica Hoctor (Payette Associates, Inc. (BOSTON)), Emily Jacobsen (Lemessurier Consultants, Inc. (BOSTON)), Avinash Jadhav (Lemessurier Consultants, Inc. (BOSTON)), Silas Mackey (Suffolk Construction), Mithila Madhavan (Lemessurier Consultants, Inc. (BOSTON)), Kevin Malenchini (Suffolk Construction), Mollica Manandhar (Payette Associates, Inc. (BOSTON)), Rick Medeiros (Suffolk Construction), Rob Morsi (Suffolk Construction), Steve Mulligan (St. Onge Company (YORK)), Christopher O'Neil (Suffolk Construction), Kaitlyn Palmer (Lemessurier Consultants, Inc. (BOSTON)), Joel Perry (Suffolk Construction), Kyle Reilly (Suffolk Construction), Henry Sniezek (Suffolk Construction) , Ben Stanton (Leggat McCall Properties LLC), Dan Sullivan (Leggat McCall Properties LLC), Sabrina Torchia (Suffolk Construction), Bob Walsh (Leggat McCall Properties LLC), Benjamin Watkins (Suffolk Construction), Jensen Ying (Payette Associates, Inc. (BOSTON)), Hyunsuk Yun (Payette Associates, Inc. (BOSTON))		

ADDITIONAL FIELDS

Required Reviewers

Urgency Low

Activity

Question

Question from Devin DiManno Suffolk Construction *on Tuesday, Mar 3, 2026 at 10:37 AM EST*

Structural drawings 6.20 and 6.21 include Note 3 stating:

"See architectural drawings for additional allowances required for façade support steel."
There are no corresponding allowances shown in the architectural drawings. Please advise whether a future architectural issuance will provide these allowances, or if Note 3 will be removed from the structural drawings in an upcoming revision.

Attachments
RFI 0-PB-132 - Missing Architectural Allowances Referenced on Structural Drawings for Facade Support.pdf

PAYETTE RESPONSE (3/12/2026)

There are no additional allowances on the architectural drawings for façade support steel. Note 3 will be removed from the structural drawings in an upcoming revision.

JYING

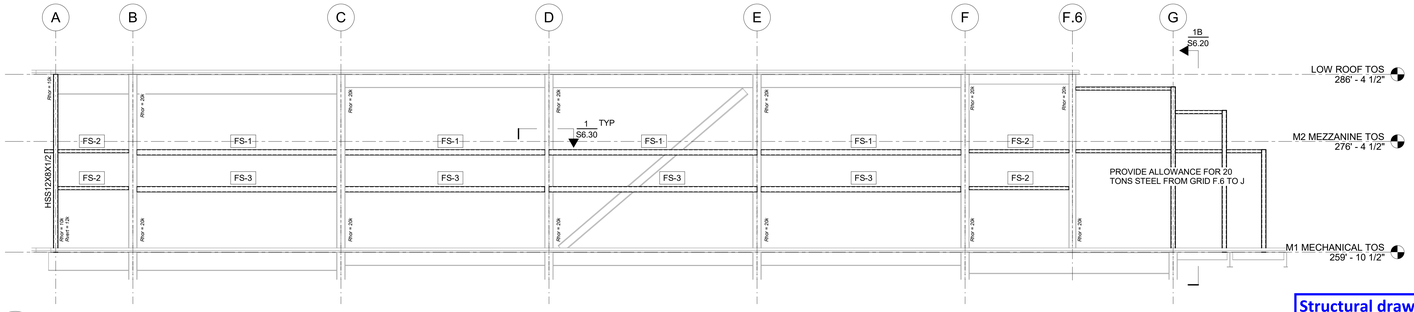

1 FACADE SUPPORT FRAMING ELEVATION - SOUTH - M1 MECHANICAL

SCALE: 1/8" = 1'-0"

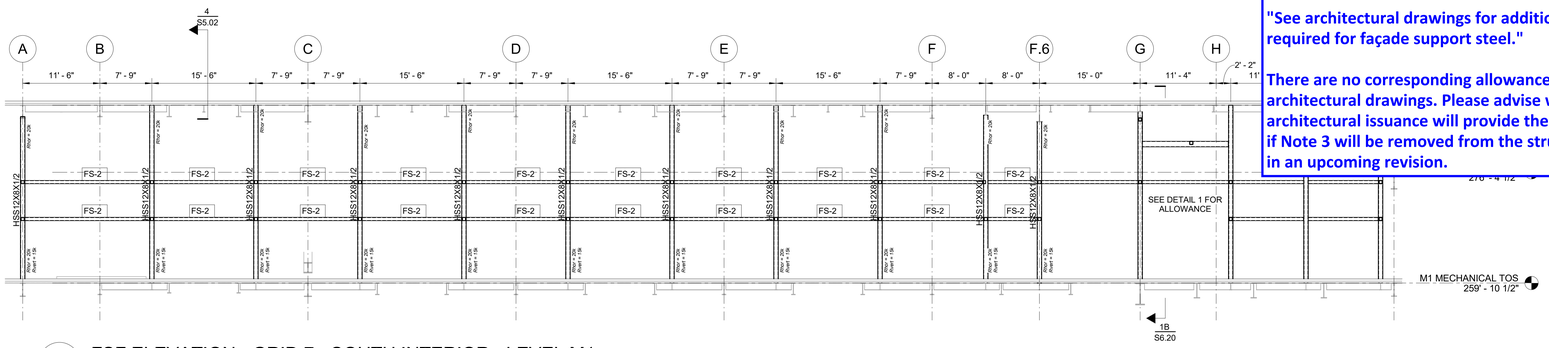

1A FSF ELEVATION - GRID 7 - SOUTH INTERIOR - LEVEL M1

SCALE: 1/8" = 1'-0"

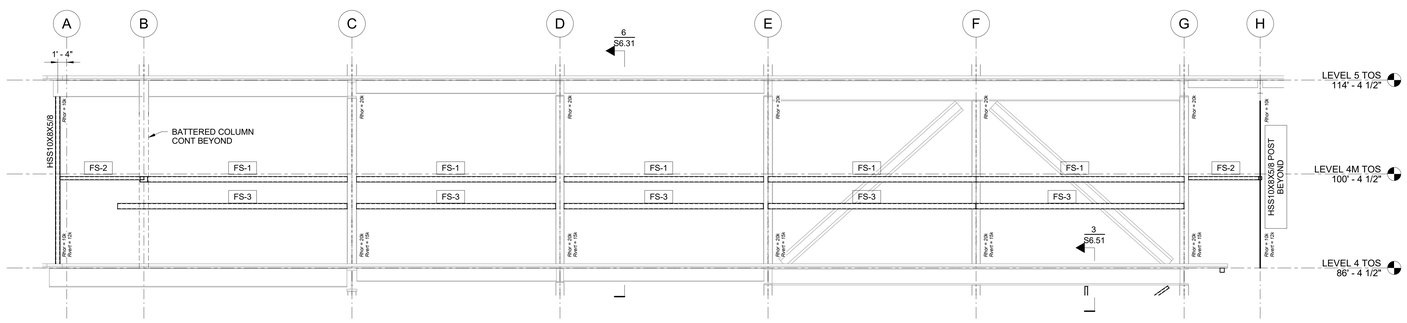

3 FACADE SUPPORT FRAMING ELEVATION - SOUTH - LEVEL 4 (A TO H)

SCALE: 1/8" = 1'-0"

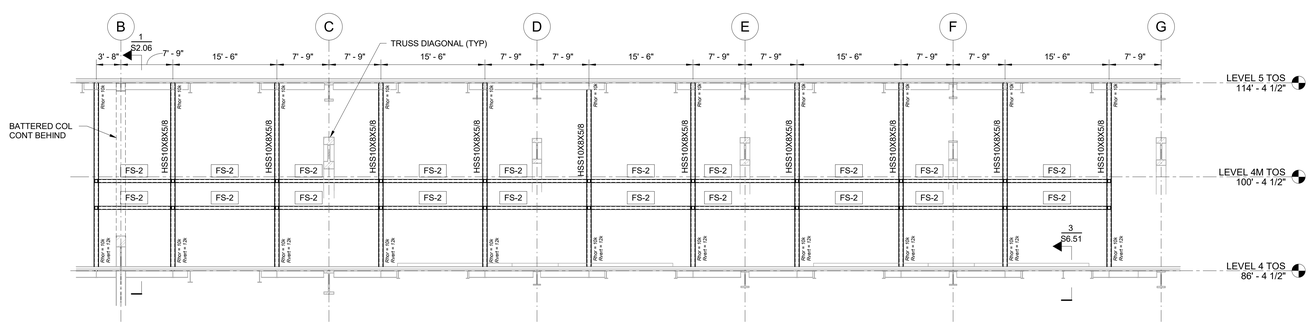

3A FSF ELEVATION - GRID 7 - SOUTH INTERIOR - LEVEL 4

SCALE: 1/8" = 1'-0"

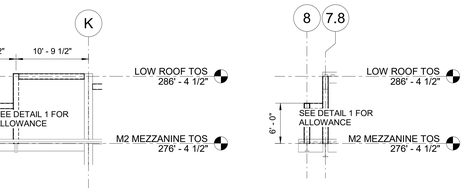

2 FACADE SUPPORT FRAMING ELEVATION - SOUTH - J.1 TO K

SCALE: 1/8" = 1'-0"

2A FACADE FRAMING NEAR J.1

SCALE: 1/8" = 1'-0"

Structural drawings 6.20 and 6.21 include Note 3 stating:

"See architectural drawings for additional allowances required for façade support steel."

There are no corresponding allowances shown in the architectural drawings. Please advise whether a future architectural issuance will provide these allowances, or if Note 3 will be removed from the structural drawings in an upcoming revision.

FACADE SUPPORT NOTES:

1. A. SEE PLANS FOR STRUT BACK TO BASE BUILDING STRUCTURE (BEYOND).
   B. SEE PLANS FOR STRUT BACK TO FACADE LATERAL SUPPORT FRAMING (BEYOND).
2. SEE ARCHITECTURAL DRAWINGS FOR AESS LOCATIONS AND LEVELS.
3. SEE ARCHITECTURAL DRAWINGS FOR ADDITIONAL ALLOWANCES REQUIRED FOR FACADE SUPPORT STEEL.

FACADE SUPPORT MEMBERS:

FS-1 INDICATES HSS14x10x1/2 LSH WITH REACTIONS:
Mhor = 140 kft
Mvert = 90 kft
Mtor = 25 kft
Rhor = 35k
Rvert = 25k
P = 40k

FS-2 INDICATES HSS6x6x1/2 WITH REACTIONS:
Mhor = 40 kft
Mvert = 30 kft
Mtor = 15 kft
Rhor = 20k
Rvert = 15k
P = 20k

FS-3 INDICATES HSS10x6x1/2 LSV WITH REACTIONS:
Mvert = 30 kft
Rvert = 6k

FS-4 INDICATES HSS8x8x1/2 WITH REACTIONS:
Mhor = 80 kft
Mvert = 60 kft
Mtor = 30 kft
Rhor = 30k
Rvert = 25k
P = 30k

FS-5 INDICATES HSS6x6x3/8 WITH REACTIONS:
Mtor = 5kft
Rhor = 10k
Rvert = 10k

FS-6 INDICATES HSS8x8x3/8 WITH REACTIONS:
Mtor = 20kft
Rhor = 20k
Rvert = 20k

FS-7 INDICATES HSS12x12x3/4 LSV WITH REACTIONS:
Mtor = 10kft
Rhor = 15k
Rvert = 20k

FS-8 INDICATES HSS14x6x5/8 WITH REACTIONS:
Mtor = 20kft
Rhor = 20k
Rvert = 20k

FS-9 INDICATES HSS12x8x3/8 WITH REACTIONS:
Mtor = 10kft
Rhor = 15k
Rvert = 15k

Architect

Payette Associates Inc.
290 Congress Street, Fifth Floor
Boston, MA 02210-1005
Tel: 617-895-1000
Fax: 617-895-1002

PAYETTE

Civil and Transportation Engineer
Vanasse Hangen Brustlin, Inc.
99 High Street, 13th Flr.
Boston, MA 02110
Tel: 617-607-2971
www.vhb.com

Landscape Architect
Michael Van Valkenburgh Associates, Inc.
231 Concord Avenue
Cambridge, MA 02138
Tel: 617-864-2076
www.mvvainc.com

Structural Engineer
LeMessurier
1380 Soldiers Field Road
Boston, MA 02135
Tel: 617-868-1200
www.lemessurier.com

Structural Engineer (Dana-Mayer)
Simon Design Engineering
49 Walnut Park, Bldg. #2
Wellesley, MA 02481
Tel: 781-237-2226
www.sde-us.com

MEPFP Tel/Data Engineer and Lighting
Bard, Rao + Athanas Consulting Engineers
10 Guest Street, 4th Flr.
Boston, MA 02135
Tel: 617-254-0016
www.brplusa.com

Vertical Transportation and Materials Management
St. Onge
1400 Williams Road
York, PA 17402
Tel: 717-840-8181
www.stonge.com

Life Safety Consultant
Code Red Consultants
123 Turnpike Road, Suite 320
Southborough, MA 01772
Tel: 617-500-7633
www.coderedconsultants.com

Medical Equipment
C/W Design Group
57 Bedford Street, Suite 207
Lexington, MA 02420
Tel: 781-274-7275
www.cwdesigngroup.com

Hardware Consultant
Allegion
77 Wexford Street
Needham Heights, MA 02494
Tel: 781-453-5300
www.allegion.com

Wind/Air Entrainment Consultant
RWDI
600 Southgate Drive
Guelph, Ontario, N1G 4P6
519-823-1311
https://rwdi.com

Building Facade Consultant
Studio NYL 129
Kingston Street, Ground Floor
Boston, MA 02111
Tel: 303-558-3145
www.studionyl.com

Building Enclosure Consultant
Simpson Gumpertz & Heger
480 Totten Pond Road
Waltham, MA 02451
Tel: 781-907-9000
www.sgh.com

Parking Consultant
Walker Consultants
1075 Main St., Suite 410
Waltham, MA 02451
Tel: 617-350-5040
www.walkerconsultants.com

Acoustics Engineer
Acentech
33 Moulton Street
Cambridge, MA 02138
Tel: 617-499-8031
www.acentech.com

Food Services Consultant
Kaizen
1525 Cornwall Road
Unit 14
Oakville, ON L6J 0B2
Tel: 905-338-3222
www.kaizenfood.com

Radiation Shielding Consultant
Nelco/Trapani
2 Burlington Woods Drive, Suite 300
Burlington, MA 01803
Tel: 781-331-0429
www.nelcoworldwide.com

RF Shielding Consultant
PDC Facilities, Inc.
700 Walnut Ridge Drive
Hartland, WI 53029
Tel: 262-367-7944
www.pdcbiz.com

Issues

Number	Date	Description
00	10-30-25	FACADE AND INFRASTRUCTURE PACKAGE
01	02-05-26	FACADE AND INFRASTRUCTURE PACKAGE ADDENDUM 2

Revisions

Number	Date	Description

NOT FOR CONSTRUCTION



Dana-Farber Cancer Institute
Beth Israel Lahey Health
Beth Israel Deaconess Medical Center

FUTURE CANCER HOSPITAL

1 JOSLIN PLACE, BOSTON MA 02115

FACADE SUPPORT ELEVATIONS - SOUTH

Drawing Scale
As indicated

Project Number
17000.00

Date Issued
10/30/2025

S6.20

©2025 Payette Associates Inc.

Autodesk Docs://DFC/Cancer_Hosp/STR_LeM_DFC_Cancer_Hospital_23-0320_R24.rvt
24/02/26 8:06:19 PM

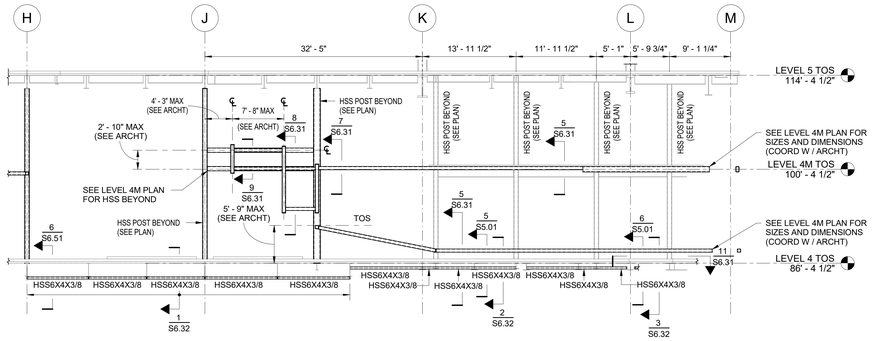

1 FACADE SUPPORT FRAMING ELEVATION - SOUTH - LEVEL 4M (J TO M)

SCALE: 1/8" = 1'-0"

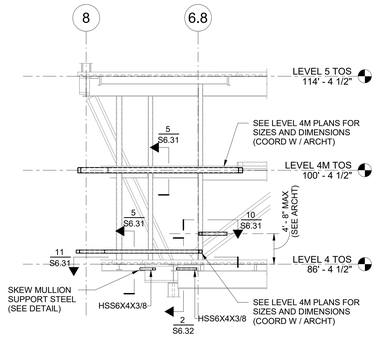

2 FACADE SUPPORT ELEVATION - EAST - LEVEL 4M (8 TO 6.8)

SCALE: 1/8" = 1'-0"

Structural drawings 6.20 and 6.21 include Note 3 stating:

"See architectural drawings for additional allowances required for façade support steel."

There are no corresponding allowances shown in the architectural drawings. Please advise whether a future architectural issuance will provide these allowances, or if Note 3 will be removed from the structural drawings in an upcoming revision.

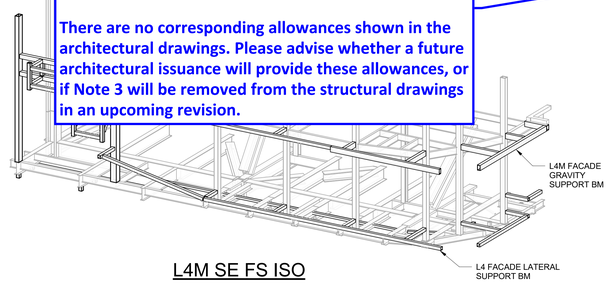

L4M SE FS ISO

FACADE SUPPORT NOTES:

1. A. SEE PLANS FOR STRUT BACK TO BASE BUILDING STRUCTURE (BEYOND).
   B. SEE PLANS FOR STRUT BACK TO FACADE LATERAL SUPPORT FRAMING (BEYOND).
2. SEE ARCHITECTURAL DRAWINGS FOR AESS LOCATIONS AND LEVELS.
3. SEE ARCHITECTURAL DRAWINGS FOR ADDITIONAL ALLOWANCES REQUIRED FOR FACADE SUPPORT STEEL.

FACADE SUPPORT MEMBERS:

FS-1 INDICATES HSS14x10x1/2 LSH WITH REACTIONS:
Mhor = 140 kft
Mvert = 90 kft
Mtor = 25 kft
Rhor = 35k
Rvert = 25k
P = 40k

FS-2 INDICATES HSS6x6x1/2 WITH REACTIONS:
Mhor = 40 kft
Mvert = 30 kft
Mtor = 15 kft
Rhor = 20k
Rvert = 15k
P = 20k

FS-3 INDICATES HSS10x6x1/2 LSV WITH REACTIONS:
Mvert = 30 kft
Rvert = 6k

FS-4 INDICATES HSS8x8x1/2 WITH REACTIONS:
Mhor = 80 kft
Mvert = 60 kft
Mtor = 30 kft
Rhor = 30k
Rvert = 25k
P = 30k

FS-5 INDICATES HSS6x6x3/8 WITH REACTIONS:
Mtor = 5kft
Rhor = 10k
Rvert = 10k

FS-6 INDICATES HSS8x8x3/8 WITH REACTIONS:
Mtor = 20kft
Rhor = 20k
Rvert = 20k

FS-7 INDICATES HSS12x12x3/4 LSV WITH REACTIONS:
Mtor = 10kft
Rhor = 15k
Rvert = 20k

FS-8 INDICATES HSS14x6x5/8 WITH REACTIONS:
Mtor = 20kft
Rhor = 20k
Rvert = 20k

FS-9 INDICATES HSS12x8x3/8 WITH REACTIONS:
Mtor = 10kft
Rhor = 15k
Rvert = 15k

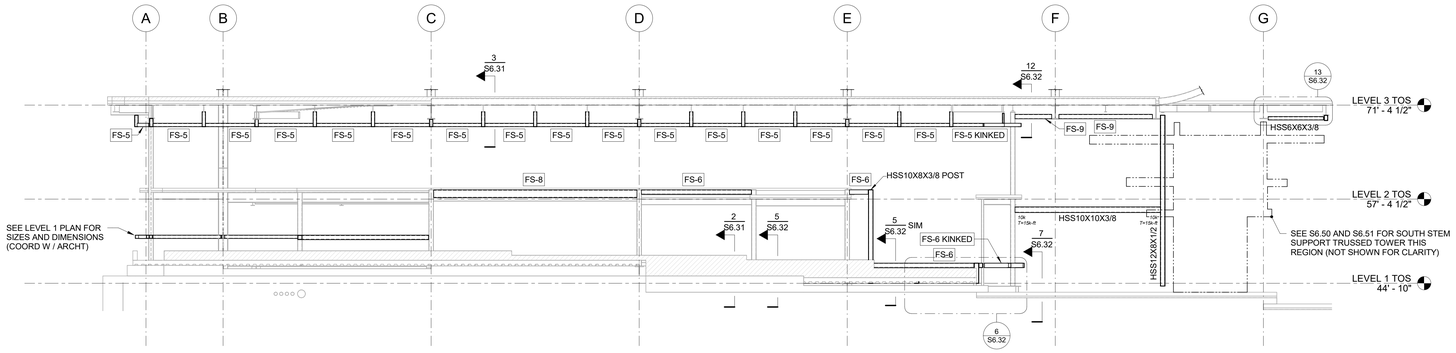

3 FACADE SUPPORT ELEVATION - SOUTH - LEVEL 1 (A TO G)

SCALE: 1/8" = 1'-0"

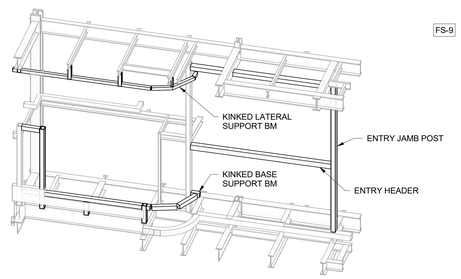

L1 SOUTH ENTRY ISO

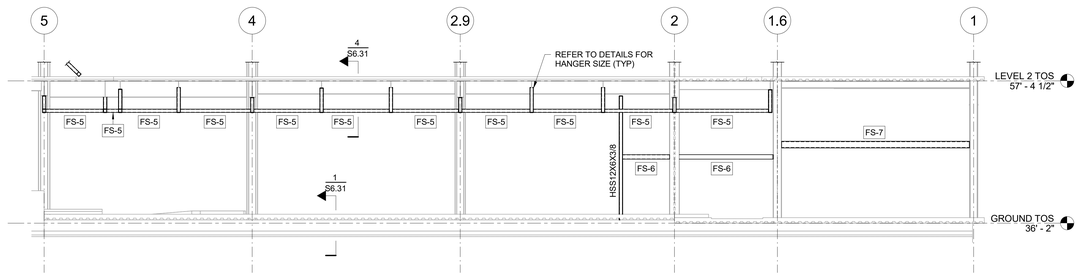

4 FACADE SUPPORT ELEVATION - EAST - GROUND (5 TO 1)

SCALE: 1/8" = 1'-0"

Architect

Payette Associates Inc.
290 Congress Street, Fifth Floor
Boston, MA 02210-1005
Tel: 617-895-1000
Fax: 617-895-1002

PAYETTE

Civil and Transportation Engineer
Vanasse Hangen Brustlin, Inc.
99 High Street, 13th Flr.
Boston, MA 02110
Tel: 617-607-2971
www.vhb.com

Landscape Architect
Michael Van Valkenburgh Associates, Inc.
231 Concord Avenue
Cambridge, MA 02138
Tel: 617-864-2076
www.mvvainc.com

Structural Engineer
LeMessurier
1380 Soldiers Field Road
Boston, MA 02135
Tel: 617-868-1200
www.lemessurier.com

Structural Engineer (Dana-Mayer)
Simon Design Engineering
49 Walnut Park, Bldg. #2
Wellesley, MA 02481
Tel: 781-237-2226
www.sde-us.com

MEPFP Tel/Data Engineer and Lighting
Bard, Rao + Athanas Consulting Engineers
10 Guest Street, 4th Flr.
Boston, MA 02135
Tel: 617-254-0016
www.brplusa.com

Vertical Transportation and Materials Management
St. Onge
1400 Williams Road
York, PA 17402
Tel: 717-840-8181
www.stonge.com

Life Safety Consultant
Code Red Consultants
123 Turnpike Road, Suite 320
Southborough, MA 01772
Tel: 617-500-7633
www.coderedconsultants.com

Medical Equipment
C/W Design Group
57 Bedford Street, Suite 207
Lexington, MA 02420
Tel: 781-274-7275
www.cwdesigngroup.com

Hardware Consultant
Allegion
77 Wexford Street
Needham Heights, MA 02494
Tel: 781-453-5300
www.allegion.com

Wind/Air Entrainment Consultant
RWDI
600 Southgate Drive
Guelph, Ontario, N1G 4P6
519-823-1311
https://rwdi.com

Building Facade Consultant
Studio NYL 129
Kingston Street, Ground Floor
Boston, MA 02111
Tel: 303-558-3145
www.studionyl.com

Building Enclosure Consultant
Simpson Gumpertz & Heger
480 Totten Pond Road
Waltham, MA 02451
Tel: 781-907-9000
www.sgh.com

Parking Consultant
Walker Consultants
1075 Main St., Suite 410
Waltham, MA 02451
Tel: 617-350-5040
www.walkerconsultants.com

Acoustics Engineer
Acentech
33 Moulton Street
Cambridge, MA 02138
Tel: 617-499-8031
www.acentech.com

Food Services Consultant
Kaizen
1525 Cornwall Road
Unit 14
Oakville, ON L6J 0B2
Tel: 905-338-3222
www.kaizenfood.com

Radiation Shielding Consultant
Nelco/Trapani
2 Burlington Woods Drive, Suite 300
Burlington, MA 01803
Tel: 781-331-0429
www.nelcoworldwide.com

RF Shielding Consultant
PDC Facilities, Inc.
700 Walnut Ridge Drive
Hartland, WI 53029
Tel: 262-367-7944
www.pdcbiz.com

Issues

Number	Date	Description
00	02-05-26	FACADE AND INFRASTRUCTURE PACKAGE ADDENDUM 2

Revisions

Number	Date	Description

NOT FOR CONSTRUCTION



Dana-Farber Cancer Institute
Beth Israel Lahey Health
Beth Israel Deaconess Medical Center

FUTURE CANCER HOSPITAL

1 JOSLIN PLACE, BOSTON MA 02115

Drawing Scale
As indicated

Project Number
17000.00

Date Issued
02/05/2026

FACADE SUPPORT ELEVATIONS - SOUTH & EAST

S6.21

©2025 Payette Associates Inc.

Autodesk Docs://DFCI-Cancer_Hosp/STR_L4M_DFCI_Cancer Hospital_23-020_R24.rvt
2/4/2026 8:08:22 PM