

Abreviaturas conforme parte 1 active, IndSt = (Bat, Resp, Tosse) IdxMultR = (X, Y, Z)
 16-20: LR_out= 1, CH_Cmd.Out= 0 (comum a todos)

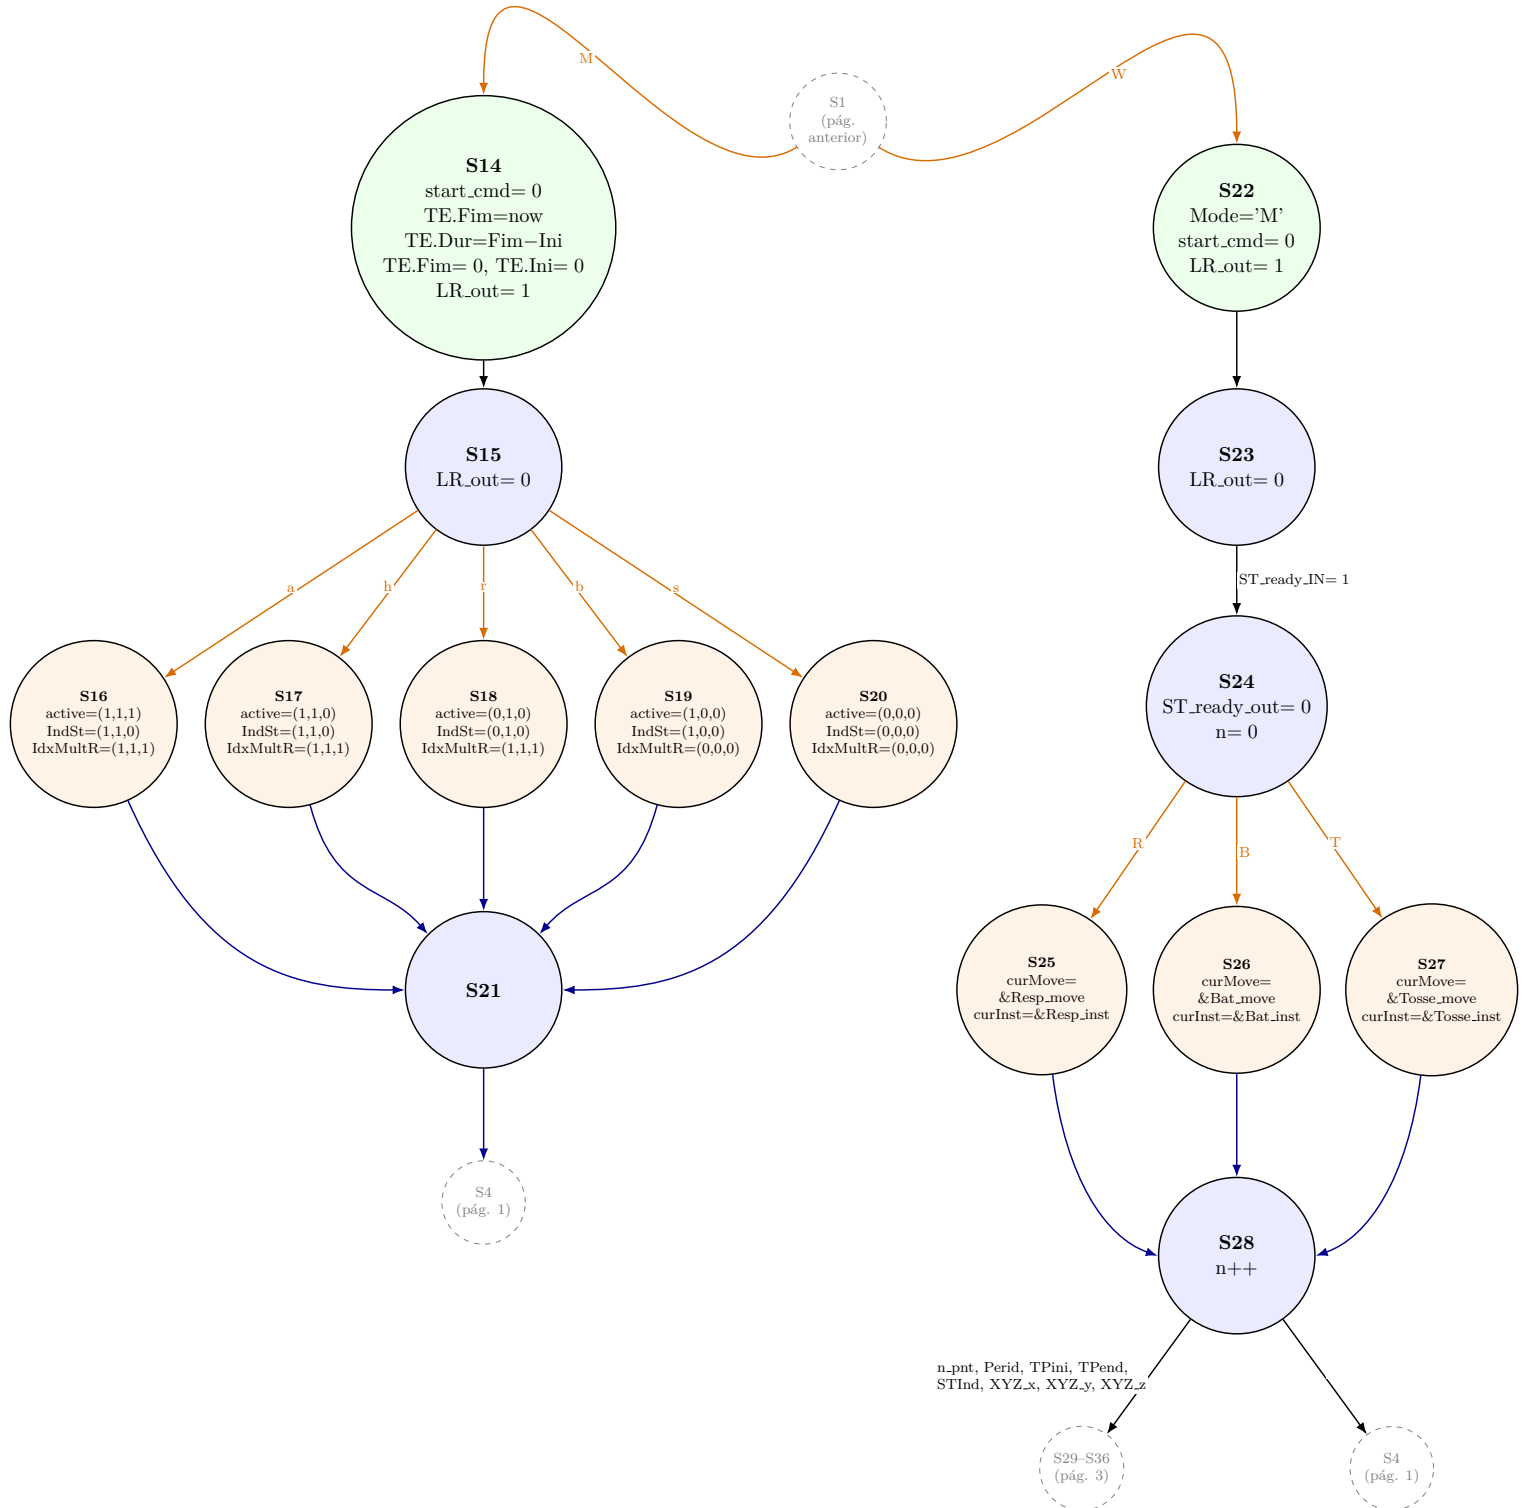


Figure 1: FSM_Serial_Command (parte 2 de 3): submenu M e entrada no comando longo W.