


6701 EVANSTAD DR N  
MAPLE GROVE, MN 55369

REFER TO P&ID LEAD SHEETS FOR SYMBOLS AND ABBREVIATIONS.  
ALL AUTOMATED VALVES ARE TO BE FAIL-CLOSE UNLESS OTHERWISE  
DICATED.  
CONNECTION POINTS TO EQUIPMENT ARE SHOWN FOR REFERENCE  
ONLY.  
PIPING AND DUCT TAKEOFFS ARE SHOWN SCHEMATICALLY. FOR ACTUAL  
TAKEOFF ORDER, SEE PLANS.

- 1 CONTROL VALVE FURNISHED BY AHU VENDOR
- 2 STRAINER FURNISHED BY AHU VENDOR
- 3 INSIDE OF VENDOR BOUNDARY IS THE VENDOR P&ID, ALL PIPING TO BE PROVIDED BY CONTRACTOR, INCLUDING ALL APPURTENANCES

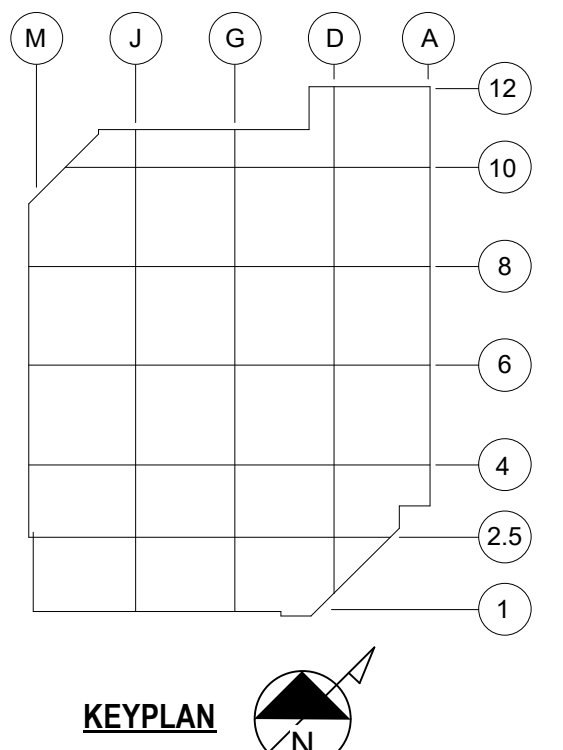

CONSULTING ENGINEER

**HORWITZ** 

7400 49th AVENUE NORTH  
NEW HOPE, MN 55428  
(763) 533-1900  
[www.horwitzinc.com](http://www.horwitzinc.com)

[illegible]

CONFIDENTIAL - THIS DRAWING IS THE PROPERTY OF UPSHER-SMITH. THE INFORMATION CONTAINED HEREIN MAY NOT BE USED OR COPIED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION OF THE OWNER.

DRAWING TITLE

FLUID BED PROCESSOR #2 AIR  
HANDLING UNIT DESSICANT  
REACTIVATION VENDOR P&ID - ROOM  
2810

DRAWING NUMBER  
**PID-3011.1**