

Simulator Improvement

Jacob Kolevas

May 4th 2025

1 Overview

This project involves developing a foundation power systems modeling package in Python. The code instantiates basic classes for the main power system components – buses, generators, conductors, geometries, and a high-level Circuit class to hold them together. The Circuit class facilitates the creation of a network, calculation of significant values like equivalent distance between conductors, and, lastly, the creation of the network admittance matrix (Y-bus) – a key step to load flow analysis and power system study.

The addition to the model includes the addition of solar generation as a specialized solar generation class. The addition supports distributed renewable energy simulation by approximating actual power output based on irradiance, temperature, and derating terms. The addition of solar generation extends the modeling paradigm to advanced energy technologies and their impact on power flow and system operation.

The objective is to provide a flexible and customized platform for discussing power system concepts, performing basic analysis and studying the effect of solar generation.

2 Class Diagram

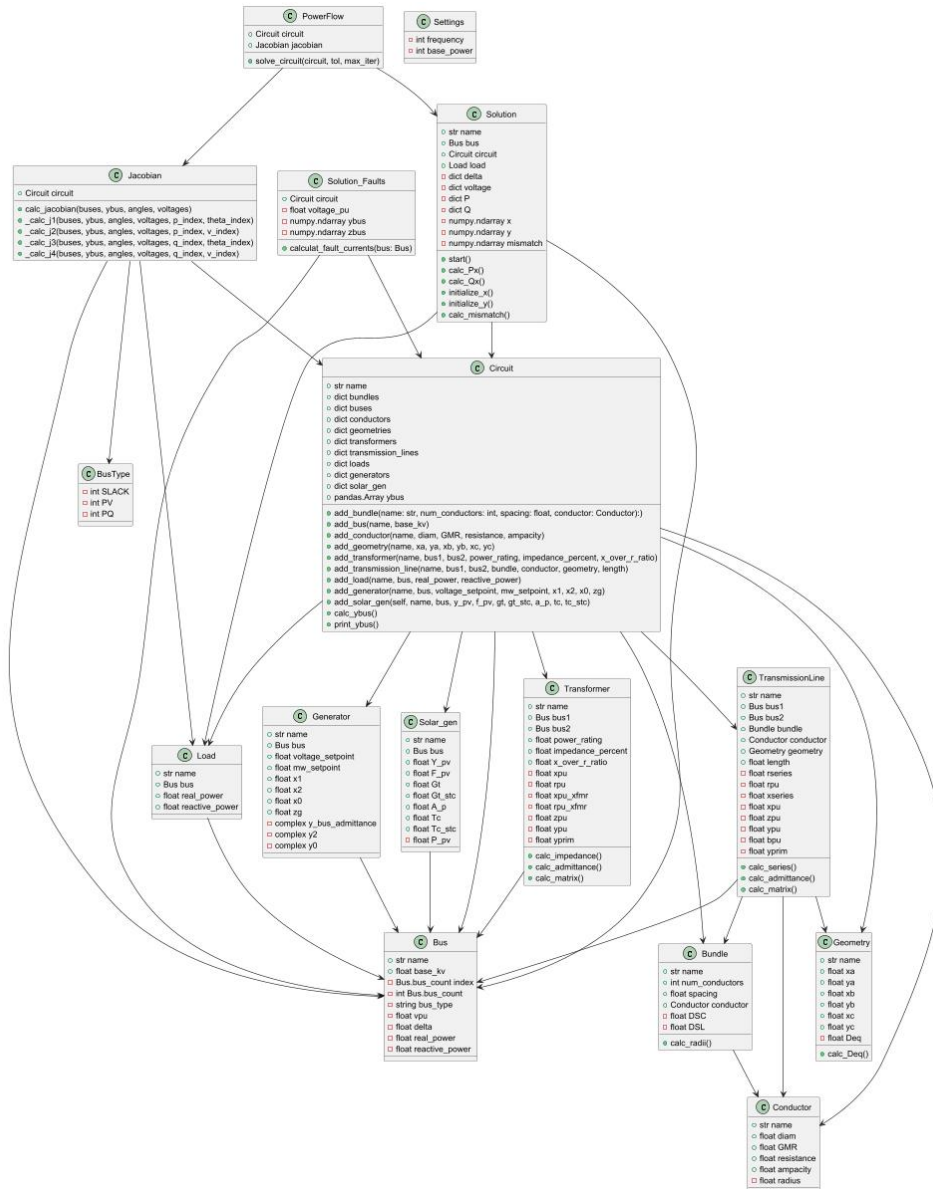


Figure 1: Class Diagram for Project

3 Classes

3.1 Bundle

The Bundle class models a collection of conductors used in this simulation and calculates effective radii for resistance and inductance computations. This class is essential for modeling transmission lines, as it helps accurately compute effective radii for conductors arranged in bundles, affecting overall line behavior in analyses.

3.2 Bus

This Bus class is designed to model various types of buses within the power system, such as Slack, PV, and PQ buses. Each Bus instance is initialized with a name and base voltage (base kv). The class maintains a count of all Bus instances created using the class-level variable bus count. Key attributes include the bus type, voltage per unit (vpu), phase angle (delta), and power values (real power and reactive power). This class serves as a foundational component for simulating and analyzing power systems, enabling tracking of essential electrical characteristics for each bus.

3.3 Circuit

The Circuit class serves as a foundational component for modeling this power systems. It encapsulates the various elements that comprise a circuit—including buses, conductors, bundles, transformers, transmission lines, loads, and generators—providing a structured framework for representing and analyzing power flow. The class allows users to define and connect these components, storing their properties and relationships. A key functionality is the calc ybus method, which computes the network admittance matrix (Y-bus) which is crucial for power system analysis. This class forms the basis for more complex power system studies, enabling simulations of load flow, fault analysis, and system stability.

3.4 Conductor

The Conductor class is designed to model electrical conductors by initializing them with key properties such as name, diameter (diam), geometric mean radius (GMR), resistance, and ampacity. Upon instantiation, these parameters are assigned to instance variables, and the radius is calculated by converting the diameter from a given unit to inches using a divisor of 24.

3.5 Generator

The Generator class models a generator component within this power system. Each generator is initialized with a name for identification, an associated bus reference (Bus), a target voltage level (voltage setpoint), and a target power output in megawatts (mw setpoint).

3.6 Geometry

The Geometry class models a geometric figure defined by three points (A, B, and C) with their respective coordinates. Upon initialization, it calculates an attribute Deq, which is the average distance between each pair of these points. This is achieved using the distance formula to compute the lengths of sides AB, BC, and AC, then averaging them. The class is useful for scenarios requiring a measure of the average side length of a triangle formed by three points.

3.7 Jacobian

The Jacobian class performs the Jacobian matrix calculation for power flow analysis in power systems. It provides methods for calculating each of the four submatrices (J1, J2, J3, J4) that constitute the total Jacobian. These include the real power (P) and reactive power (Q) sensitivities due to variations in voltage angles (δ) and voltage magnitudes (V). The class crosses the network buses, computing these sensitivities from the admittance matrix (Ybus) and voltage angle and magnitude current estimates. The calculated Jacobian is a critical input to iterative power flow solvers, including the Newton-Raphson solution, to determine power system operating conditions. The functions within this class calculate efficiently the partial derivatives utilized for power flow convergence.

3.8 Load

The Load class is an electrical load that is connected to some bus in the power system. Each load is described by a name, a pointer to the 'Bus' that it is connected to, and its real power and reactive power demands (in Watts and VARs, respectively). This class simulates the action of power usage at a node in the network and is a key object to be utilized within power system simulation and analysis. It allows demand modeling of the electricity grid and must be done in order to conduct load flow, contingency, and other power calculations.

3.9 Power flow

The PowerFlow class computes the voltage magnitudes and angles of every bus in a power system circuit through the Newton-Raphson power flow algorithm. It is initialized with a circuit object that defines the network topology and parameters, and the power flow solution is determined iteratively. The solve circuit method performs the primary power flow calculation with a tolerance (tol) and maximum iterations (max iter). It employs a Jacobian object to calculate the Jacobian matrix and then proceeds to use it to update bus

voltage angles and magnitudes iteratively until a converged solution is reached. The function returns a dictionary containing the convergence status, number of iterations, final mismatch, calculated voltage magnitudes and angles, calculated real and reactive power injections, and a history of the mismatch values during the iteration process, providing a complete overview of the power flow solution.

3.10 Settings

The Settings class is a store of global parameters used throughout the power system analysis. It currently sets the system frequency (in Hertz) and base power (in MVA), base values used for per-unit calculation and conversion. This class provides simple modification and consistent application of these essential system parameters, with the benefit of code maintainability and the flexibility to represent different power system configurations. While presently constrained, it is designed to be extensible with more global settings as needed.

3.11 Seven Bus Power System

This Seven Bus Power System illustrates the development and solution of a power flow study on a typical electrical power system. It outlines the creation of a network model, including bus data, line data, and load data, in a Python setting. The code calculates the Jacobian matrix, a critical component of the power flow equations' solution, and utilizes a Newton-Raphson method to determine bus voltages and power injections. Additionally, the Seven Bus incorporates fault analysis capability, calculating fault currents and determining bus voltages under fault conditions. The code forms a foundation for power system behavior simulation, network stability verification, and contingency analysis, ultimately demonstrating an integrated approach to power system modeling and analysis.

3.12 Solar Gen

The Solar gen class is a solar generation unit within the power system context. It calculates the real power delivered by a solar generator based on environmental and design parameters, such as irradiance, derating factor, temperature coefficient, and cell temperature. The class supports dynamic injection of solar power at any bus on the system through increment of the net real power injection at the bus. With the incorporation of solar generation in the system model, the class enables simulation of renewable energy integration and its effects on power flow outcomes. The functionality augments the framework's ability to examine existing grid scenarios, including distributed generation and variable energy resources, and therefore expands the platform's use to concerns of the contemporary power system.

3.13 Solution

This Solution class implements a Newton-Raphson power flow solver for power system network analysis. It solves bus voltages by iterative minimization of the mismatch between calculated and specified power injections, utilizing an external 'circuit' object to define network data and topology. The solver accommodates various bus types (Slack, PV, PQ) and features base MVA scaling for normalized calculations. By converging to a solution, it provides valuable information on steady-state operation, including voltage profiles and power flows, and is therefore a key building block for power system analysis.

3.14 Solution Symmetric

This Solution Symmetric class aids fault analysis of power system networks by calculating symmetrical fault currents and related post-fault bus voltages. It addresses three-phase fault simulation from the impedance matrix (Z_{bus}) based on the system's admittance matrix (Y_{bus}). It enhances the conventional power flow analysis by introducing the effect of generator subtransient reactance through modification of Y_{bus} matrix diagonal elements. The program computes the fault current magnitude and angle at an arbitrary faulted bus and calculates the resultant voltage profile of the entire network. By incorporating fault analysis, the class enables the investigation of system response to faults, which in turn supports protective device coordination, system planning, and reliability studies.

3.15 Transformer

The Transformer class models transformers in a power system, connecting two buses and calculating their electrical characteristics like impedance and admittance. It's essential for simulating power flow and analyzing the system's behavior in this simulation.

3.16 Transmission Line

The TransmissionLine class encapsulates the electrical characteristics of a power transmission line. It initializes with necessary components such as buses, conductors, bundles, geometry, and length. The class computes series impedance (r_{pu} , x_{pu}) and shunt admittance (b_{pu}) using given formulas. These values are then used to construct an admittance matrix (y_{prim}), essential for power flow analysis. This model allows detailed simulation of how electrical power is transmitted between two points in a power system.

4 Equations Used for Power Calculations

Bundle

1 conductor:

$$DSC = r$$

$$DSL = GMR(\text{geometric mean radius})$$

2 conductors:

$$DSC = \sqrt{r * s} - r \text{ is radius and } s \text{ is spacing}$$

$$DSL = \sqrt{GMR * s}$$

3 conductors:

$$DSC = \sqrt[3]{r * s^2}$$

$$DSL = \sqrt[3]{GMR * s^2}$$

4 conductors:

$$DSC = 1.091 * (r * s^4)^{1/4}$$

$$DSL = 1.091 * (GMR * s^4)^{1/4}$$

Where:

- DSC is the equivalent diameter of a single circular conductor
- DSL is the geometric mean radius of the bundle
- r is the radius of individual conductors
- s is the spacing between conductors

Circuit

$Y_{\text{Bus}}[i, i] = \text{sum of all self-admittances at bus } i$

$Y_{\text{Bus}}[i, j] = -\text{sum of mutual admittances between buses } i \text{ and } j$

$$Z_{\text{transformer}} = \frac{\text{base_voltage}^2}{\text{power_rating}} * \frac{\text{impedance_percent}}{100}$$

$G_{\text{line}} = \text{conductance per unit length} * \text{length}$

$B_{\text{line}} = \text{susceptance per unit length} * \text{length}$

$$Z_{\text{line}} = R + jX$$

Generator

$$Y_1 = 1/jX_1$$

$$Y_2 = 1/jX_2$$

$$Y_0 = 1/(jX_0 + 3Z_g)$$

Where:

- Y represents admittance (per unit or Siemens)
- X represents reactance (per unit or Ohms)
- Z_g represents ground resistance (Ohms)
- j is the imaginary unit ($\sqrt{-1}$)

Geometry

Euclidean Distance Formula: $d = \sqrt{(x_2 - x_1)^2 + (y_2 - y_1)^2}$

Jacobian

Active Power:

$$P_i = V_i \sum_{j=1}^n V_j [G_{ij} \cos(\delta_i - \delta_j) + B_{ij} \sin(\delta_i - \delta_j)]$$

Reactive Power:

$$Q_i = V_i \sum_{j=1}^n V_j [G_{ij} \sin(\delta_i - \delta_j) - B_{ij} \cos(\delta_i - \delta_j)]$$

Jacobian Sub-matrices:

J1:

$$J1_{ij} = \begin{cases} -V_i^2 \sum_{k \neq i} Y_{ik} \sin(\delta_i - \delta_k - \theta_{ik}) & \text{if } i = j \\ V_i V_j Y_{ij} \sin(\delta_i - \delta_j - \theta_{ij}) & \text{if } i \neq j \end{cases}$$

J2:

$$J2_{ij} = \begin{cases} V_i Y_{ii} \cos(\delta_i - \delta_i - \theta_{ii}) + V_i \sum_{k \neq i} Y_{ik} \cos(\delta_i - \delta_k - \theta_{ik}) & \text{if } i = j \\ V_i Y_{ij} \cos(\delta_i - \delta_j - \theta_{ij}) & \text{if } i \neq j \end{cases}$$

J3:

$$J3_{ij} = \begin{cases} V_i^2 \sum_{k \neq i} Y_{ik} \cos(\delta_i - \delta_k - \theta_{ik}) & \text{if } i = j \\ -V_i V_j Y_{ij} \cos(\delta_i - \delta_j - \theta_{ij}) & \text{if } i \neq j \end{cases}$$

J4:

$$J4_{ij} = \begin{cases} -V_i Y_{ii} \sin(\delta_i - \delta_i - \theta_{ii}) + V_i \sum_{k \neq i} Y_{ik} \sin(\delta_i - \delta_k - \theta_{ik}) & \text{if } i = j \\ V_i Y_{ij} \sin(\delta_i - \delta_j - \theta_{ij}) & \text{if } i \neq j \end{cases}$$

Where:

- V_i and V_j : Voltage magnitudes at buses i and j
- G_{ij} and B_{ij} : Real and imaginary parts of the admittance between buses i and j
- Y_{ii} : Admittance between buses i and j, where $Y_{ij} = G_{ij} + jB_{ij}$
- δ_i and δ_j : Phase angles at buses i and j
- θ_{ij} : Phase angle of the admittance Y_{ij}

PowerFlow

Newton-Raphson Method:

$$J \cdot dx = -\text{mismatch}$$

Angle and Voltage Corrections:

$$\Delta \theta_i^{k+1} = \Delta \theta_i^k + dx_i$$

Solution

Active Power Mismatch:

$$\Delta P_i = P_{spec,i} - P_i$$

Reactive Power Mismatch:

$$\Delta Q_i = Q_{spec,i} - Q_i$$

Solution Faults

Inverse Matrix:

$$Z_{bus} = (Y_{bus})^{-1}$$

Fault Current at Bus:

$$I_f(n) = \frac{V_{pu}}{Z_{nn}}$$

Bus Voltage Post-Fault:

$$V_k = (1 - \frac{Z_{kn}}{Z_{nn}}) \times V_{pu}$$

Transformer

Transformer Impedance:

$$Z_{pu} = \frac{Z_{\%}}{100} \cdot \frac{S_{base}}{S_{transformer}} \angle \theta$$

where $\theta = \tan^{-1}(X/R)$.

Transformer Admittance:

$$Y_{pu} = \frac{1}{Z_{pu}}$$

Transformer Y-Bus Matrix:

$$[Y_{Bus}] = \begin{bmatrix} Y_{11} & -Y_{12} \\ -Y_{21} & Y_{22} \end{bmatrix}$$

where $-Y_{12} = -Y_{21}$.

Transmission Line

Series Resistance Calculation:

$$R_{series} = \left(\frac{p}{n}\right) \times L$$

Series Reactance Calculation:

$$X_{series} = 2\pi f \times \mu_0 \times \log\left(\frac{D_{eq}}{D_{SL}}\right) \times L$$

Per Unit Impedance:

$$Z_{pu} = R_{pu} + jX_{pu}$$

Shunt Admittance Calculation:

$$B_{shunt} = 2\pi f \times \frac{\epsilon_0}{\log\left(\frac{D_{eq}}{D_{SC}}\right)} \times L$$

Per Unit Shunt Admittance Calculation:

$$B_{pu} = \frac{B_{shunt}}{Y_{base}}$$

Prim Matrix Calculation:

$$Y' = \begin{bmatrix} Y_p + B/2 & -Y_p \\ -Y_p & Y_p + B/2 \end{bmatrix}$$

Where:

- Y_p is the per unit admittance due to series resistance and reactance.
- B is the shunt conductance (real part of admittance).

Solar gen

Output power of the solar cell

$$P_{PV} = Y_{PV} f_{PV} \left(\frac{\bar{G}_T}{\bar{G}_{T,STC}} \right) \left[1 + \alpha_p (T_c - T_{c,STC}) \right]$$

Where:

Y_{pv} = rated capacity of the PV array

f_{pv} = derating factor

G_t = incident radiation

$G_{t,stc}$ = incident radiation at standard temperature condition – 1Kw/m²

α_p = Temperature coefficient of power

T_c = Temperature of the solar cell

$T_{c,stc}$ = Temperature of the solar cell at standard temperature conditions = 25C

5 Example Problem with Solution

5.1 Problem Definition

This example demonstrates the use of the Simple Circuit Simulator on a 7-bus power system. The configuration includes:

- Bus 1: Slack bus, 20 kV, V = 1.00000 p.u., angle = 0.00°
- Bus 2: PQ bus, 230 kV, V = 0.93692 p.u., angle = -4.44°
- Bus 3: PQ bus, 230 kV, V = 0.92049 p.u., angle = -5.46°, Load = 110 MW / 50 MVar
- Bus 4: PQ bus, 230 kV, V = 0.92980 p.u., angle = -4.70°, Load = 100 MW / 70 MVar
- Bus 5: PQ bus, 230 kV, V = 0.92672 p.u., angle = -4.83°, Load = 100 MW / 65 MVar
- Bus 6: PQ bus, 230 kV, V = 0.93968 p.u., angle = -3.95°
- Bus 7: PV bus, 18 kV, V = 0.99999 p.u., angle = +2.15°, Generator = 200 MW

Components include:

- Transformers: T1 (Bus1-Bus2, 125 MVA, 8.5%, X/R=10), T2 (Bus6-Bus7, 200 MVA, 10.5%, X/R=12)
- Transmission Lines: L1-L6, 10-35 km, using ACSR conductor, double bundle, and triangle geometry.
- Solar cell : S1 connected to Bus3 with $Y_{pv} = 100000 \text{kw}$, $f_{pv} = .95$, $G_t = .8$, $G_{t,stc} = 1$, $\alpha_p = .0045$, $T_c = 60$, $T_{c,stc} = 25$)

5.2 Solution Process

The simulator applies the Newton-Raphson power flow algorithm to solve bus voltages and power injections.

Solar Cell effects:

- Assigned on a certain bus.
- Calculates the real power provided by the cell using

$$P_{PV} = Y_{PV} f_{PV} \left(\frac{\overline{G}_T}{\overline{G}_{T,STC}} \right) \left[1 + \alpha_p (T_c - T_{c,STC}) \right]$$

- Adds its real power value to the real power saved for the selected bus.

Newton Raphson Solution:

- Initial voltages and angles are set for each bus.
- Power mismatches are computed based on specified vs. calculated P and Q.
- The Jacobian matrix is built using partial derivatives.
- Iterate through the system to find the voltages.

Fault Calculation:

- Using generator impedances to edited Ybus admittance matrix to find Zbus = $1/Y_{bus}$.
- Using the Zbus to find the faulted current at the faulted bus is given by $I_f = \text{voltage} / Z_{bus}$
- Find the voltages at the other buses after the fault using $Voltgae = (1 - (Z_{bus} / Z_{bus}) * \text{voltage}$

5.3 Expected Outputs

```
==== POWER FLOW RESULTS ====  
Converged: True  
Iterations: 3  
Final Maximum Mismatch: 0.000104
```

--- Per Unit Voltages ---

```
Bus 1: 1.00000  
Bus 2: 0.94172  
Bus 3: 0.93046  
Bus 4: 0.93515  
Bus 5: 0.93355  
Bus 6: 0.94520  
Bus 7: 0.99999
```

--- Voltage Angles (Degrees) ---

```
Bus 1: 0.00  
Bus 2: -0.74  
Bus 3: -0.67  
Bus 4: -0.75  
Bus 5: -0.50  
Bus 6: 0.26  
Bus 7: 6.36
```

--- Modified Y-bus for Symmetrical Fault Analysis ---

```
Row 0: ['1.4633-22.9662j', '-1.4633+14.6329j', '0.0000+0.0000j', '0.0000+0.0000j', '0.0000+0.0000j', '0.0000+0.0000j', '0.0000+0.0000j']  
Row 1: ['-1.4633+14.6329j', '37.7241-126.9765j', '-10.3602+32.1167j', '-25.9006+80.2918j', '0.0000+0.0000j', '0.0000+0.0000j', '0.0000+0.0000j']  
Row 2: ['0.0000+0.0000j', '-10.3602+32.1167j', '23.3105-72.1792j', '0.0000+0.0000j', '-12.9503+40.1459j', '0.0000+0.0000j', '0.0000+0.0000j']  
Row 3: ['0.0000+0.0000j', '-25.9006+80.2918j', '0.0000+0.0000j', '46.2511-143.2577j', '-7.4002+22.9405j', '-12.9503+40.1459j', '0.0000+0.0000j']  
Row 4: ['0.0000+0.0000j', '0.0000+0.0000j', '-12.9503+40.1459j', '-7.4002+22.9405j', '46.2511-143.2577j', '-25.9006+80.2918j', '0.0000+0.0000j']  
Row 5: ['0.0000+0.0000j', '0.0000+0.0000j', '0.0000+0.0000j', '-12.9503+40.1459j', '-25.9006+80.2918j', '40.4327-139.3639j', '-1.5818+18.9818j']  
Row 6: ['0.0000+0.0000j', '0.0000+0.0000j', '0.0000+0.0000j', '0.0000+0.0000j', '0.0000+0.0000j', '-1.5818+18.9818j', '1.5818-27.3152j']  
Fault Current at Bus4: 11.5903  $\angle$  -76.93°  
Solar PV Output (p_pv) at Bus3: 87970.00 kW
```