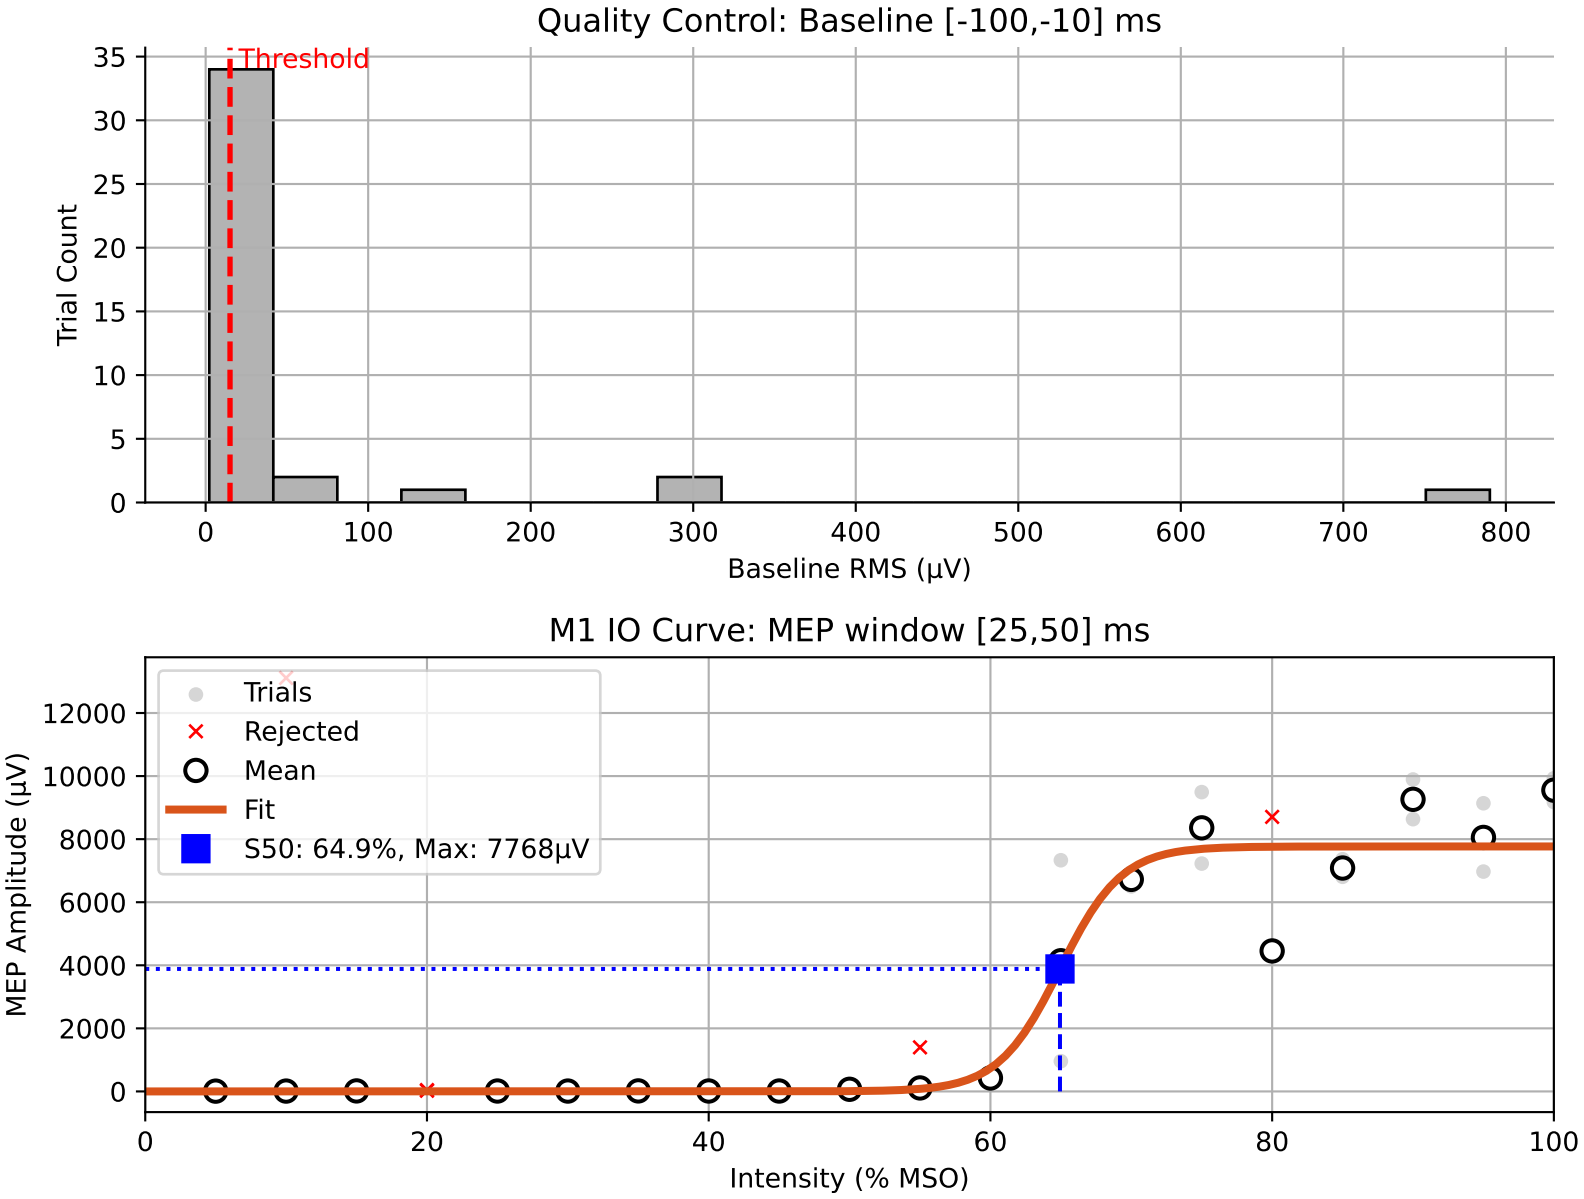
Quality Control: Baseline [-100,-10] ms
Threshold
Trial Count
Baseline RMS (µV)
M1 IO Curve: MEP window [25,50] ms
Trials
Rejected
Mean
Fit
S50: 64.9%, Max: 7768µV
MEP Amplitude (µV)
Intensity (% MSO)