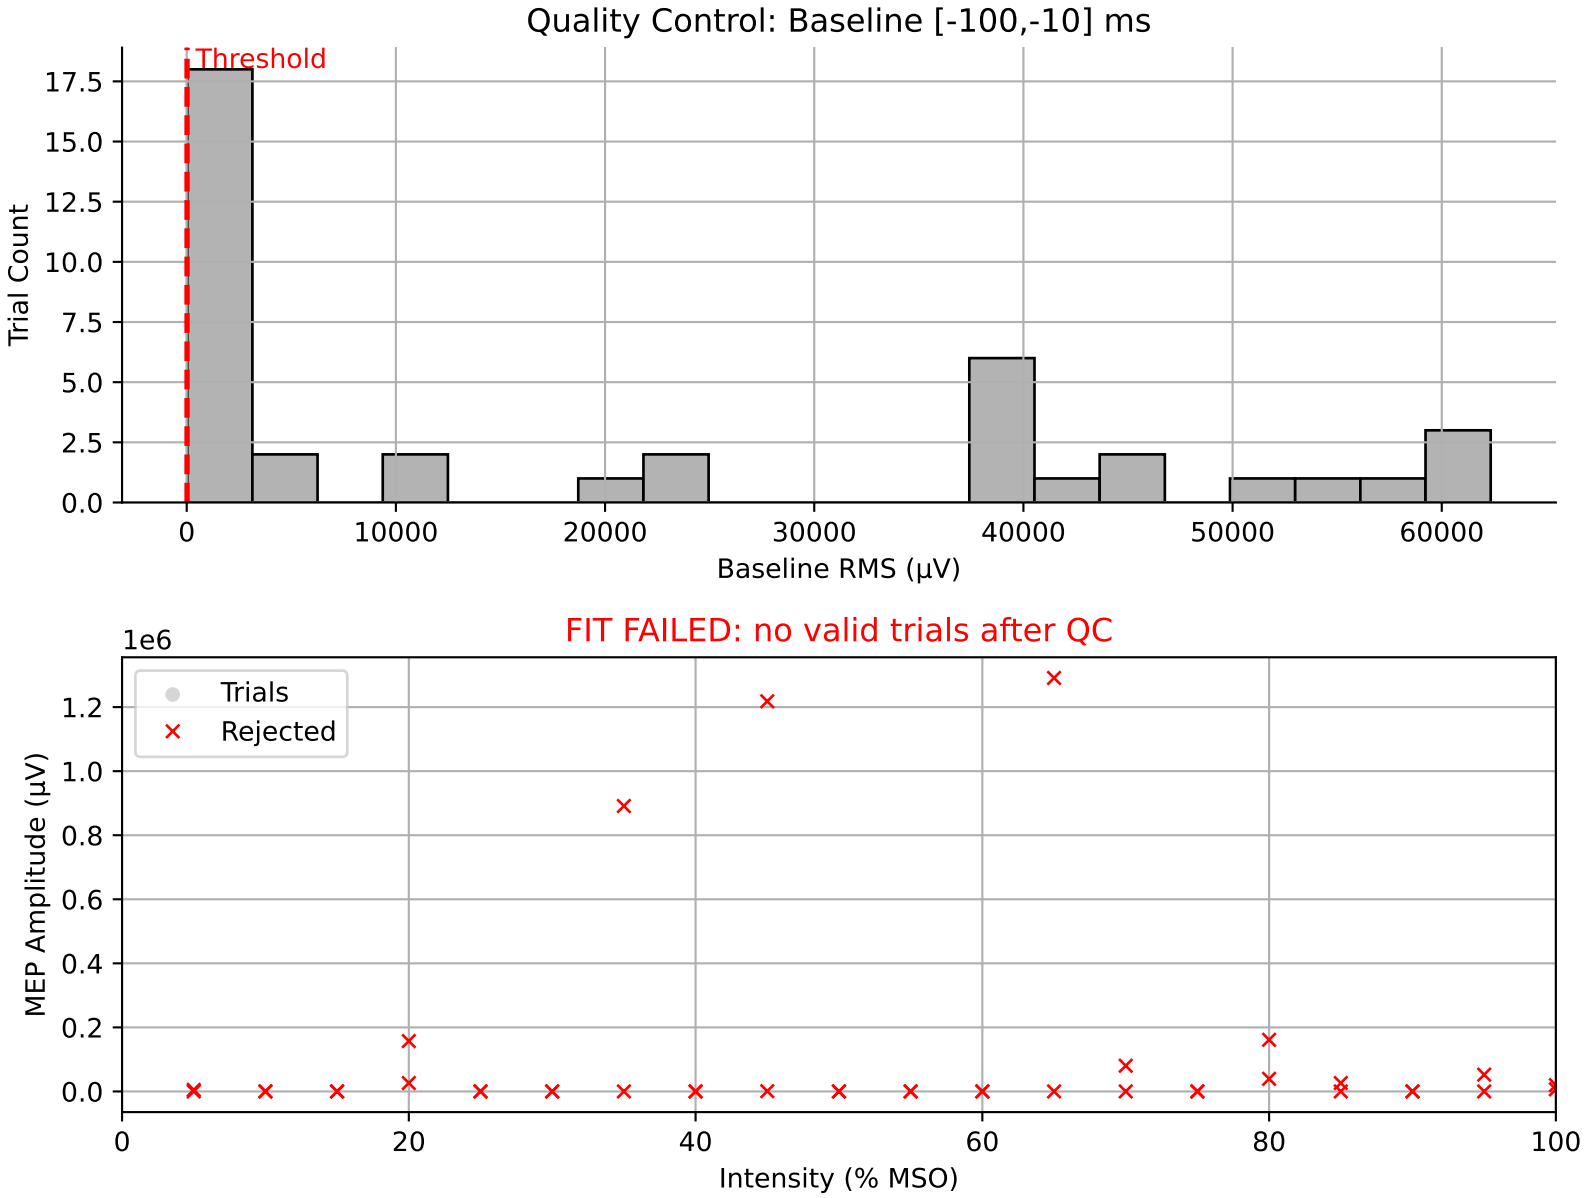
Quality Control: Baseline [-100,-10] ms
Threshold
Trial Count
Baseline RMS (µV)
FIT FAILED: no valid trials after QC
1e6
Trials
Rejected
MEP Amplitude (µV)
Intensity (% MSO)