


THE MONUMENT IS TO BE POURED IN PLACE AND THE MARKER PLUMBED INTO POSITION AND SET IN THE CONCRETE IN SUCH A MANNER THAT NO AIR WILL BE TRAPPED ON THE UNDERSIDE OF THE MARKER.


#10 REINFORCEMENT STEEL, 18" LONG, TO BE PLACED AT THE TIME OF CONCRETE POUR.

THE MONUMENT MARKER SHALL BE MADE OF BRASS, CONFORMING TO ASTM B-19.

MONUMENT

CD-157-1.1

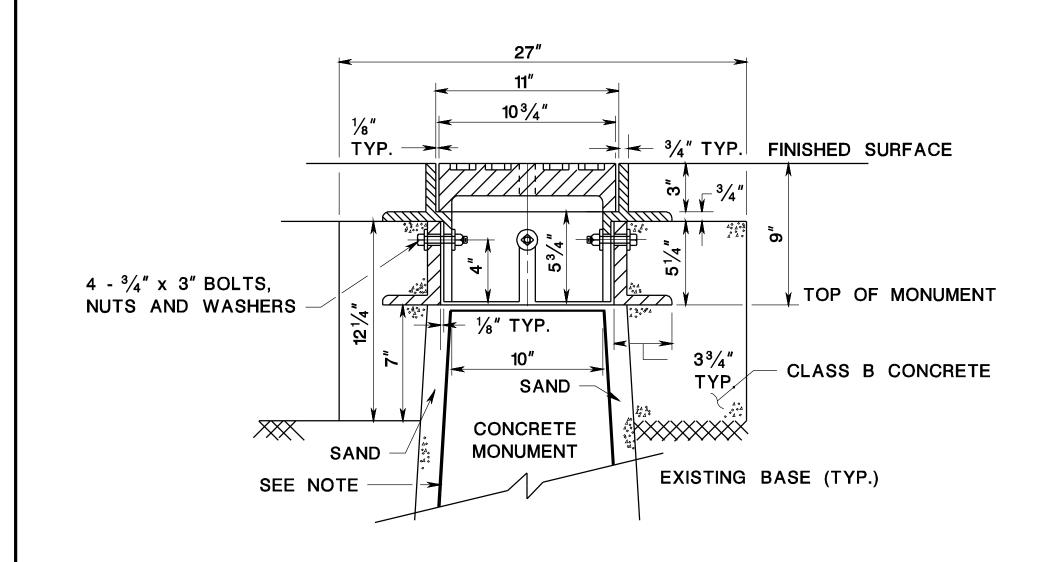

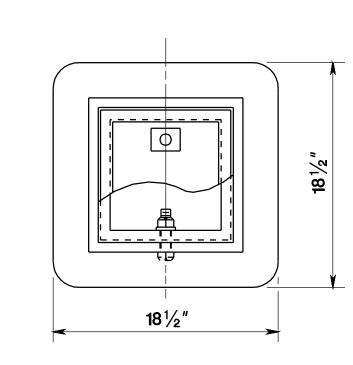

TOP VIEW OF CASTING

NOTE:

A LAYER OF FELT OR NYLON OR TAR PAPER NEEDED BETWEEN SAND AND CONCRETE MONUMENT.

MONUMENT BOX FOR NEW MONUMENT

CD-157-1.2

REINFORCEMENT STEEL IS IN METRIC UNITS.

MONUMENT AND MONUMENT BOX

N.T.S.

CD-157-1

NEW JERSEY DEPARTMENT OF TRANSPORTATION

CONSTRUCTION DETAILS

8 146