


NOTE

1. ALL LOW POINTS WILL BE PROVIDED WITH DRAIN CONNECTION AND HIGH POINTS WITH VENT CONNECTION AFTER LAYOUT IS FINALIZED.

2. THE PIPE SIZES HEREIN MAY BE CHANGED IN ACCORDANCE WITH THE FINAL CALCULATIONS OR VENDOR INFORMATION.

3. MULTIPLE VIB. SENSOR AND TEMP. SENSOR WILL BE INSTALLED FOR PUMP REFER TO VENDOR DWG. NO. VP-100-2-M-PI-111-133

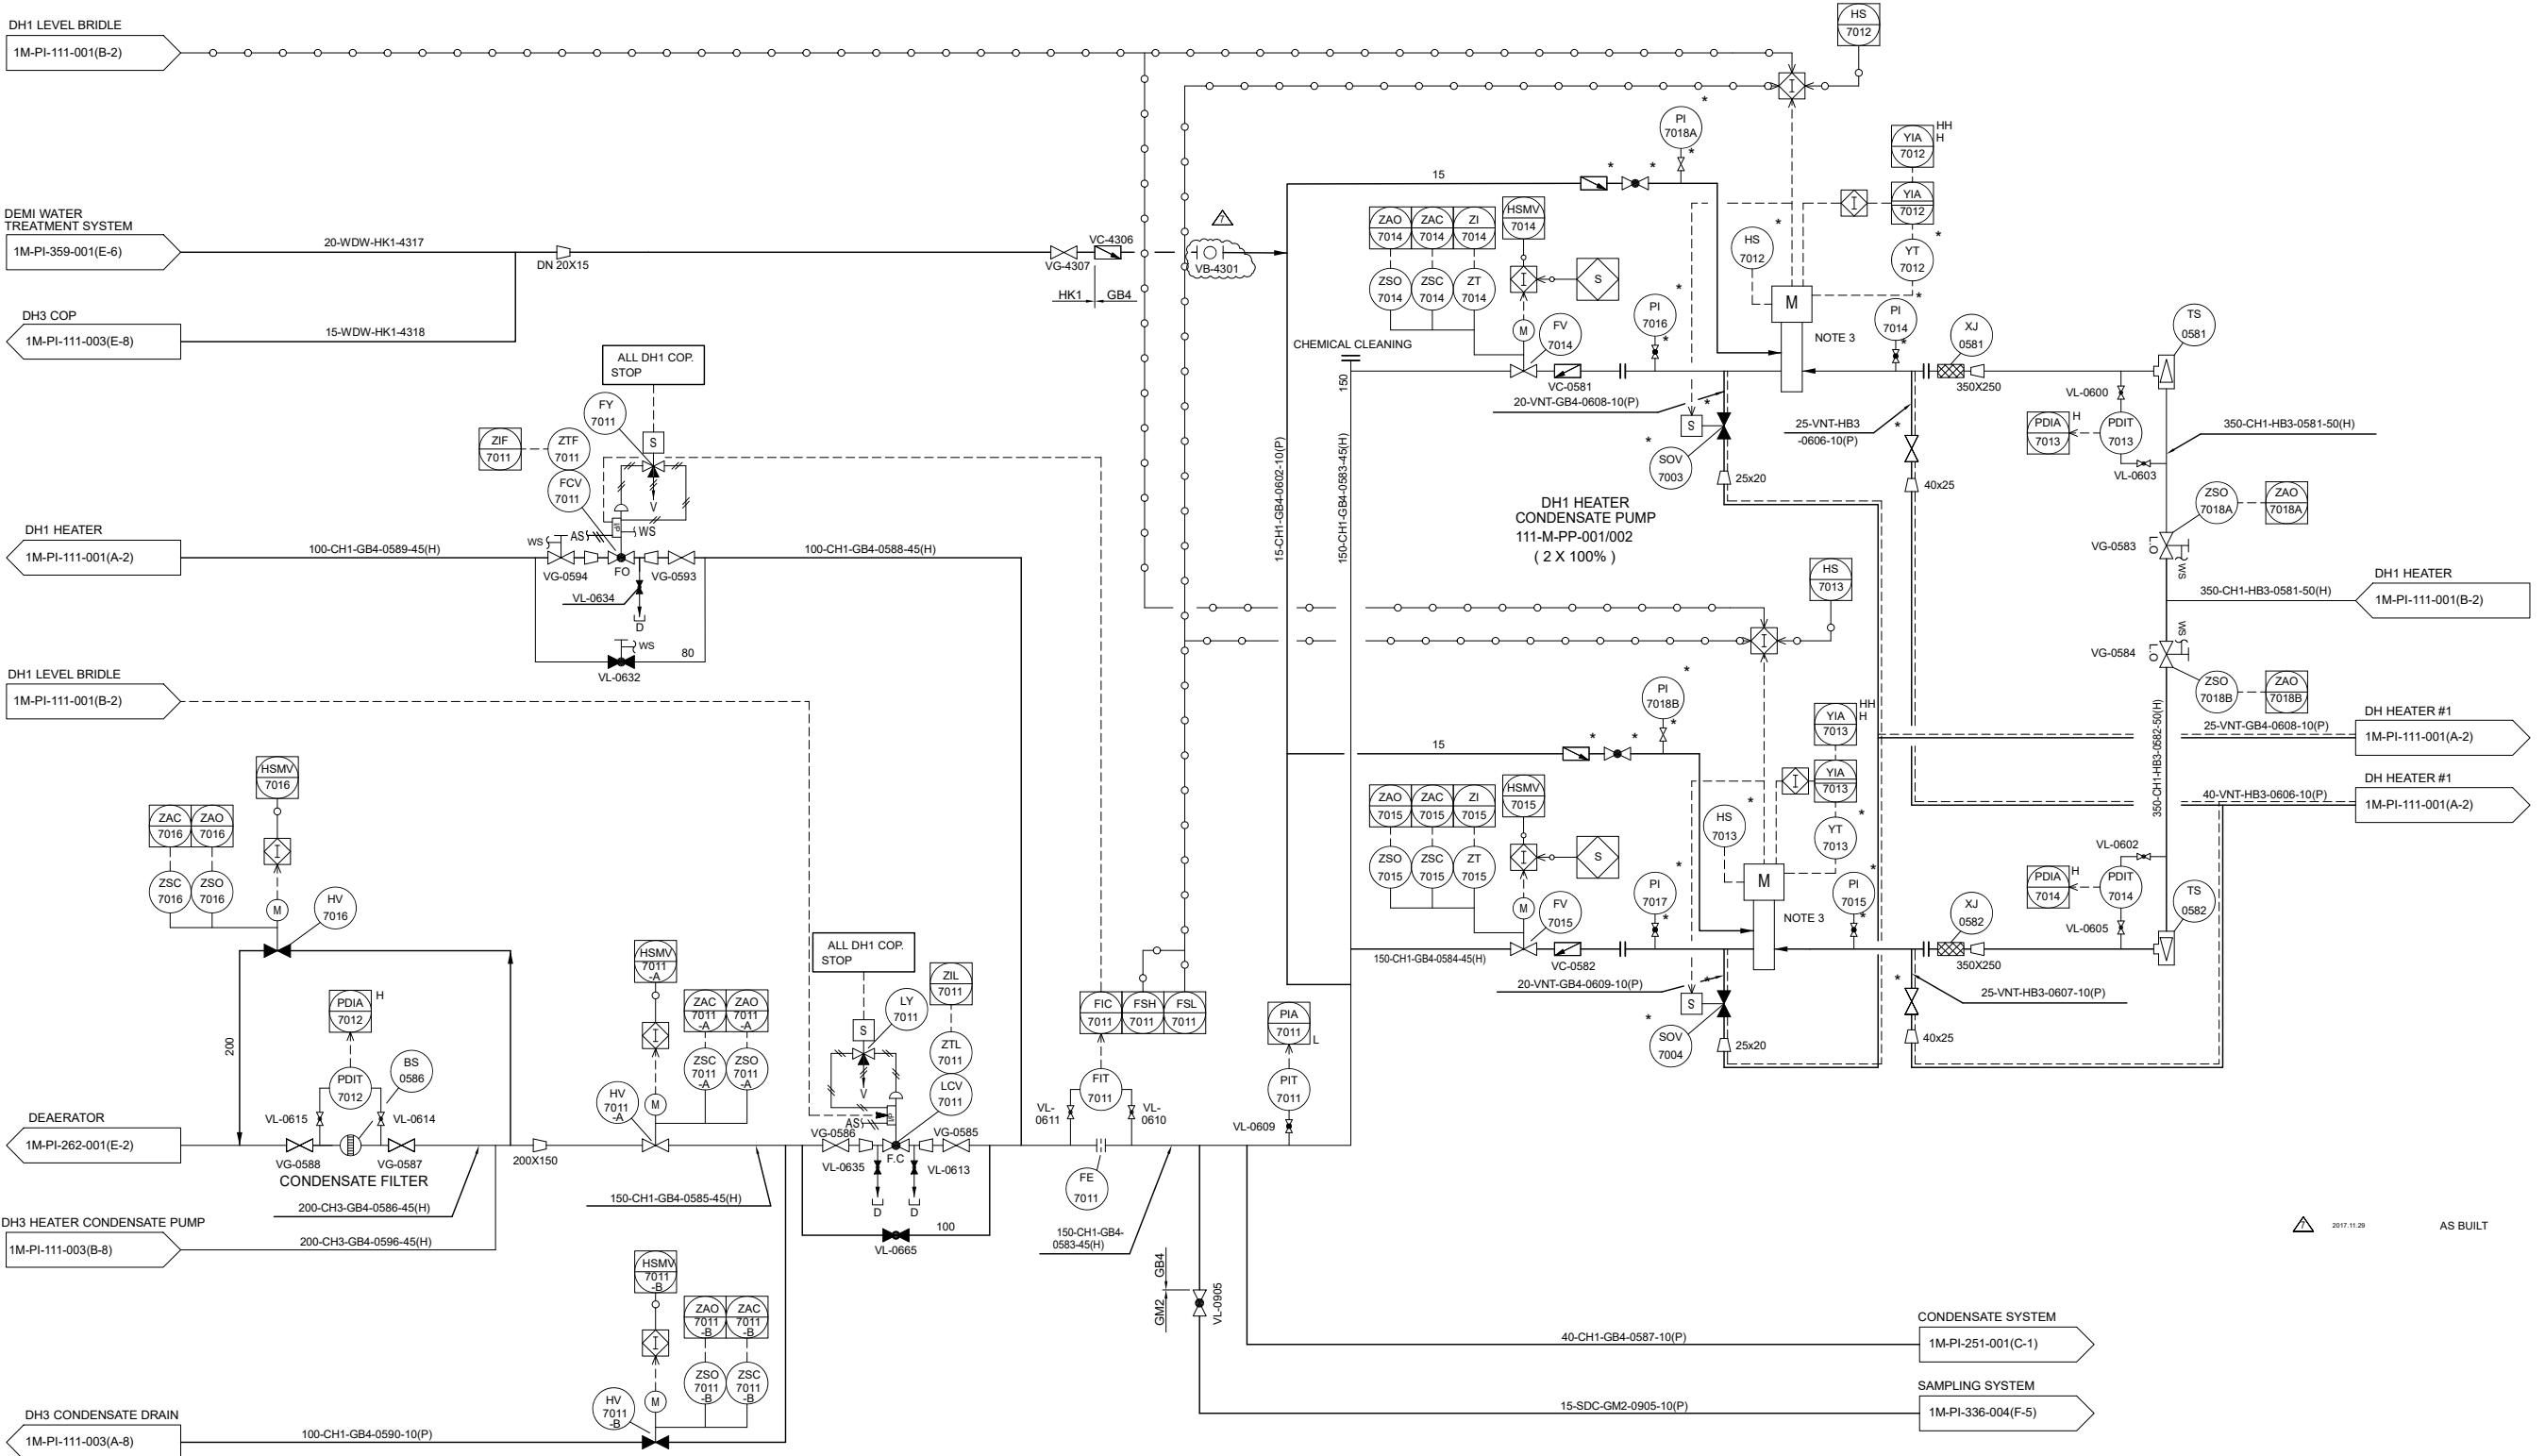

P & I DIAGRAM
DH H/E CONDENSATE SYSTEM (2/3)