

Climate 5000 Series - Gen 4

27K BTU Multi Zone Max Performance Outdoor Unit

Engineering
Submittal
Sheet



BOSCH

Overview and Project Information



Project name

Location

Architect

Engineer

General contractor

Reference #

Date

27K Btu Multi Zone Max Performance Outdoor Unit

Outdoor part number

8-733-962-700

Outdoor model number

BMS500-AAM027-1CSXHD

Efficiency Data

Ducted

Non-Ducted

Mixed Ducted & Non-Ducted

SEER2

19

23

21.0

EER2

12

12.5

12.25

HSPF2 (Region IV)

9.5

10.5

10.0

HSPF2 (Region V)

7.7

8.5

8.1

COP(47°F)

3.6

3.8

3.7

COP (5°F)

2.0

2.0

2.0

Performance Data

Ducted

Non-Ducted

Mixed Ducted & Non-Ducted

Cooling

Capacity Range (Btu/h)

7200~38000

7200~37000

7200~38000

Rated Capacity (Btu/h)

28000

27000

27500

Current (A)

10.5

9.5

10.0

Input Power (W)

2333

2125

2229.0

Heating

Capacity Range (Btu/h)

8400~38500

8400~36000

8400~37250

Rated Capacity (47°F)

28000

27000

27500

Capacity (5°F)

27000

27000

27000

Current (A)

10

9.1

9.6

Input Power (W)

2279

2082

2180.5

Operation Range

ODU	Cooling (°F / °C)	-22~122 / -30~50
	Heating (°F / °C)	-22~75 / -30~24

Electrical Data

Power supply (V / Ø / Hz)	208-230 / 1 / 60
Min. circuit ampacity (A)	30
Max. fuse (A)	35

Compressor Data

Type:	Rotary
Refrigerant oil /oil charge (ml)	VG74 / 1000
Input (W)	2765
Rated current (A)	5.4

Climate 5000 Series - Gen 4

27K Btu Multi Zone Max Performance Outdoor Unit



BOSCH

Piping	
Refrigerant precharge (ft / m)	24.6(7.5)x4
Refrigerant charge (oz / kg)	120.63 / 3.42
Liquid side (in / mm)	4x1/4in / 4x6.35mm
Gas side (in / mm)	3x3/8in+1x1/2in / 3x9.52mm+1x12.7mm
Additional Charge of Refrigerant - liquid side (oz/ft)/(g/m)	0.16 / 15
Additional Charge of Refrigerant - gas side (oz/ft)/(g/m)	0.32 / 30
Max. refrigerant pipe length (ft / m)	262.4 / 80
Max. length to one IDU (ft / m)	114.8 / 35
Max. height difference between IDU and ODU (ft / m)	49.2 / 15
Max. height difference between IDU's (ft / m)	33 / 10

System Data		
Refrigerant type		R454B
Design pressure (PSIG)		550 / 340
Dehumidification (L/hr)		0.423
ODU	Fan motor model #	ZKFN-120-8-9
	Fan motor qty (ea)	1
	Fan motor input (W)	150.0
	Fan motor speed, H / M / L (RPM)	800 / 750 / 600
	Air flow, max (CFM)	2148.4
	Noise level, max (dB(A))	61
	Net weight (lbs / kg)	168.43 / 76.4
IDU	Gross weight (lbs / kg)	179.67 / 81.5
	Minimum # of indoors	1
IDU	Maximum # of indoors	4

Multi Zone Pairing Information	1 ZONE	2 ZONE	3 ZONE		4 ZONE		5 ZONE
BMS500-AAM027-1CSXHD	24	6+18	6+6+6	9+9+12	6+6+6+6	6+9+9+18	
	30	6+24	6+6+9	9+9+18	6+6+6+9	6+9+9+24	
		9+9	6+6+12	9+9+24	6+6+6+12	6+9+12+12	
		9+12	6+6+18	9+12+12	6+6+6+18	6+9+12+18	
		9+18	6+6+24	9+12+18	6+6+6+24	6+12+12+12	
		9+24	6+9+9	9+12+24	6+6+9+9	6+12+12+18	
		12+12	6+9+12	9+18+18	6+6+9+12	9+9+9+9	
		12+18	6+9+18	12+12+12	6+6+9+18	9+9+9+12	
		12+24	6+9+24	12+12+18	6+6+9+24	9+9+9+18	
		18+18	6+12+12	12+12+24	6+6+12+12	9+9+12+12	
			6+12+18	12+18+18	6+6+12+18	9+9+12+18	
			6+12+24		6+6+12+24	9+12+12+12	
			6+18+18		6+6+18+18	12+12+12+12	
			6+18+24		6+9+9+9		
			9+9+9		6+9+9+12		
Capacities	Wall Mounted - 6K to 30K Cassette/Ducted - 9K to 24K						


Climate 5000 Series - Gen 4

27K Btu Multi Zone Max Performance Outdoor Unit



BOSCH

Outdoor Unit Dimensions and Connections

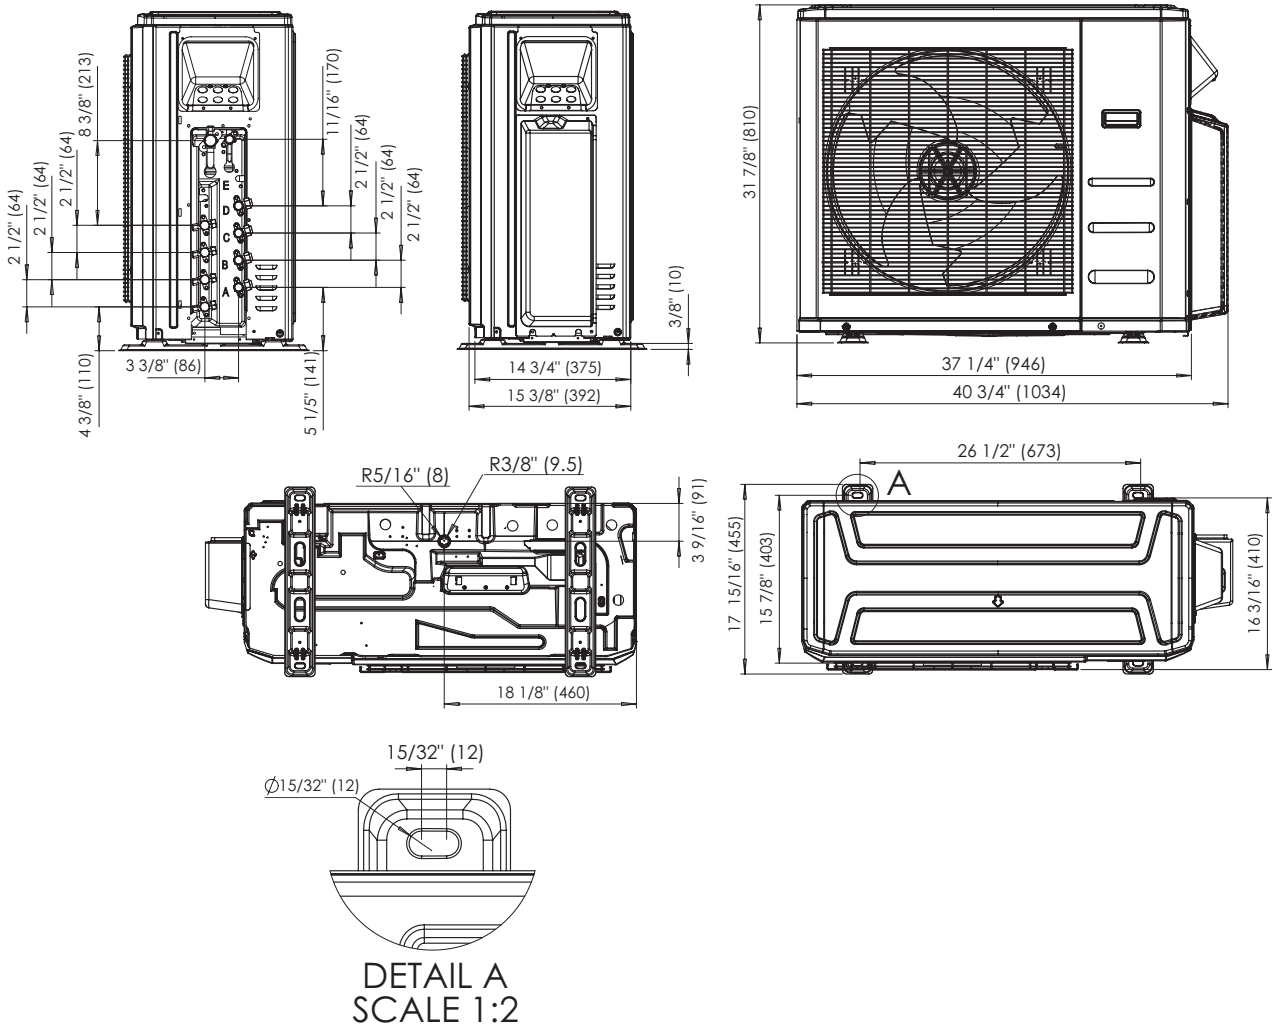

Model	W (in)	D (in)	H (in)
BMS500-AAM027-1CSXHD	37.24	16.14	31.89

Climate 5000 Series - Gen 4

27K Btu Multi Zone Max Performance Outdoor Unit


BOSCH

Cooling Performance - Indoor Dry Bulb Temperature at 1294 CFM (Ducted)																					
ODU DB(F)	IDU WB (F)	60.8°F(16.0°C)					64.4°F(18.0°C)					67°F(19.4°C)					71.6°F(22.0°C)				
	IDU DB (F)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)
-22°F (-30.0°C)	TC	32518	32562	32597	32598	32642	34478	34519	34553	34559	34600	36538	36585	36626	36633	36673	38739	38781	38823	38829	38878
	S/T	0.48	0.56	0.63	0.63	0.72	0.50	0.59	0.67	0.67	0.77	0.53	0.63	0.71	0.71	0.81	0.57	0.67	0.76	0.76	0.86
	PI	2.62	2.62	2.62	2.62	2.63	2.77	2.78	2.78	2.78	2.78	2.94	2.94	2.95	2.95	2.95	3.12	3.12	3.12	3.12	3.13
-13°F (-25.0°C)	TC	35228	35275	35313	35315	35362	37351	37395	37432	37439	37484	39582	39634	39678	39685	39730	41967	42013	42059	42065	42118
	S/T	0.48	0.56	0.64	0.64	0.73	0.51	0.60	0.68	0.68	0.77	0.54	0.63	0.72	0.72	0.82	0.57	0.67	0.76	0.76	0.87
	PI	2.83	2.84	2.84	2.84	2.85	3.01	3.01	3.01	3.01	3.02	3.19	3.19	3.19	3.19	3.20	3.38	3.38	3.38	3.38	3.39
-4°F (-20.0°C)	TC	37938	37989	38030	38031	38083	40224	40272	40311	40319	40367	42627	42682	42730	42738	42786	45195	45245	45294	45301	45357
	S/T	0.48	0.57	0.64	0.64	0.73	0.51	0.60	0.68	0.68	0.78	0.54	0.64	0.72	0.72	0.82	0.57	0.67	0.77	0.77	0.87
	PI	3.05	3.06	3.06	3.06	3.06	3.24	3.24	3.24	3.24	3.25	3.43	3.43	3.44	3.44	3.44	3.64	3.64	3.64	3.65	3.65
0°F (-17.8°C)	TC	39142	39195	39237	39239	39292	41501	41550	41591	41599	41649	43980	44037	44087	44095	44144	46630	46681	46732	46739	46797
	S/T	0.48	0.57	0.64	0.64	0.73	0.51	0.60	0.68	0.68	0.78	0.54	0.64	0.72	0.72	0.83	0.58	0.68	0.77	0.77	0.88
	PI	3.15	3.15	3.16	3.16	3.16	3.34	3.34	3.35	3.35	3.35	3.54	3.54	3.55	3.55	3.55	3.75	3.76	3.76	3.76	3.77
5°F (-15.0°C)	TC	40647	40702	40746	40748	40803	43097	43148	43191	43199	43251	45672	45731	45782	45791	45842	48424	48476	48529	48537	48597
	S/T	0.49	0.57	0.65	0.65	0.74	0.51	0.60	0.69	0.69	0.78	0.55	0.64	0.73	0.73	0.83	0.58	0.68	0.77	0.77	0.88
	PI	3.27	3.28	3.28	3.28	3.28	3.47	3.47	3.48	3.48	3.48	3.68	3.68	3.68	3.68	3.69	3.90	3.90	3.91	3.91	3.91
14°F (-10.0°C)	TC	41036	41091	41135	41137	41193	43509	43561	43604	43612	43664	46108	46168	46220	46228	46280	48887	48940	48993	49001	49062
	S/T	0.49	0.57	0.65	0.65	0.74	0.52	0.61	0.69	0.69	0.78	0.55	0.64	0.73	0.73	0.83	0.58	0.68	0.77	0.77	0.88
	PI	3.16	3.17	3.17	3.17	3.17	3.35	3.36	3.36	3.36	3.36	3.55	3.56	3.56	3.56	3.56	3.77	3.77	3.77	3.77	3.78
17°F (-8.3°C)	TC	41166	41221	41265	41267	41323	43646	43698	43741	43750	43802	46254	46314	46366	46374	46426	49041	49094	49148	49155	49216
	S/T	0.49	0.57	0.65	0.65	0.74	0.52	0.61	0.69	0.69	0.79	0.55	0.64	0.73	0.73	0.83	0.58	0.68	0.78	0.78	0.88
	PI	3.12	3.13	3.13	3.13	3.14	3.31	3.32	3.32	3.32	3.32	3.51	3.52	3.52	3.52	3.52	3.72	3.73	3.73	3.73	3.74
23°F (-5.0°C)	TC	40768	40822	40866	40868	40923	43225	43276	43318	43327	43378	45807	45866	45918	45926	45977	48567	48620	48673	48680	48741
	S/T	0.49	0.58	0.65	0.65	0.75	0.52	0.61	0.69	0.69	0.79	0.55	0.65	0.74	0.74	0.84	0.58	0.69	0.78	0.78	0.89
	PI	3.04	3.05	3.05	3.05	3.06	3.23	3.23	3.23	3.23	3.24	3.42	3.42	3.43	3.43	3.43	3.63	3.63	3.63	3.63	3.64
35°F (1.7°C)	TC	39972	40026	40069	40071	40125	42381	42431	42473	42481	42532	44913	44971	45021	45030	45080	47619	47671	47723	47730	47789
	S/T	0.49	0.58	0.66	0.66	0.75	0.52	0.61	0.70	0.70	0.79	0.55	0.65	0.74	0.74	0.84	0.59	0.69	0.78	0.78	0.89
	PI	2.88	2.89	2.89	2.89	2.89	3.06	3.06	3.06	3.06	3.07	3.24	3.24	3.25	3.25	3.25	3.43	3.44	3.44	3.44	3.45
41°F (5.0°C)	TC	39952	40006	40049	40051	40105	42360	42410	42452	42460	42511	44891	44949	44999	45008	45058	47596	47647	47699	47707	47766
	S/T	0.49	0.58	0.66	0.66	0.75	0.52	0.61	0.70	0.70	0.80	0.56	0.65	0.74	0.74	0.84	0.59	0.69	0.78	0.78	0.89
	PI	2.91	2.91	2.91	2.91	2.92	3.08	3.08	3.09	3.09	3.09	3.27	3.27	3.27	3.27	3.28	3.46	3.47	3.47	3.47	3.47
47°F (8.3°C)	TC	39933	39986	40029	40031	40085	42339	42389	42431	42440	42490	44869	44927	44977	44985	45036	47572	47624	47676	47683	47742
	S/T	0.50	0.58	0.66	0.66	0.75	0.53	0.62	0.70	0.70	0.80	0.56	0.65	0.74	0.74	0.85	0.59	0.69	0.79	0.79	0.90
	PI	2.93	2.93	2.94	2.94	2.94	3.11	3.11	3.11	3.11	3.12	3.29	3.30	3.30	3.30	3.30	3.49	3.49	3.50	3.50	3.50
50°F (10.0°C)	TC	40475	40530	40573	40575	40630	42914	42965	43008	43016	43067	45478	45537	45588	45597	45648	48219	48271	48323	48331	48391
	S/T	0.50	0.58	0.66	0.66	0.76	0.53	0.62	0.70	0.70	0.80	0.56	0.66	0.75	0.75	0.85	0.59	0.70	0.79	0.79	0.90
	PI	2.99	2.99	2.99	2.99	3.00	3.17	3.17	3.17	3.18	3.18	3.36	3.36	3.36	3.37	3.37	3.56	3.56	3.57	3.57	3.57
59°F (15.0°C)	TC	42103	42160	42205	42207	42264	44640	44693	44737	44746	44799	47307	47369	47422	47431	47483	50158	50212	50267	50275	50337
	S/T	0.50	0.59	0.67	0.67	0.76	0.53	0.62	0.71	0.71	0.81	0.56	0.66	0.75	0.75	0.86	0.60	0.70	0.80	0.80	0.91
	PI	3.16	3.16	3.17	3.17	3.17	3.35	3.36	3.36	3.36	3.36	3.55	3.56	3.56	3.56	3.56	3.77	3.77	3.77	3.77	3.78
68°F (20.0°C)	TC	43731	43790	43837	43839	43898	46367	46421	46467	46476	46532	49137	49200	49255	49264	49319	52097	52154	52211	52219	52284
	S/T	0.51	0.60	0.69	0.69	0.78	0.54	0.64	0.73	0.73	0.83	0.58	0.68	0.77	0.77	0.88	0.61	0.72	0.82	0.82	0.93
	PI	3.33	3.34	3.34	3.34	3.35	3.53	3.54	3.54	3.54	3.55	3.75	3.75	3.75	3.76	3.76	3.97	3.98	3.98	3.98	3.99
77°F (25.0°C)	TC	45359	45420	45469	45471	45532	48093	48149	48197	48207	48264	50966	51032	51089	51098	51155	54037	54095	54154	54163	54230
	S/T	0.52	0.61	0.69	0.69	0.79	0.55	0.65	0.74	0.74	0.84	0.59	0.69	0.78	0.78	0.89	0.62	0.73	0.83	0.83	0.94
	PI	3.51	3.51	3.52	3.52	3.52	3.72	3.72	3.73	3.73	3.73	3.94	3.95	3.95	3.95	3.95	4.18	4.18	4.19	4.19	4.19
82°F (27.8°C)	TC	44567	44627	44675	44677	44737	47253	47309	47356	47365	47421	50076	50141	50197	50206	50262	53093	53151	53209	53217	53283
	S/T	0.53	0.62	0.70	0.70	0.80	0.56	0.66	0.75	0.75	0.85	0.59	0.70	0.79	0.79	0.90	0.63	0.74	0.84	0.84	0.95
	PI	3.62	3.63	3.63	3.63	3.63	3.84	3.84	3.85	3.85	3.85	4.07	4.07	4.07	4.08	4.08	4.31	4.32	4.32	4.32	4.33
86°F (30.0°C)	TC	41793	41850	41895	41896	41953	44312	44364	44408	44417	44470	46959	47020	47073	47082	47134	49789	49843	49897	49905	49967
	S/T	0.53	0.63	0.71	0.71	0.81	0.57	0.66	0.75	0.75	0.86	0.60	0.70	0.80	0.80	0.91	0.64	0.75	0.85	0.85	0.97
	PI	3.73	3.74	3.74	3.74	3.75	3.96	3.96	3.97	3.97	3.97	4.20	4.20	4.21	4.21	4.21	4.45	4.45	4.46	4.46	4.46

Climate 5000 Series - Gen 4

27K Btu Multi Zone Max Performance Outdoor Unit


BOSCH

Cooling Performance - Indoor Dry Bulb Temperature at 1588 CFM (Non-Ducted)

ODU DB(°F)	IDU WB (°F)	60.8°F(16.0°C)					64.4°F(18.0°C)					67°F(19.4°C)					71.6°F(22.0°C)				
		IDU DB (°F)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)
-22°F (-30.0°C)	TC	25592	25626	25654	25655	25690	27134	27166	27193	27198	27231	28755	28792	28825	28830	28862	30488	30521	30554	30559	30597
	S/T	0.60	0.71	0.80	0.80	0.91	0.57	0.67	0.76	0.76	0.86	0.53	0.63	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.77
	PI	2.37	2.38	2.38	2.38	2.38	2.52	2.52	2.52	2.52	2.53	2.67	2.67	2.67	2.67	2.68	2.83	2.83	2.83	2.84	2.84
-13°F (-25.0°C)	TC	27724	27762	27792	27793	27830	29395	29430	29459	29465	29500	31151	31192	31227	31232	31267	33028	33064	33100	33105	33147
	S/T	0.61	0.72	0.82	0.82	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.73	0.73	0.83	0.51	0.60	0.68	0.68	0.78
	PI	2.46	2.47	2.47	2.47	2.47	2.61	2.61	2.62	2.62	2.62	2.77	2.77	2.77	2.77	2.78	2.93	2.94	2.94	2.94	2.94
-4°F (-20.0°C)	TC	29857	29897	29929	29931	29971	31656	31694	31725	31731	31769	33548	33591	33629	33635	33672	35569	35608	35646	35652	35696
	S/T	0.62	0.73	0.83	0.83	0.94	0.59	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.70	0.70	0.79
	PI	2.55	2.55	2.56	2.56	2.56	2.70	2.71	2.71	2.71	2.71	2.87	2.87	2.87	2.87	2.88	3.04	3.04	3.04	3.05	3.05
0°F (-17.8°C)	TC	30805	30846	30880	30881	30923	32661	32700	32732	32739	32778	34613	34658	34696	34703	34741	36698	36738	36778	36784	36830
	S/T	0.63	0.73	0.84	0.84	0.95	0.59	0.69	0.79	0.79	0.90	0.56	0.65	0.74	0.74	0.85	0.53	0.62	0.70	0.70	0.80
	PI	2.59	2.59	2.60	2.60	2.60	2.75	2.75	2.75	2.75	2.75	2.91	2.91	2.92	2.92	2.92	3.08	3.09	3.09	3.09	3.10
5°F (-15.0°C)	TC	31990	32033	32067	32069	32112	33918	33958	33991	33998	34038	35944	35991	36031	36037	36078	38110	38151	38193	38199	38246
	S/T	0.63	0.74	0.84	0.84	0.96	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81
	PI	2.64	2.64	2.64	2.64	2.65	2.80	2.80	2.80	2.80	2.81	2.96	2.97	2.97	2.97	2.98	3.14	3.15	3.15	3.15	3.15
14°F (-10.0°C)	TC	32535	32579	32614	32615	32659	34496	34537	34571	34577	34619	36557	36604	36645	36652	36693	38759	38801	38844	38850	38898
	S/T	0.62	0.73	0.83	0.83	0.94	0.59	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.69	0.69	0.79
	PI	2.67	2.67	2.67	2.67	2.68	2.83	2.83	2.83	2.84	2.84	3.00	3.00	3.01	3.01	3.01	3.18	3.18	3.19	3.19	3.19
17°F (-8.3°C)	TC	32717	32761	32796	32797	32842	34688	34729	34764	34771	34812	36761	36809	36850	36856	36898	38976	39018	39061	39067	39115
	S/T	0.62	0.72	0.82	0.82	0.94	0.58	0.68	0.78	0.78	0.88	0.55	0.64	0.73	0.73	0.83	0.52	0.61	0.69	0.69	0.79
	PI	2.68	2.68	2.68	2.68	2.69	2.84	2.84	2.85	2.85	2.85	3.01	3.01	3.02	3.02	3.02	3.19	3.19	3.20	3.20	3.20
23°F (-5.0°C)	TC	33265	33310	33346	33347	33392	35270	35312	35346	35353	35395	37377	37426	37467	37474	37516	39629	39672	39715	39721	39771
	S/T	0.61	0.72	0.81	0.81	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.72	0.72	0.83	0.51	0.60	0.68	0.68	0.78
	PI	2.58	2.58	2.59	2.59	2.59	2.74	2.74	2.74	2.74	2.75	2.90	2.90	2.91	2.91	2.91	3.07	3.08	3.08	3.08	3.09
35°F (1.7°C)	TC	34362	34408	34445	34447	34493	36433	36476	36512	36519	36562	38609	38659	38703	38710	38753	40936	40980	41025	41031	41082
	S/T	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.76
	PI	2.39	2.39	2.39	2.39	2.40	2.53	2.53	2.54	2.54	2.54	2.68	2.69	2.69	2.69	2.69	2.84	2.85	2.85	2.85	2.85
41°F (5.0°C)	TC	35169	35216	35254	35256	35303	37289	37333	37370	37377	37421	39516	39568	39612	39619	39663	41897	41943	41988	41995	42047
	S/T	0.61	0.72	0.82	0.82	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.73	0.73	0.83	0.51	0.60	0.69	0.69	0.78
	PI	2.49	2.49	2.49	2.49	2.49	2.63	2.64	2.64	2.64	2.64	2.79	2.80	2.80	2.80	2.80	2.96	2.96	2.97	2.97	2.97
47°F (8.3°C)	TC	35976	36025	36064	36065	36114	38144	38190	38227	38235	38280	40423	40476	40521	40529	40574	42859	42906	42952	42959	43012
	S/T	0.63	0.73	0.83	0.83	0.95	0.59	0.69	0.79	0.79	0.90	0.56	0.65	0.74	0.74	0.85	0.53	0.62	0.70	0.70	0.80
	PI	2.58	2.59	2.59	2.59	2.59	2.74	2.74	2.74	2.75	2.75	2.90	2.91	2.91	2.91	2.91	3.08	3.08	3.08	3.09	3.09
50°F (10.0°C)	TC	36004	36053	36091	36093	36142	38174	38219	38257	38264	38310	40455	40507	40552	40560	40605	42892	42939	42985	42992	43046
	S/T	0.62	0.73	0.82	0.82	0.94	0.58	0.68	0.78	0.78	0.89	0.55	0.65	0.73	0.73	0.84	0.52	0.61	0.69	0.69	0.79
	PI	2.65	2.66	2.66	2.66	2.66	2.81	2.82	2.82	2.82	2.82	2.98	2.99	2.99	2.99	2.99	3.16	3.17	3.17	3.17	3.17
59°F (15.0°C)	TC	36087	36136	36175	36176	36225	38262	38307	38345	38353	38398	40548	40601	40646	40653	40699	42991	43038	43085	43091	43145
	S/T	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.76
	PI	2.87	2.87	2.87	2.87	2.88	3.04	3.04	3.05	3.05	3.05	3.22	3.22	3.23	3.23	3.23	3.41	3.42	3.42	3.42	3.43
68°F (20.0°C)	TC	36170	36219	36258	36260	36309	38350	38396	38433	38441	38487	40641	40694	40739	40747	40793	43090	43137	43184	43191	43244
	S/T	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.72	0.72	0.83	0.51	0.60	0.68	0.68	0.78	0.48	0.57	0.65	0.65	0.74
	PI	3.08	3.08	3.09	3.09	3.09	3.26	3.27	3.27	3.27	3.28	3.46	3.46	3.47	3.47	3.47	3.67	3.67	3.68	3.68	3.68
77°F (25.0°C)	TC	36253	36302	36341	36343	36392	38438	38484	38522	38529	38575	40735	40788	40833	40841	40886	43189	43236	43283	43290	43344
	S/T	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.70	0.70	0.80	0.49	0.58	0.66	0.66	0.75	0.47	0.55	0.62	0.62	0.71
	PI	3.29	3.29	3.30	3.30	3.30	3.49	3.49	3.50	3.50	3.50	3.70	3.70	3.71	3.71	3.71	3.92	3.92	3.93	3.93	3.93
82°F (27.8°C)	TC	36085	36134	36173	36174	36223	38260	38305	38343	38351	38396	40546	40598	40644	40651	40696	42989	43035	43082	43089	43143
	S/T	0.56	0.66	0.75	0.75	0.85	0.53	0.62	0.70	0.70	0.80	0.50	0.58	0.66	0.66	0.76	0.47	0.55	0.63	0.63	0.71
	PI	3.34	3.35	3.35	3.35	3.36	3.54	3.55	3.55	3.55	3.56	3.76	3.76	3.76	3.77	3.77	3.98	3.99	3.99	3.99	4.00
86°F (30.0°C)	TC	35680	35728	35766	35768	35816	37830	37875	37912	37920	37965	40090	40142	40187	40195	40239	42506	42552	42598	42605	42658
	S/T	0.58	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.69	0.69	0.79	0.49	0.58	0.65	0.65	0.75
	PI	3.30	3.31	3.31	3.31	3.31	3.50	3.50	3.51	3.51	3.51	3.71	3.71	3.72	3.72	3.72	3.93	3.94	3.94	3.94	3.95
95°F (35.0°C)	TC	3473																			

Climate 5000 Series - Gen 4

27K Btu Multi Zone Max Performance Outdoor Unit



BOSCH

Heating Performance - Indoor Dry Bulb Temperature at 1294 CFM (Ducted)										
Outdoor DB(°F)	TC□Total Heating Capacity(BTU/hr)					PI□Power Input(kW)				
	Indoor Conditions(DB °F)					Indoor Conditions(DB °F)				
	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)
-22°F(-30.0°C)	13538	13267	13201	13148	13030	3.08	3.11	3.12	3.12	3.13
-13°F(-25.0°C)	16684	16350	16268	16203	16058	3.26	3.29	3.30	3.30	3.32
-4°F(-20.0°C)	20707	20293	20192	20111	19930	3.53	3.56	3.56	3.57	3.59
0°F(-17.8°C)	24118	23636	23517	23423	23213	3.61	3.64	3.65	3.66	3.67
5°F(-15.0°C)	28381	27814	27675	27564	27316	3.72	3.75	3.76	3.77	3.78
14°F(-10.0°C)	28080	27518	27380	27271	27025	3.65	3.68	3.69	3.70	3.71
17°F(-8.3°C)	27979	27419	27282	27173	26929	3.63	3.66	3.67	3.67	3.69
22°F(-5.6°C)	28981	28402	28260	28146	27893	3.51	3.54	3.55	3.55	3.57
27°F(-2.8°C)	29983	29384	29237	29120	28858	3.40	3.42	3.43	3.44	3.45
32°F(-0.0°C)	30985	30366	30214	30093	29822	3.28	3.30	3.31	3.32	3.33
35°F(1.7°C)	31587	30955	30800	30677	30401	3.21	3.23	3.24	3.25	3.26
37°F(2.8°C)	33049	32388	32226	32097	31809	3.33	3.36	3.37	3.37	3.39
42°F(5.6°C)	36706	35972	35792	35649	35328	3.64	3.67	3.68	3.69	3.70
44.6°F(7.0°C)	38168	37405	37218	37069	36736	3.77	3.80	3.80	3.81	3.83
47°F(8.3°C)	40362	39555	39357	39200	38847	3.95	3.98	3.99	4.00	4.02
52°F(11.1°C)	35210	34505	34333	34196	33888	3.31	3.34	3.34	3.35	3.36
57°F(13.9°C)	30057	29456	29308	29191	28929	2.67	2.69	2.70	2.70	2.71
59°F(15.0°C)	27996	27436	27299	27189	26945	2.41	2.43	2.44	2.44	2.45
62°F(16.7°C)	24904	24406	24284	24187	23969	2.03	2.04	2.05	2.05	2.06
64.4°F(18.0°C)	22843	22386	22274	22185	21985	1.77	1.79	1.79	1.79	1.80

Bolded values were tested. All other values are simulated and for reference only.

Climate 5000 Series - Gen 4

27K Btu Multi Zone Max Performance Outdoor Unit



Heating Performance - Indoor Dry Bulb Temperature at 1588 CFM (Non-Ducted)										
Outdoor DB(°F)	TC□Total Heating Capacity(BTU/hr)					PI□Power Input(kW)				
	Indoor Conditions(DB °F)					Indoor Conditions(DB °F)				
	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)
-22°F(-30.0°C)	15010	14710	14636	14578	14447	3.05	3.08	3.08	3.09	3.10
-13°F(-25.0°C)	18047	17686	17597	17527	17369	3.21	3.23	3.24	3.25	3.26
-4°F(-20.0°C)	23441	22973	22858	22766	22561	3.39	3.42	3.42	3.43	3.45
0°F(-17.8°C)	25875	25358	25231	25130	24904	3.45	3.48	3.48	3.49	3.50
5°F(-15.0°C)	28917	28339	28197	28084	27832	3.52	3.55	3.55	3.56	3.58
14°F(-10.0°C)	29383	28795	28651	28537	28280	3.66	3.69	3.70	3.70	3.72
17°F(-8.3°C)	29538	28948	28803	28688	28429	3.70	3.73	3.74	3.75	3.76
22°F(-5.6°C)	29679	29085	28940	28824	28565	3.52	3.55	3.56	3.57	3.58
27°F(-2.8°C)	29820	29223	29077	28961	28700	3.34	3.37	3.37	3.38	3.39
32°F(-0.0°C)	29960	29361	29214	29097	28836	3.16	3.18	3.19	3.20	3.21
35°F(1.7°C)	30045	29444	29297	29179	28917	3.05	3.07	3.08	3.09	3.10
37°F(2.8°C)	31626	30993	30838	30715	30439	3.08	3.11	3.12	3.12	3.13
42°F(5.6°C)	35579	34867	34693	34554	34243	3.18	3.20	3.21	3.21	3.23
44.6°F(7.0°C)	37160	36416	36234	36089	35765	3.21	3.24	3.24	3.25	3.26
47°F(8.3°C)	39531	38741	38547	38393	38047	3.27	3.29	3.30	3.31	3.32
52°F(11.1°C)	39013	38233	38041	37889	37548	3.02	3.05	3.05	3.06	3.07
57°F(13.9°C)	38494	37724	37536	37386	37049	2.78	2.80	2.81	2.81	2.83
59°F(15.0°C)	38287	37521	37334	37184	36850	2.68	2.70	2.71	2.72	2.73
62°F(16.7°C)	37976	37216	37030	36882	36550	2.54	2.56	2.56	2.57	2.58
64.4°F(18.0°C)	37769	37013	36828	36681	36351	2.44	2.46	2.46	2.47	2.48

Bolded values were tested. All other values are simulated and for reference only.