

Climate 5000 Series - Gen 4

36K BTU Multi Zone Max Performance Outdoor Unit

Engineering
Submittal
Sheet



BOSCH

Overview and Project Information



Project name

Location

Architect

Engineer

General contractor

Reference #

Date

36K Btu Multi Zone Max Performance Outdoor Unit

Outdoor part number

8-733-962-701

Outdoor model number

BMS500-AAM036-1CSXHD

Efficiency Data

Ducted

Non-Ducted

Mixed Ducted & Non-Ducted

SEER2

19.4

23

21.2

EER2

12

13

12.5

HSPF2 (Region IV)

10.4

10.7

10.55

HSPF2 (Region V)

8.8

8.5

8.7

COP(47°F)

3.8

4

3.9

COP (5°F)

2.0

2.0

2.0

Performance Data

Ducted

Non-Ducted

Mixed Ducted & Non-Ducted

Cooling

Capacity Range (Btu/h)

9000~42000

9000~43000

9000~42500

Rated Capacity (Btu/h)

36000

36000

36000

Current (A)

13.4

12

12.7

Input Power (W)

3000

2750

2875.0

Heating

Capacity Range (Btu/h)

10000~45000

10000~44000

10000~44500

Rated Capacity (47°F)

36000

36000

36000

Capacity (5°F)

38000

36000

37000

Current (A)

12.4

11.5

12

Input Power (W)

2776

2638

2707

Operation Range

ODU

Cooling (°F / °C)

-22~122 / -30~50

Heating (°F / °C)

-22~75 / -30~24

Electrical Data

Power supply (V / Ø / Hz)

208-230 / 1 / 60

Min. circuit ampacity (A)

37

Max. fuse (A)

40

Compressor Data

Type:

Twin-Rotary

Refrigerant oil /oil charge (ml)

VG75 / 1460

Input (W)

3265

Rated current (A)

6.6

Climate 5000 Series - Gen 4

36K Btu Multi Zone Max Performance Outdoor Unit



BOSCH

Piping	
Refrigerant precharge (ft / m)	24.6(7.5)x5
Refrigerant charge (oz / kg)	134.04 / 3.8
Liquid side (in / mm)	5x1/4in / 5x6.35mm
Gas side (in / mm)	3x3/8in+2x1/2in / 3x9.52mm+2x12.7mm
Additional Charge of Refrigerant - liquid side (oz/ft)/(g/m)	0.16 / 15
Additional Charge of Refrigerant - gas side (oz/ft)/(g/m)	0.32 / 30
Max. refrigerant pipe length (ft / m)	262.4 / 80
Max. length to one IDU (ft / m)	114.8 / 35
Max. height difference between IDU and ODU (ft / m)	49.2 / 15
Max. height difference between IDU's (ft / m)	33 / 10

System Data		
Refrigerant type		R454B
Design pressure (PSIG)		550 / 340
Dehumidification (L/hr)		4.22
ODU	Fan motor model #	ZKFN-250-10-1
	Fan motor qty (ea)	1
	Fan motor input (W)	320.0
	Fan motor speed, H / M / L (RPM)	750 / 700 / 650
	Air flow, max (CFM)	3037.2
	Noise level, max (dB(A))	65
	Net weight (lbs / kg)	211.86 / 96.1
	Gross weight (lbs / kg)	244.71 / 111
IDU	Minimum # of indoors	1
	Maximum # of indoors	5


Multi Zone Pairing Information	1 ZONE	2 ZONE	3 ZONE		4 ZONE			5 ZONE	
BMS500-AAM036-1CSXHD	30	6+24	6+6+12	9+9+9	6+6+6+6	6+9+9+18	9+9+9+24	6+6+6+6+6	6+9+9+12+12
	36	6+30	6+6+18	9+9+12	6+6+6+9	6+9+9+24	9+9+12+12	6+6+6+6+9	9+9+9+9+9
		6+36	6+6+24	9+9+18	6+6+6+12	6+9+12+12	9+9+12+18	6+6+6+6+12	9+9+9+9+12
		9+18	6+6+30	9+9+24	6+6+6+18	6+9+12+18	9+9+12+24	6+6+6+6+18	
		9+24	6+6+36	9+9+30	6+6+6+24	6+9+12+24	9+9+18+18	6+6+6+9+9	
		9+30	6+9+9	9+12+12	6+6+9+9	6+9+18+18	9+9+18+24	6+6+6+9+12	
		9+36	6+9+12	9+12+18	6+6+9+12	6+9+18+24	9+12+12+12	6+6+6+9+18	
		12+12	6+9+18	9+12+24	6+6+9+18	6+12+12+12	9+12+12+18	6+6+6+12+12	
		12+18	6+9+24	9+18+18	6+6+9+24	6+12+12+18	9+12+12+24	6+6+6+12+18	
		12+24	6+9+30	9+18+24	6+6+12+12	6+12+12+24	9+12+18+18	6+6+9+9+9	
		12+30	6+12+12	12+12+12	6+6+12+18	6+12+18+18	9+18+18+18	6+6+9+9+12	
		12+36	6+12+18	12+12+18	6+6+12+24	6+12+18+24	12+12+12+12	6+6+9+9+18	
		18+18	6+12+24	12+12+24	6+6+18+18	6+18+18+18	12+12+12+18	6+6+9+12+12	
		18+24	6+12+30	12+18+18	6+6+18+24	9+9+9+9	12+12+12+24	6+6+12+12+12	
		18+30	6+18+18	12+18+24	6+9+9+9	9+9+9+12	12+12+18+18	6+9+9+9+9	
		24+24	6+18+24	18+18+18	6+9+9+12	9+9+9+18		6+9+9+9+12	
Capacities	Wall Mounted - 6K to 36K Cassette/Ducted - 9K to 24K								

36K Btu Multi Zone Max Performance Outdoor Unit



BOSCH

Outdoor Unit Dimensions and Connections

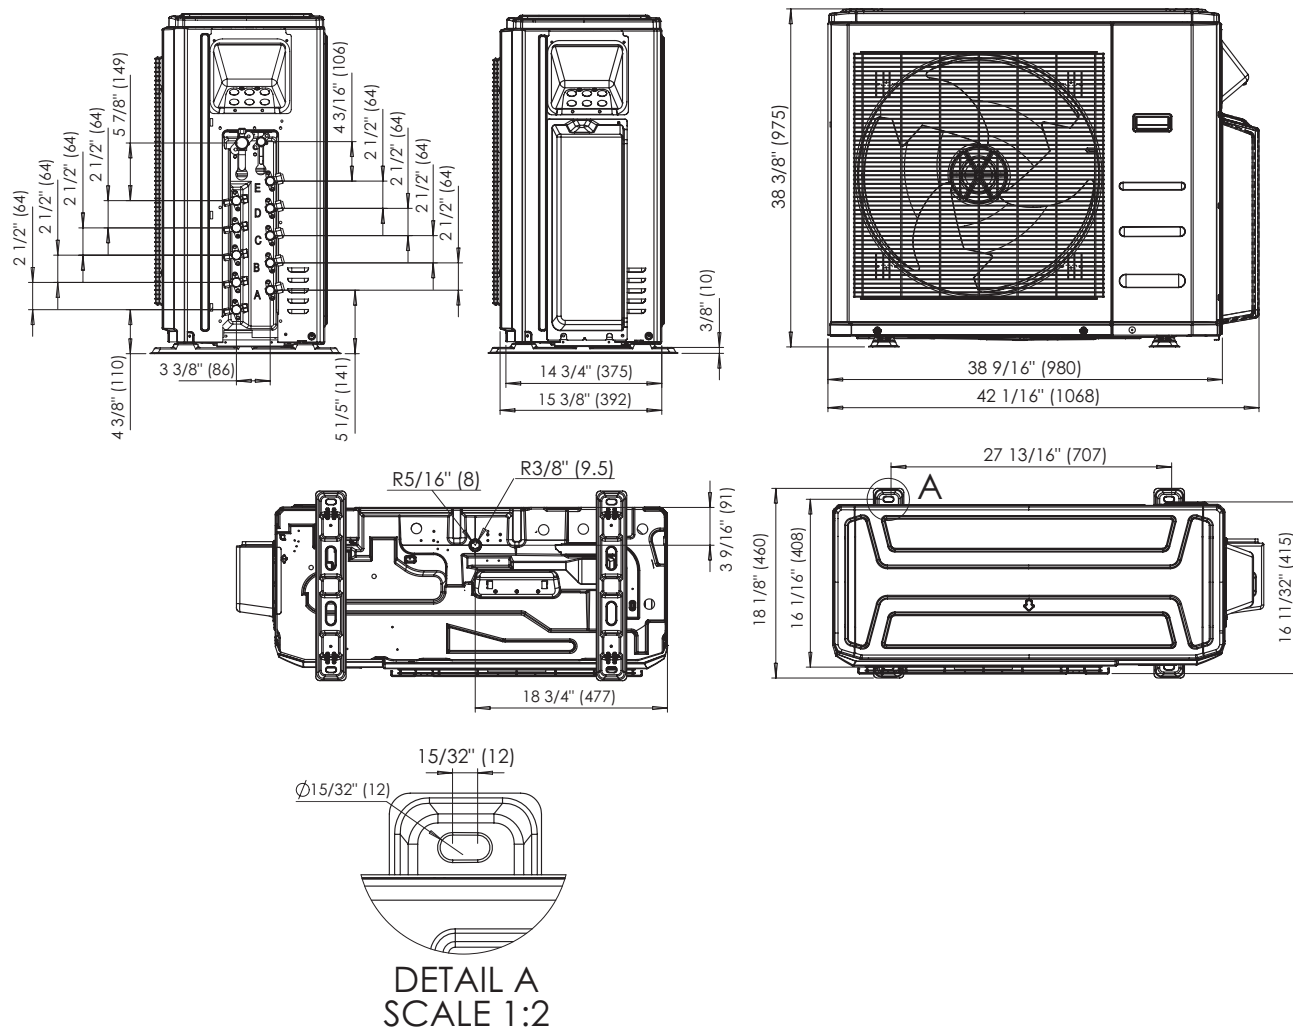

Model	W (in)	D (in)	H (in)
BMS500-AAM036-1CSXHD	38.58	16.34	38.39

Climate 5000 Series - Gen 4

36K Btu Multi Zone Max Performance Outdoor Unit


BOSCH

Cooling Performance - Indoor Dry Bulb Temperature at 1618 CFM (Ducted)																					
ODU DB(°F)	IDU WB (°F)	60.8°F (16.0°C)					64.4°F (18.0°C)					67°F (19.4°C)					71.6°F (22.0°C)				
	IDU DB (°F)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)
-22°F (-30.0°C)	TC	25870	25905	25933	25934	25969	27430	27462	27489	27495	27527	29068	29106	29138	29144	29176	30820	30853	30887	30892	30930
	S/T	0.60	0.71	0.80	0.80	0.91	0.57	0.67	0.76	0.76	0.86	0.53	0.63	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.77
	PI	1.72	1.73	1.73	1.73	1.73	1.83	1.83	1.83	1.83	1.83	1.94	1.94	1.94	1.94	1.94	2.05	2.06	2.06	2.06	2.06
-13°F (-25.0°C)	TC	28026	28064	28094	28095	28133	29715	29751	29780	29786	29821	31491	31532	31567	31573	31608	33388	33424	33461	33466	33508
	S/T	0.61	0.72	0.82	0.82	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.73	0.73	0.83	0.51	0.60	0.68	0.68	0.78
	PI	1.79	1.79	1.79	1.79	1.80	1.90	1.90	1.90	1.90	1.90	2.01	2.01	2.01	2.01	2.02	2.13	2.13	2.13	2.14	2.14
-4°F (-20.0°C)	TC	30182	30223	30255	30257	30297	32001	32039	32071	32077	32115	33913	33957	33995	34001	34039	35956	35995	36035	36040	36085
	S/T	0.62	0.73	0.83	0.83	0.94	0.59	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.70	0.70	0.79
	PI	1.85	1.85	1.86	1.86	1.86	1.96	1.97	1.97	1.97	1.97	2.08	2.08	2.09	2.09	2.09	2.21	2.21	2.21	2.21	2.21
0°F (-17.8°C)	TC	31140	31182	31216	31217	31259	33017	33056	33089	33095	33135	34990	35035	35074	35081	35120	37098	37138	37179	37184	37231
	S/T	0.63	0.73	0.84	0.84	0.95	0.59	0.69	0.79	0.79	0.90	0.56	0.65	0.74	0.74	0.85	0.53	0.62	0.70	0.70	0.80
	PI	1.88	1.88	1.89	1.89	1.89	1.99	2.00	2.00	2.00	2.00	2.11	2.12	2.12	2.12	2.12	2.24	2.24	2.25	2.25	2.25
5°F (-15.0°C)	TC	32338	32382	32416	32418	32462	34287	34328	34361	34368	34409	36335	36383	36423	36430	36471	38525	38567	38608	38614	38663
	S/T	0.63	0.74	0.84	0.84	0.96	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81
	PI	1.92	1.92	1.92	1.92	1.92	2.03	2.03	2.04	2.04	2.04	2.15	2.16	2.16	2.16	2.16	2.28	2.28	2.29	2.29	2.29
14°F (-10.0°C)	TC	38700	38752	38793	38795	38847	41032	41080	41121	41129	41178	43483	43540	43588	43596	43645	46103	46153	46204	46211	46268
	S/T	0.62	0.73	0.83	0.83	0.94	0.59	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.69	0.69	0.79
	PI	1.88	1.89	1.89	1.89	1.89	2.00	2.00	2.00	2.00	2.00	2.12	2.12	2.12	2.12	2.12	2.24	2.25	2.25	2.25	2.25
17°F (-8.3°C)	TC	40820	40875	40919	40921	40976	43280	43331	43374	43383	43434	45866	45926	45977	45985	46037	48629	48682	48735	48743	48804
	S/T	0.62	0.72	0.82	0.82	0.94	0.58	0.68	0.78	0.78	0.88	0.55	0.64	0.73	0.73	0.83	0.52	0.61	0.69	0.69	0.79
	PI	1.87	1.87	1.88	1.88	1.88	1.99	1.99	1.99	1.99	1.99	2.10	2.11	2.11	2.11	2.11	2.23	2.23	2.24	2.24	2.24
23°F (-5.0°C)	TC	41496	41552	41596	41598	41654	43996	44049	44092	44101	44153	46625	46686	46738	46746	46798	49434	49488	49542	49550	49611
	S/T	0.61	0.72	0.81	0.81	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.72	0.72	0.83	0.51	0.60	0.68	0.68	0.78
	PI	1.90	1.91	1.91	1.91	1.91	2.02	2.02	2.02	2.02	2.02	2.14	2.14	2.14	2.14	2.15	2.27	2.27	2.27	2.27	2.28
35°F (1.7°C)	TC	42847	42904	42951	42953	43010	45429	45483	45528	45537	45591	48143	48206	48259	48268	48322	51044	51099	51155	51163	51227
	S/T	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.76
	PI	1.96	1.97	1.97	1.97	1.97	2.08	2.08	2.09	2.09	2.09	2.21	2.21	2.21	2.21	2.21	2.34	2.34	2.34	2.35	2.35
41°F (5.0°C)	TC	44383	44442	44490	44492	44552	47057	47113	47160	47169	47225	49869	49934	49989	49999	50054	52873	52931	52989	52997	53063
	S/T	0.61	0.72	0.82	0.82	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.73	0.73	0.83	0.51	0.60	0.69	0.69	0.78
	PI	2.14	2.14	2.14	2.14	2.15	2.27	2.27	2.27	2.27	2.28	2.40	2.41	2.41	2.41	2.41	2.55	2.55	2.55	2.55	2.56
47°F (8.3°C)	TC	45919	45980	46030	46032	46094	48686	48743	48792	48801	48859	51594	51662	51719	51729	51786	54703	54763	54822	54831	54899
	S/T	0.63	0.73	0.83	0.83	0.95	0.59	0.69	0.79	0.79	0.90	0.56	0.65	0.74	0.74	0.85	0.53	0.62	0.70	0.70	0.80
	PI	2.31	2.32	2.32	2.32	2.32	2.45	2.46	2.46	2.46	2.46	2.60	2.60	2.61	2.61	2.61	2.76	2.76	2.76	2.76	2.77
50°F (10.0°C)	TC	45868	45930	45979	45981	46043	48632	48690	48738	48748	48805	51538	51605	51662	51672	51729	54643	54702	54762	54770	54839
	S/T	0.62	0.73	0.82	0.82	0.94	0.58	0.68	0.78	0.78	0.89	0.55	0.65	0.73	0.73	0.84	0.52	0.61	0.69	0.69	0.79
	PI	2.37	2.37	2.38	2.38	2.38	2.51	2.52	2.52	2.52	2.52	2.66	2.67	2.67	2.67	2.67	2.82	2.83	2.83	2.83	2.83
59°F (15.0°C)	TC	45716	45778	45827	45829	45891	48472	48529	48577	48586	48644	51367	51434	51491	51501	51559	54462	54522	54581	54589	54657
	S/T	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.76
	PI	2.54	2.54	2.54	2.54	2.55	2.69	2.69	2.70	2.70	2.70	2.85	2.85	2.86	2.86	2.86	3.02	3.03	3.03	3.03	3.03
68°F (20.0°C)	TC	45565	45626	45675	45677	45739	48311	48368	48416	48425	48483	51197	51264	51321	51330	51388	54282	54341	54400	54408	54476
	S/T	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.72	0.72	0.83	0.51	0.60	0.68	0.68	0.78	0.48	0.57	0.65	0.65	0.74
	PI	2.70	2.71	2.71	2.71	2.71	2.87	2.87	2.87	2.87	2.88	3.04	3.04	3.05	3.05	3.05	3.22	3.23	3.23	3.23	3.23
77°F (25.0°C)	TC	45413	45474	45523	45525	45587	48150	48207	48255	48264	48322	51027	51093	51150	51160	51217	54101	54160	54219	54227	54293
	S/T	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.70	0.70	0.80	0.49	0.58	0.66	0.66	0.75	0.47	0.55	0.62	0.62	0.71
	PI	2.87	2.88	2.88	2.88	2.88	3.05	3.05	3.05	3.05	3.06	3.23	3.23	3.23	3.23	3.24	3.42	3.43	3.43	3.43	3.43
82°F (27.8°C)	TC	44409	44469	44517	44519	44579	47085	47141	47188	47197	47253	49898	49963	50019	50028	50084	52905	52962	53020	53028	53094
	S/T	0.56	0.66	0.75	0.75	0.85	0.53	0.62	0.70	0.70	0.80	0.50	0.58	0.66	0.66	0.76	0.47	0.55	0.63	0.63	0.71
	PI	3.03	3.04	3.04	3.04	3.04	3.22	3.22	3.22	3.22	3.23	3.41	3.41	3.42	3.42	3.42	3.61	3.62	3.62	3.62	3.63
86°F (30.0°C)	TC	42444	42501	42547	42549	42607	45002	45056	45100	45109	45163	47691	47753	47806	47815	47868	50564	50619	50674	50682	50745
	S/T	0.58	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.69	0.69	0.79	0.49	0.58	0.65	0.65	0.75
	PI	3.25	3.25	3.25	3.25	3.26	3.44	3.45	3.45	3.45	3.45	3.65	3.65	3.66	3.66	3.66	3.87	3.87	3.88	3.88	3.88
95°F (35.0°C)	TC	38024	38075</																		

Climate 5000 Series - Gen 4

36K Btu Multi Zone Max Performance Outdoor Unit


BOSCH

Cooling Performance - Indoor Dry Bulb Temperature at 2029 CFM (Non-Ducted)																					
ODU DB(F)	IDU WB (F)	60.8°F(16.0°C)					64.4°F(18.0°C)					67°F(19.4°C)					71.6°F(22.0°C)				
	IDU DB (F)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)
-22°F (-30.0°C)	TC	33412	33457	33493	33495	33540	35426	35468	35503	35510	35552	37542	37591	37633	37640	37682	39804	39848	39891	39897	39947
	S/T	0.60	0.71	0.80	0.80	0.91	0.57	0.67	0.76	0.76	0.86	0.53	0.63	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.77
	PI	1.94	1.94	1.94	1.94	1.95	2.06	2.06	2.06	2.06	2.06	2.18	2.18	2.18	2.18	2.19	2.31	2.31	2.31	2.31	2.32
-13°F (-25.0°C)	TC	36197	36245	36284	36286	36335	38378	38423	38461	38469	38515	40671	40724	40769	40777	40822	43121	43168	43215	43222	43276
	S/T	0.61	0.72	0.82	0.82	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.73	0.73	0.83	0.51	0.60	0.68	0.68	0.78
	PI	2.01	2.01	2.02	2.02	2.02	2.13	2.13	2.14	2.14	2.14	2.26	2.26	2.26	2.26	2.27	2.39	2.40	2.40	2.40	2.40
-4°F (-20.0°C)	TC	38981	39033	39075	39077	39130	41330	41379	41420	41428	41477	43799	43856	43905	43913	43962	46438	46489	46539	46547	46605
	S/T	0.62	0.73	0.83	0.83	0.94	0.59	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.70	0.70	0.79
	PI	2.08	2.08	2.09	2.09	2.09	2.21	2.21	2.21	2.21	2.22	2.34	2.34	2.35	2.35	2.35	2.48	2.48	2.49	2.49	2.49
0°F (-17.8°C)	TC	40218	40273	40316	40318	40372	42642	42693	42735	42743	42794	45190	45249	45299	45307	45358	47913	47965	48017	48024	48084
	S/T	0.63	0.73	0.84	0.84	0.95	0.59	0.69	0.79	0.79	0.90	0.56	0.65	0.74	0.74	0.85	0.53	0.62	0.70	0.70	0.80
	PI	2.11	2.12	2.12	2.12	2.12	2.24	2.24	2.25	2.25	2.25	2.38	2.38	2.38	2.38	2.38	2.52	2.52	2.52	2.52	2.53
5°F (-15.0°C)	TC	41765	41821	41867	41868	41925	44282	44335	44379	44387	44440	46928	46989	47041	47050	47102	49755	49810	49864	49871	49934
	S/T	0.63	0.74	0.84	0.84	0.96	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81
	PI	2.15	2.16	2.16	2.16	2.16	2.28	2.29	2.29	2.29	2.29	2.42	2.42	2.43	2.43	2.43	2.57	2.57	2.57	2.57	2.58
14°F (-10.0°C)	TC	35651	35699	35738	35739	35788	37800	37845	37882	37890	37935	40058	40110	40155	40162	40207	42472	42518	42564	42571	42624
	S/T	0.62	0.73	0.83	0.83	0.94	0.59	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.69	0.69	0.79
	PI	1.89	1.90	1.90	1.90	1.90	2.01	2.01	2.01	2.01	2.01	2.13	2.13	2.13	2.13	2.14	2.26	2.26	2.26	2.26	2.26
17°F (-8.3°C)	TC	33613	33659	33695	33696	33742	35639	35681	35717	35724	35766	37768	37817	37860	37867	37909	40044	40087	40131	40137	40187
	S/T	0.62	0.72	0.82	0.82	0.94	0.58	0.68	0.78	0.78	0.88	0.55	0.64	0.73	0.73	0.83	0.52	0.61	0.69	0.69	0.79
	PI	1.81	1.81	1.81	1.81	1.81	1.92	1.92	1.92	1.92	1.92	2.03	2.03	2.04	2.04	2.04	2.15	2.15	2.16	2.16	2.16
23°F (-5.0°C)	TC	33887	33933	33969	33971	34017	35929	35972	36007	36014	36057	38076	38125	38168	38175	38217	40370	40414	40458	40464	40515
	S/T	0.61	0.72	0.81	0.81	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.72	0.72	0.83	0.51	0.60	0.68	0.68	0.78
	PI	1.83	1.83	1.84	1.84	1.84	1.94	1.94	1.95	1.95	1.95	2.06	2.06	2.06	2.06	2.07	2.18	2.18	2.19	2.19	2.19
35°F (1.7°C)	TC	34434	34481	34518	34519	34566	36510	36553	36589	36596	36640	38691	38741	38784	38791	38835	41022	41067	41111	41118	41169
	S/T	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.76
	PI	1.88	1.88	1.88	1.88	1.89	1.99	2.00	2.00	2.00	2.00	2.11	2.11	2.12	2.12	2.12	2.24	2.24	2.24	2.24	2.25
41°F (5.0°C)	TC	35760	35808	35846	35848	35896	37915	37960	37997	38005	38050	40180	40232	40277	40284	40329	42601	42647	42694	42700	42753
	S/T	0.61	0.72	0.82	0.82	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.73	0.73	0.83	0.51	0.60	0.69	0.69	0.78
	PI	2.01	2.01	2.01	2.01	2.01	2.13	2.13	2.13	2.13	2.14	2.25	2.26	2.26	2.26	2.26	2.39	2.39	2.40	2.40	2.40
47°F (8.3°C)	TC	37085	37135	37175	37177	37227	39320	39366	39405	39413	39460	41669	41723	41770	41777	41824	44180	44228	44276	44283	44338
	S/T	0.63	0.73	0.83	0.83	0.95	0.59	0.69	0.79	0.79	0.90	0.56	0.65	0.74	0.74	0.85	0.53	0.62	0.70	0.70	0.80
	PI	2.13	2.14	2.14	2.14	2.14	2.26	2.26	2.27	2.27	2.27	2.40	2.40	2.40	2.40	2.41	2.54	2.54	2.55	2.55	2.55
50°F (10.0°C)	TC	36731	36781	36820	36822	36871	38945	38991	39029	39037	39083	41271	41325	41371	41379	41425	43758	43806	43853	43860	43915
	S/T	0.62	0.73	0.82	0.82	0.94	0.58	0.68	0.78	0.78	0.89	0.55	0.65	0.73	0.73	0.84	0.52	0.61	0.69	0.69	0.79
	PI	2.20	2.20	2.20	2.20	2.21	2.33	2.33	2.34	2.34	2.34	2.47	2.47	2.48	2.48	2.48	2.62	2.62	2.63	2.63	2.63
59°F (15.0°C)	TC	35670	35718	35756	35758	35806	37819	37864	37901	37909	37954	40079	40131	40176	40183	40228	42494	42540	42586	42593	42646
	S/T	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.76
	PI	2.40	2.40	2.40	2.40	2.41	2.54	2.54	2.55	2.55	2.55	2.69	2.70	2.70	2.70	2.70	2.86	2.86	2.86	2.86	2.87
68°F (20.0°C)	TC	34608	34655	34692	34694	34740	36694	36737	36774	36781	36824	38886	38937	38980	38987	39031	41229	41274	41319	41325	41377
	S/T	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.72	0.72	0.83	0.51	0.60	0.68	0.68	0.78	0.48	0.57	0.65	0.65	0.74
	PI	2.59	2.60	2.60	2.60	2.60	2.75	2.75	2.76	2.76	2.76	2.91	2.92	2.92	2.92	2.93	3.09	3.09	3.10	3.10	3.10
77°F (25.0°C)	TC	33547	33592	33628	33629	33675	35568	35610	35646	35653	35695	37693	37742	37784	37791	37833	39964	40008	40051	40058	40107
	S/T	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.70	0.70	0.80	0.49	0.58	0.66	0.66	0.75	0.47	0.55	0.62	0.62	0.71
	PI	2.79	2.80	2.80	2.80	2.80	2.96	2.96	2.97	2.97	2.97	3.14	3.14	3.14	3.14	3.14	3.35	3.33	3.33	3.33	3.34
82°F (27.8°C)	TC	34177	34223	34260	34261	34308	36237	36280	36315	36323	36366	38402	38452	38494	38502	38544	40715	40760	40804	40810	40861
	S/T	0.56	0.66	0.75	0.75	0.85	0.53	0.62	0.70	0.70	0.80	0.50	0.58	0.66	0.66	0.76	0.47	0.55	0.63	0.63	0.71
	PI	2.95	2.96	2.96	2.96	2.96	3.13	3.13	3.14	3.14	3.14	3.32	3.32	3.33	3.33	3.33	3.52	3.52	3.53	3.53	3.53
86°F (30.0°C)	TC	36221	36270	36309	36310	36359	38404	38449	38487	38495	38541	40698	40751	40797	40804	40850	43151	43197	43244	43251	43305
	S/T	0.58	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.69	0.69	0.79	0.49	0.58	0.65	0.65	0.75
	PI	3.15	3.15	3.15	3.15	3.16	3.34	3.34	3.34	3.34	3.35	3.54	3.54	3.54	3.54	3.55	3.75	3.75	3.76	3.76	3.76
95°F (35.0°C)	TC	40820	40875	40919	40921	40976	43280														

Climate 5000 Series - Gen 4

36K Btu Multi Zone Max Performance Outdoor Unit



BOSCH

Heating Performance - Indoor Dry Bulb Temperature at 1618 CFM (Ducted)										
Outdoor DB(°F)	TC Total Heating Capacity(BTU/hr)					PI Power Input(kW)				
	Indoor Conditions(DB °F)					Indoor Conditions(DB °F)				
	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)
-22°F(-30.0°C)	17835	17478	17391	17321	17166	4.62	4.65	4.66	4.67	4.69
-13°F(-25.0°C)	21751	21316	21209	21124	20934	5.12	5.16	5.17	5.18	5.21
-4°F(-20.0°C)	28245	27680	27542	27431	27185	5.07	5.11	5.12	5.13	5.15
0°F(-17.8°C)	33427	32758	32594	32464	32172	5.23	5.27	5.28	5.29	5.32
5°F(-15.0°C)	39904	39106	38910	38755	38406	5.43	5.47	5.48	5.49	5.52
14°F(-10.0°C)	36569	35837	35658	35515	35196	4.66	4.70	4.71	4.72	4.74
17°F(-8.3°C)	35457	34748	34574	34436	34126	4.41	4.44	4.45	4.46	4.48
22°F(-5.6°C)	36596	35864	35685	35542	35222	4.25	4.29	4.30	4.30	4.32
27°F(-2.8°C)	37735	36980	36795	36648	36318	4.10	4.13	4.14	4.15	4.17
32°F(-0.0°C)	38874	38097	37906	37755	37415	3.95	3.98	3.99	3.99	4.01
35°F(1.7°C)	39558	38766	38573	38418	38073	3.86	3.89	3.89	3.90	3.92
37°F(2.8°C)	40642	39829	39630	39471	39116	3.81	3.84	3.85	3.86	3.88
42°F(5.6°C)	43352	42485	42273	42104	41725	3.71	3.74	3.75	3.76	3.77
44.6°F(7.0°C)	44436	43548	43330	43157	42768	3.67	3.70	3.71	3.72	3.73
47°F(8.3°C)	46063	45141	44916	44736	44333	3.61	3.64	3.65	3.65	3.67
52°F(11.1°C)	44865	43967	43747	43572	43180	3.58	3.61	3.62	3.63	3.64
57°F(13.9°C)	43667	42793	42579	42409	42027	3.55	3.58	3.59	3.60	3.61
59°F(15.0°C)	43187	42324	42112	41944	41566	3.54	3.57	3.58	3.59	3.60
62°F(16.7°C)	42469	41619	41411	41246	40874	3.53	3.55	3.56	3.57	3.58
64.4°F(18.0°C)	41990	41150	40944	40780	40413	3.51	3.54	3.55	3.56	3.57

Bolded values were tested. All other values are simulated and for reference only.

Climate 5000 Series - Gen 4

36K Btu Multi Zone Max Performance Outdoor Unit



Heating Performance - Indoor Dry Bulb Temperature at 2029 CFM (Non-Ducted)										
Outdoor DB(°F)	TC□Total Heating Capacity(BTU/hr)					PI□Power Input(kW)				
	Indoor Conditions(DB °F)					Indoor Conditions(DB °F)				
	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)
-22°F(-30.0°C)	22559	22108	21997	21909	21712	4.55	4.59	4.60	4.61	4.63
-13°F(-25.0°C)	28763	28188	28047	27934	27683	4.77	4.81	4.82	4.83	4.85
-4°F(-20.0°C)	35285	34580	34407	34269	33961	5.25	5.29	5.30	5.31	5.33
0°F(-17.8°C)	36011	35291	35115	34974	34660	5.12	5.17	5.18	5.19	5.21
5°F(-15.0°C)	36919	36181	36000	35856	35533	4.97	5.01	5.02	5.03	5.05
14°F(-10.0°C)	41341	40514	40312	40151	39789	4.36	4.40	4.41	4.41	4.43
17°F(-8.3°C)	42815	41959	41749	41582	41208	4.16	4.19	4.20	4.21	4.23
22°F(-5.6°C)	42586	41734	41526	41359	40987	4.15	4.18	4.19	4.20	4.21
27°F(-2.8°C)	42357	41509	41302	41137	40766	4.13	4.17	4.18	4.18	4.20
32°F(0.0°C)	42127	41285	41078	40914	40546	4.12	4.15	4.16	4.17	4.19
35°F(1.7°C)	41990	41150	40944	40780	40413	4.11	4.15	4.16	4.16	4.18
37°F(2.8°C)	42808	41952	41742	41575	41201	4.05	4.08	4.09	4.10	4.11
42°F(5.6°C)	44855	43958	43738	43563	43171	3.88	3.92	3.92	3.93	3.95
44.6°F(7.0°C)	45674	44761	44537	44359	43959	3.82	3.85	3.86	3.86	3.88
47°F(8.3°C)	46902	45964	45734	45552	45142	3.72	3.75	3.76	3.77	3.78
52°F(11.1°C)	45869	44952	44727	44548	44147	3.67	3.70	3.71	3.72	3.73
57°F(13.9°C)	44836	43939	43719	43544	43153	3.63	3.66	3.67	3.67	3.69
59°F(15.0°C)	44422	43534	43316	43143	42755	3.61	3.64	3.65	3.65	3.67
62°F(16.7°C)	43802	42926	42712	42541	42158	3.58	3.61	3.62	3.63	3.64
64.4°F(18.0°C)	43389	42521	42309	42140	41760	3.56	3.59	3.60	3.61	3.62

Bolded values were tested. All other values are simulated and for reference only.