

Climate 5000 Series - Gen 4

48K BTU Multi Zone Max Performance Outdoor Unit

Engineering
Submittal
Sheet



BOSCH

Overview and Project Information



Project name

Location

Architect

Engineer

General contractor

Reference #

Date

48K Btu Multi Zone Max Performance Outdoor Unit

Outdoor part number

8-733-962-702

Outdoor model number

BMS500-AAM048-1CSXHD

Efficiency Data

Ducted

Non-Ducted

Mixed Ducted & Non-Ducted

SEER2

20.4

23

21.7

EER2

11.7

12

11.85

HSPF2 (Region IV)

11

11

11.0

HSPF2 (Region V)

9

9

9.0

COP(47°F)

3.52

3.7

3.6

COP (5°F)

2.0

2.0

2.0

Performance Data

Ducted

Non-Ducted

Mixed Ducted & Non-Ducted

Cooling

Capacity Range (Btu/h)

12000~57000

12000~57000

12000~57000

Rated Capacity (Btu/h)

47000

47000

47000

Current (A)

17.9

17.3

17.6

Input Power (W)

4020

3917

3968.5

Heating

Capacity Range (Btu/h)

13000~60000

13000~57000

13000~58500

Rated Capacity (47°F)

48000

49000

48500

Capacity (5°F)

48000

47000

47500

Current (A)

17.5

17.3

17.4

Input Power (W)

4000

3881

3940.5

Operation Range

ODU	Cooling (°F / °C)	-22~122 / -30~50
	Heating (°F / °C)	-22~75 / -30~24

Electrical Data

Power supply (V / Ø / Hz)	208-230 / 1 / 60
Min. circuit ampacity (A)	43
Max. fuse (A)	45

Compressor Data

Type:	Twin-Rotary
Refrigerant oil /oil charge (ml)	VG75 / 1300
Input (W)	3430
Rated current (A)	7.3

Climate 5000 Series - Gen 4

48K Btu Multi Zone Max Performance Outdoor Unit



BOSCH

Piping	
Refrigerant precharge (ft / m)	24.6(7.5)x6
Refrigerant charge (oz / kg)	151.68 / 4.3
Liquid side (in / mm)	6x1/4in / 6x6.35mm
Gas side (in / mm)	4x3/8in+2x1/2in / 4x9.52mm+2x12.7mm
Additional Charge of Refrigerant - liquid side (oz/ft)/(g/m)	0.16 / 15
Additional Charge of Refrigerant - gas side (oz/ft)/(g/m)	0.32 / 30
Max. refrigerant pipe length (ft / m)	262.4 / 80
Max. length to one IDU (ft / m)	114.8 / 35
Max. height difference between IDU and ODU (ft / m)	49.2 / 15
Max. height difference between IDU's (ft / m)	33 / 10

System Data		
Refrigerant type		R454B
Design pressure (PSIG)		550 / 340
Dehumidification (L/hr)		9.3
ODU	Fan motor model #	ZKFN-85-10-1L
	Fan motor qty (ea)	2
	Fan motor input (W)	126
	Fan motor speed, H / M / L (RPM)	800 / 700 / 650
	Air flow, max (CFM)	4502.8
	Noise level, max (dB(A))	65
	Net weight (lbs / kg)	246.47 / 111.8
IDU	Gross weight (lbs / kg)	276.68 / 125.5
	Minimum # of indoors	1
	Maximum # of indoors	6

Multi Zone Pairing Information	1 ZONE	2 ZONE	3 ZONE			4 ZONE		
BMS500-AAM048-1CSXHD	30	6+24	6+6+18	9+9+9	12+12+36	6+6+6+6	6+9+12+18	9+9+18+24
	36	6+30	6+6+24	9+9+12	12+18+18	6+6+6+9	6+9+12+24	9+12+12+12
		6+36	6+6+30	9+9+18	12+18+24	6+6+6+12	6+9+18+18	9+12+12+18
		9+18	6+6+36	9+9+24	12+18+30	6+6+6+18	6+9+18+24	9+12+12+24
		9+24	6+9+9	9+9+30	12+18+36	6+6+6+24	6+12+12+12	9+12+18+18
		9+30	6+9+12	9+9+36	18+18+18	6+6+9+9	6+12+12+18	9+12+18+24
		9+36	6+9+18	9+12+12		6+6+9+12	6+12+12+24	9+18+18+18
		12+12	6+9+24	9+12+18		6+6+9+18	6+12+18+18	12+12+12+12
		12+18	6+9+30	9+12+24		6+6+9+24	6+12+18+24	12+12+12+18
		12+24	6+9+36	9+12+30		6+6+12+12	6+18+18+18	12+12+12+24
		12+30	6+12+12	9+12+36		6+6+12+18	6+18+18+24	12+12+18+18
		12+36	6+12+18	9+18+18		6+6+12+24	9+9+9+9	12+12+18+24
		18+18	6+12+24	9+18+24		6+6+18+18	9+9+9+12	12+18+18+18
		18+24	6+12+30	9+18+30		6+6+18+24	9+9+9+18	
		18+30	6+12+36	9+18+36		6+9+9+9	9+9+9+24	
		18+36	6+18+18	12+12+12		6+9+9+12	9+9+12+12	
		24+24	6+18+24	12+12+18		6+9+9+18	9+9+12+18	
		24+30	6+18+30	12+12+24		6+9+9+24	9+9+12+24	
		24+36	6+18+36	12+12+30		6+9+12+12	9+9+18+18	
Capacities	Wall Mounted - 6K to 36K Cassette/Ducted - 9K to 24K							

Climate 5000 Series - Gen 4

48K Btu Multi Zone Max Performance Outdoor Unit




5 ZONE				6 ZONE			
6+6+6+6+6	6+6+9+12+18	6+9+9+18+24	9+9+9+18+18	6+6+6+6+6+6	6+6+6+12+12+12	6+9+9+9+9+24	9+9+9+12+12+18
6+6+6+6+9	6+6+9+12+24	6+9+12+12+12	9+9+9+18+24	6+6+6+6+6+9	6+6+6+12+12+18	6+9+9+9+12+12	9+9+12+12+12+12
6+6+6+6+12	6+6+9+18+18	6+9+12+12+18	9+9+12+12+12	6+6+6+6+6+12	6+6+6+12+12+24	6+9+9+9+12+18	9+9+12+12+12+18
6+6+6+6+18	6+6+9+18+24	6+9+12+12+24	9+9+12+12+18	6+6+6+6+6+18	6+6+9+9+9+9	6+9+9+9+12+24	9+12+12+12+12+12
6+6+6+6+24	6+6+12+12+12	6+9+12+18+18	9+9+12+12+24	6+6+6+6+6+24	6+6+9+9+9+12	6+9+9+12+12+12	12+12+12+12+12+12
6+6+6+9+9	6+6+12+12+18	6+9+12+18+24	9+9+12+18+18	6+6+6+6+9+9	6+6+9+9+9+18	6+9+9+12+12+18	
6+6+6+9+12	6+6+12+12+24	6+9+18+18+18	9+9+12+18+24	6+6+6+6+9+12	6+6+9+9+9+24	6+9+9+12+12+24	
6+6+6+9+18	6+6+12+18+18	6+12+12+12+12	9+9+18+18+18	6+6+6+6+9+18	6+6+9+9+12+12	6+9+12+12+12+12	
6+6+6+9+24	6+6+12+18+24	6+12+12+12+18	9+12+12+12+12	6+6+6+6+9+24	6+6+9+9+12+18	6+9+12+12+12+18	
6+6+6+12+12	6+6+18+18+18	6+12+12+12+24	9+12+12+12+18	6+6+6+6+12+12	6+6+9+9+12+24	6+12+12+12+12+12	
6+6+6+12+18	6+6+18+18+24	6+12+12+18+18	9+12+12+12+24	6+6+6+6+12+18	6+6+9+12+12+12	6+12+12+12+12+18	
6+6+6+12+24	6+9+9+9+9	6+12+18+18+18	9+12+12+18+18	6+6+6+6+12+24	6+6+9+12+12+18	9+9+9+9+9+9	
6+6+6+18+18	6+9+9+9+12	9+9+9+9+9	12+12+12+12+12	6+6+6+9+9+9	6+6+9+12+12+24	9+9+9+9+9+12	
6+6+6+18+24	6+9+9+9+18	9+9+9+9+12	12+12+12+12+18	6+6+6+9+9+12	6+6+12+12+12+12	9+9+9+9+9+18	
6+6+9+9+9	6+9+9+9+24	9+9+9+9+18	12+12+12+12+24	6+6+6+9+9+18	6+6+12+12+12+18	9+9+9+9+9+24	
6+6+9+9+12	6+9+9+12+12	9+9+9+9+24	12+12+12+18+18	6+6+6+9+9+24	6+6+12+12+12+24	9+9+9+9+12+12	
6+6+9+9+18	6+9+9+12+18	9+9+9+12+12		6+6+6+9+12+12	6+9+9+9+9+9	9+9+9+9+12+18	
6+6+9+9+24	6+9+9+12+24	9+9+9+12+18		6+6+6+9+12+18	6+9+9+9+9+12	9+9+9+9+12+24	
6+6+9+12+12	6+9+9+18+18	9+9+9+12+24		6+6+6+9+12+24	6+9+9+9+9+18	9+9+9+12+12+12	
Wall Mounted - 6K to 36K Cassette/Ducted - 9K to 24K							

Climate 5000 Series - Gen 4
48K Btu Multi Zone Max Performance Outdoor Unit



Outdoor Unit Dimensions and Connections

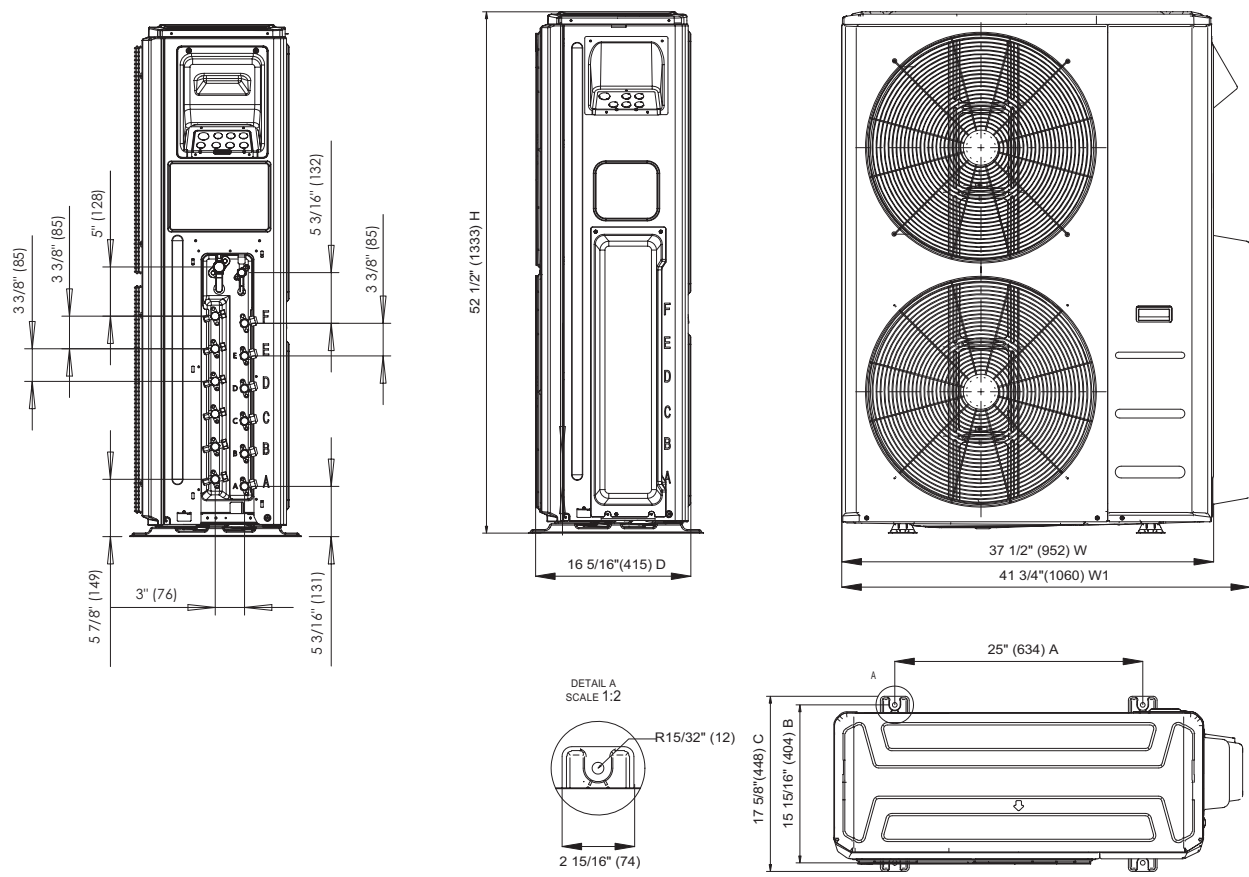

Model	W (in)	D (in)	H (in)
BMS500-AAM048-1CSXHD	37.48	16.34	52.48

Climate 5000 Series - Gen 4

48K Btu Multi Zone Max Performance Outdoor Unit


BOSCH

Cooling Performance - Indoor Dry Bulb Temperature at 1618 CFM (Ducted)																					
ODU DB(°F)	IDU WB (°F)	60.8°F(16.0°C)					64.4°F(18.0°C)					67°F(19.4°C)					71.6°F(22.0°C)				
	IDU DB (°F)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)
-22°F (-30.0°C)	TC	44473	44532	44580	44582	44642	47153	47209	47255	47265	47321	49970	50035	50091	50100	50156	52981	53038	53096	53104	53170
	S/T	0.60	0.71	0.80	0.80	0.91	0.57	0.67	0.76	0.76	0.86	0.53	0.63	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.77
	PI	2.89	2.89	2.90	2.90	2.90	3.06	3.07	3.07	3.07	3.08	3.25	3.25	3.26	3.26	3.26	3.44	3.45	3.45	3.45	3.46
-13°F (-25.0°C)	TC	48179	48243	48295	48298	48363	51082	51143	51193	51203	51264	54134	54204	54265	54275	54335	57396	57458	57521	57530	57601
	S/T	0.61	0.72	0.82	0.82	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.73	0.73	0.83	0.51	0.60	0.68	0.68	0.78
	PI	3.00	3.00	3.01	3.01	3.01	3.18	3.18	3.19	3.19	3.19	3.37	3.37	3.38	3.38	3.38	3.57	3.58	3.58	3.58	3.58
-4°F (-20.0°C)	TC	51885	51954	52010	52013	52083	55012	55077	55131	55142	55207	58298	58374	58439	58450	58515	61811	61878	61945	61955	62032
	S/T	0.62	0.73	0.83	0.83	0.94	0.59	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.70	0.70	0.79
	PI	3.10	3.11	3.11	3.11	3.12	3.29	3.30	3.30	3.30	3.30	3.49	3.49	3.50	3.50	3.50	3.70	3.70	3.71	3.71	3.71
0°F (-17.8°C)	TC	53532	53604	53662	53664	53736	56758	56825	56881	56892	56960	60149	60227	60294	60305	60373	63773	63842	63912	63922	64001
	S/T	0.63	0.73	0.84	0.84	0.95	0.59	0.69	0.79	0.79	0.90	0.56	0.65	0.74	0.74	0.85	0.53	0.62	0.70	0.70	0.80
	PI	3.15	3.16	3.16	3.16	3.16	3.34	3.35	3.35	3.35	3.35	3.54	3.55	3.55	3.55	3.56	3.76	3.76	3.76	3.76	3.77
5°F (-15.0°C)	TC	55591	55666	55725	55728	55803	58941	59011	59069	59081	59151	62462	62543	62613	62625	62695	66226	66298	66370	66380	66463
	S/T	0.63	0.74	0.84	0.84	0.96	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81
	PI	3.21	3.22	3.22	3.22	3.22	3.41	3.41	3.41	3.41	3.42	3.61	3.61	3.62	3.62	3.62	3.83	3.83	3.83	3.84	3.84
14°F (-10.0°C)	TC	57773	57850	57913	57915	57993	61254	61327	61387	61399	61472	64914	64998	65071	65083	65155	68825	68900	68975	68985	69071
	S/T	0.62	0.73	0.83	0.83	0.94	0.59	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.69	0.69	0.79
	PI	3.22	3.22	3.23	3.23	3.23	3.41	3.42	3.42	3.42	3.43	3.62	3.62	3.63	3.63	3.63	3.84	3.84	3.84	3.84	3.85
17°F (-8.3°C)	TC	58500	58578	58642	58644	58723	62025	62099	62160	62172	62246	65731	65816	65890	65902	65975	69691	69767	69843	69854	69941
	S/T	0.62	0.72	0.82	0.82	0.94	0.58	0.68	0.78	0.78	0.88	0.55	0.64	0.73	0.73	0.83	0.52	0.61	0.69	0.69	0.79
	PI	3.22	3.23	3.23	3.23	3.23	3.42	3.42	3.42	3.42	3.43	3.62	3.62	3.63	3.63	3.63	3.84	3.84	3.85	3.85	3.85
23°F (-5.0°C)	TC	57345	57422	57484	57487	57564	60801	60873	60933	60945	61018	64434	64517	64589	64601	64674	68316	68390	68465	68475	68561
	S/T	0.61	0.72	0.81	0.81	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.72	0.72	0.83	0.51	0.60	0.68	0.68	0.78
	PI	3.29	3.29	3.30	3.30	3.30	3.49	3.49	3.50	3.50	3.50	3.70	3.70	3.71	3.71	3.71	3.92	3.92	3.93	3.93	3.93
35°F (1.7°C)	TC	55036	55111	55170	55172	55247	58353	58422	58480	58492	58561	61840	61920	61989	62000	62070	65565	65637	65708	65718	65800
	S/T	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.76
	PI	3.43	3.43	3.43	3.43	3.44	3.63	3.64	3.64	3.64	3.65	3.85	3.85	3.86	3.86	3.86	4.08	4.09	4.09	4.09	4.10
41°F (5.0°C)	TC	54955	55028	55088	55090	55164	58266	58335	58393	58405	58474	61747	61828	61897	61908	61977	65468	65539	65610	65621	65702
	S/T	0.61	0.72	0.82	0.82	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.73	0.73	0.83	0.51	0.60	0.69	0.69	0.78
	PI	3.47	3.47	3.47	3.47	3.48	3.67	3.68	3.68	3.68	3.69	3.89	3.90	3.90	3.90	3.91	4.13	4.13	4.14	4.14	4.14
47°F (8.3°C)	TC	54873	54946	55006	55008	55082	58180	58248	58306	58317	58387	61655	61735	61804	61816	61885	65370	65441	65513	65523	65604
	S/T	0.63	0.73	0.83	0.83	0.95	0.59	0.69	0.79	0.79	0.90	0.56	0.65	0.74	0.74	0.85	0.53	0.62	0.70	0.70	0.80
	PI	3.51	3.51	3.51	3.51	3.52	3.72	3.72	3.72	3.72	3.73	3.94	3.94	3.95	3.95	3.95	4.18	4.18	4.19	4.19	4.19
50°F (10.0°C)	TC	54370	54443	54502	54505	54578	57647	57715	57772	57784	57852	61091	61170	61239	61250	61318	64772	64842	64913	64923	65004
	S/T	0.62	0.73	0.82	0.82	0.94	0.58	0.68	0.78	0.78	0.89	0.55	0.65	0.73	0.73	0.84	0.52	0.61	0.69	0.69	0.79
	PI	3.59	3.60	3.60	3.60	3.60	3.81	3.81	3.82	3.82	3.82	4.03	4.04	4.04	4.05	4.05	4.28	4.28	4.29	4.29	4.29
59°F (15.0°C)	TC	52864	52935	52992	52994	53066	56049	56116	56171	56182	56249	59398	59475	59542	59553	59619	62977	63045	63114	63124	63202
	S/T	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.76
	PI	3.85	3.85	3.86	3.86	3.86	4.08	4.08	4.09	4.09	4.09	4.32	4.33	4.33	4.33	4.34	4.58	4.59	4.59	4.59	4.60
68°F (20.0°C)	TC	51357	51426	51481	51484	51553	54452	54516	54570	54581	54646	57705	57780	57844	57855	57920	61182	61248	61315	61325	61401
	S/T	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.72	0.72	0.83	0.51	0.60	0.68	0.68	0.78	0.48	0.57	0.65	0.65	0.74
	PI	4.10	4.11	4.11	4.11	4.12	4.35	4.36	4.36	4.36	4.37	4.61	4.62	4.62	4.62	4.63	4.89	4.89	4.90	4.90	4.91
77°F (25.0°C)	TC	49850	49917	49971	49973	50041	52854	52917	52969	52980	53043	56012	56085	56147	56158	56221	59387	59452	59516	59526	59600
	S/T	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.70	0.70	0.80	0.49	0.58	0.66	0.66	0.75	0.47	0.55	0.62	0.62	0.71
	PI	4.36	4.37	4.37	4.37	4.38	4.62	4.63	4.63	4.63	4.64	4.90	4.91	4.91	4.91	4.92	5.19	5.20	5.21	5.21	5.22
82°F (27.8°C)	TC	49534	49601	49654	49656	49723	52519	52581	52633	52644	52706	55657	55729	55791	55802	55864	59010	59075	59139	59148	59222
	S/T	0.56	0.66	0.75	0.75	0.85	0.53	0.62	0.70	0.70	0.80	0.50	0.58	0.66	0.66	0.76	0.47	0.55	0.63	0.63	0.71
	PI	4.53	4.54	4.54	4.54	4.55	4.81	4.81	4.82	4.82	4.82	5.09	5.10	5.11	5.11	5.11	5.40	5.41	5.41	5.41	5.42
86°F (30.0°C)	TC	49939	50006	50060	50062	50130	52948	53011	53063	53074	53137	56112	56185	56247	56258	56320	59492	59557	59622	59631	59706
	S/T	0.58	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.69	0.69	0.79	0.49	0.58	0.65	0.65	0.75
	PI	4.71	4.72	4.72	4.72	4.73	4.99	5.00	5.01	5.01	5.01	5.29	5.30	5.31	5.31	5.31	5.61	5.62	5.62	5.62	5.63
95°F (35.0°C)	TC	50849																			

Climate 5000 Series - Gen 4

48K Btu Multi Zone Max Performance Outdoor Unit


BOSCH

Cooling Performance - Indoor Dry Bulb Temperature at 2206 CFM (Non-Ducted)

ODU DB(°F)	IDU WB (°F)	60.8°F(16.0°C)					64.4°F(18.0°C)					67°F(19.4°C)					71.6°F(22.0°C)				
		73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)	73.4°F (23.0°C)	77.0°F (25.0°C)	80.0°F (26.7°C)	80.6°F (27.0°C)	84.2°F (29.0°C)
-22°F (-30.0°C)	TC	42834	42892	42938	42940	42998	45416	45469	45514	45523	45577	48129	48191	48245	48254	48308	51029	51084	51140	51148	51212
	S/T	0.60	0.71	0.80	0.80	0.91	0.57	0.67	0.76	0.76	0.86	0.53	0.63	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.77
	PI	2.72	2.73	2.73	2.73	2.73	2.89	2.89	2.89	2.89	2.90	3.06	3.06	3.07	3.07	3.07	3.24	3.25	3.25	3.25	3.26
-13°F (-25.0°C)	TC	46404	46466	46516	46518	46581	49200	49258	49307	49317	49375	52140	52207	52266	52275	52334	55281	55341	55401	55410	55479
	S/T	0.61	0.72	0.82	0.82	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.73	0.73	0.83	0.51	0.60	0.68	0.68	0.78
	PI	2.82	2.83	2.83	2.83	2.83	2.99	3.00	3.00	3.00	3.00	3.17	3.18	3.18	3.18	3.18	3.36	3.37	3.37	3.37	3.38
-4°F (-20.0°C)	TC	49973	50040	50094	50097	50164	52985	53048	53100	53110	53174	56150	56223	56286	56296	56359	59534	59598	59663	59672	59747
	S/T	0.62	0.73	0.83	0.83	0.94	0.59	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.70	0.70	0.79
	PI	2.92	2.93	2.93	2.93	2.94	3.10	3.10	3.11	3.11	3.11	3.29	3.29	3.29	3.29	3.30	3.48	3.49	3.49	3.49	3.50
0°F (-17.8°C)	TC	51560	51629	51685	51687	51757	54667	54732	54786	54797	54862	57933	58008	58073	58084	58148	61424	61490	61557	61567	61643
	S/T	0.63	0.73	0.84	0.84	0.95	0.59	0.69	0.79	0.79	0.90	0.56	0.65	0.74	0.74	0.85	0.53	0.62	0.70	0.70	0.80
	PI	2.97	2.97	2.98	2.98	2.98	3.15	3.15	3.15	3.16	3.16	3.34	3.34	3.34	3.34	3.35	3.54	3.54	3.54	3.55	3.55
5°F (-15.0°C)	TC	53543	53615	53672	53675	53747	56769	56837	56893	56904	56972	60161	60239	60306	60318	60385	63786	63855	63925	63935	64014
	S/T	0.63	0.74	0.84	0.84	0.96	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81
	PI	3.03	3.03	3.03	3.03	3.04	3.21	3.21	3.21	3.21	3.22	3.40	3.40	3.41	3.41	3.41	3.60	3.61	3.61	3.61	3.62
14°F (-10.0°C)	TC	55894	55969	56029	56032	56108	59262	59333	59391	59403	59473	62803	62885	62955	62966	63037	66587	66659	66732	66742	66826
	S/T	0.62	0.73	0.83	0.83	0.94	0.59	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.69	0.69	0.79
	PI	2.95	2.96	2.96	2.96	2.96	3.13	3.14	3.14	3.14	3.14	3.32	3.32	3.33	3.33	3.33	3.52	3.52	3.53	3.53	3.53
17°F (-8.3°C)	TC	56678	56754	56815	56818	56894	60093	60165	60224	60236	60307	63684	63766	63837	63849	63921	67521	67594	67668	67678	67763
	S/T	0.62	0.72	0.82	0.82	0.94	0.58	0.68	0.78	0.78	0.88	0.55	0.64	0.73	0.73	0.83	0.52	0.61	0.69	0.69	0.79
	PI	2.93	2.93	2.94	2.94	2.94	3.11	3.11	3.11	3.11	3.12	3.29	3.30	3.30	3.30	3.30	3.49	3.49	3.50	3.50	3.50
23°F (-5.0°C)	TC	55464	55538	55598	55601	55676	58806	58876	58934	58946	59016	62320	62401	62470	62482	62551	66074	66146	66218	66229	66311
	S/T	0.61	0.72	0.81	0.81	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.72	0.72	0.83	0.51	0.60	0.68	0.68	0.78
	PI	3.07	3.07	3.08	3.08	3.08	3.26	3.26	3.26	3.26	3.27	3.45	3.45	3.46	3.46	3.46	3.66	3.66	3.67	3.67	3.67
35°F (1.7°C)	TC	53036	53107	53164	53167	53238	56232	56298	56354	56365	56432	59591	59669	59735	59746	59813	63182	63251	63319	63329	63408
	S/T	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.76
	PI	3.35	3.36	3.36	3.36	3.36	3.55	3.56	3.56	3.56	3.57	3.77	3.77	3.78	3.78	3.78	3.99	4.00	4.00	4.00	4.01
41°F (5.0°C)	TC	54354	54427	54486	54488	54561	57629	57698	57755	57766	57835	61072	61152	61220	61231	61300	64752	64823	64893	64903	64984
	S/T	0.61	0.72	0.82	0.82	0.93	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.73	0.73	0.83	0.51	0.60	0.69	0.69	0.78
	PI	3.36	3.37	3.37	3.37	3.38	3.57	3.57	3.58	3.58	3.58	3.78	3.79	3.79	3.79	3.79	3.99	4.01	4.01	4.02	4.02
47°F (8.3°C)	TC	55672	55747	55807	55809	55885	59027	59097	59155	59167	59237	62554	62635	62705	62716	62786	66323	66395	66467	66477	66560
	S/T	0.63	0.73	0.83	0.83	0.95	0.59	0.69	0.79	0.79	0.90	0.56	0.65	0.74	0.74	0.85	0.53	0.62	0.70	0.70	0.80
	PI	3.38	3.38	3.39	3.39	3.39	3.58	3.59	3.59	3.59	3.59	3.80	3.80	3.80	3.81	3.81	4.02	4.03	4.03	4.03	4.04
50°F (10.0°C)	TC	54797	54870	54929	54932	55006	58099	58168	58225	58237	58306	61570	61650	61719	61730	61799	65280	65351	65422	65432	65514
	S/T	0.62	0.73	0.82	0.82	0.94	0.58	0.68	0.78	0.78	0.89	0.55	0.65	0.73	0.73	0.84	0.52	0.61	0.69	0.69	0.79
	PI	3.45	3.45	3.46	3.46	3.46	3.66	3.66	3.66	3.66	3.67	3.87	3.88	3.88	3.88	3.89	4.11	4.11	4.12	4.12	4.12
59°F (15.0°C)	TC	52171	52241	52297	52299	52370	55315	55380	55435	55446	55512	58619	58696	58761	58772	58837	62151	62219	62287	62296	62374
	S/T	0.60	0.70	0.80	0.80	0.91	0.56	0.66	0.75	0.75	0.86	0.53	0.62	0.71	0.71	0.81	0.50	0.59	0.67	0.67	0.76
	PI	3.66	3.66	3.67	3.67	3.67	3.88	3.88	3.89	3.89	3.89	4.11	4.12	4.12	4.12	4.13	4.36	4.36	4.37	4.37	4.38
68°F (20.0°C)	TC	49545	49611	49665	49667	49734	52530	52593	52644	52655	52717	55669	55741	55803	55814	55876	59023	59087	59151	59161	59234
	S/T	0.58	0.68	0.77	0.77	0.88	0.54	0.64	0.72	0.72	0.83	0.51	0.60	0.68	0.68	0.78	0.48	0.57	0.65	0.65	0.74
	PI	3.87	3.88	3.88	3.88	3.89	4.10	4.11	4.11	4.11	4.12	4.35	4.36	4.36	4.36	4.37	4.61	4.62	4.62	4.62	4.63
77°F (25.0°C)	TC	46918	46982	47032	47034	47098	49746	49805	49854	49864	49923	52718	52787	52845	52855	52914	55894	55955	56016	56025	56095
	S/T	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.70	0.70	0.80	0.49	0.58	0.66	0.66	0.75	0.47	0.55	0.62	0.62	0.71
	PI	4.08	4.09	4.09	4.09	4.10	4.33	4.33	4.34	4.34	4.34	4.59	4.59	4.60	4.60	4.60	4.86	4.87	4.87	4.87	4.88
82°F (27.8°C)	TC	46677	46740	46790	46793	46856	49490	49549	49598	49608	49667	52447	52515	52574	52584	52642	55607	55668	55728	55737	55806
	S/T	0.56	0.66	0.75	0.75	0.85	0.53	0.62	0.70	0.70	0.80	0.50	0.58	0.66	0.66	0.76	0.47	0.55	0.63	0.63	0.71
	PI	4.24	4.24	4.25	4.25	4.25	4.49	4.50	4.50	4.50	4.51	4.76	4.77	4.77	4.77	4.78	5.05	5.05	5.06	5.06	5.07
86°F (30.0°C)	TC	48021	48086	48138	48140	48205	50915	50975	51026	51036	51096	53957	54027	54087	54097	54158	57208	57270	57333	57342	57413
	S/T	0.58	0.69	0.78	0.78	0.89	0.55	0.65	0.74	0.74	0.84	0.52	0.61	0.69	0.69	0.79	0.49	0.58	0.65	0.65	0.75
	PI	4.41	4.41	4.42	4.42	4.42	4.67	4.68	4.68	4.68	4.69	4.95	4.96	4.96	4.96	4.97	5.25	5.26	5.26	5.26	5.27
95°F (35.0°C)	TC	51045	51113	51168	51171	51240	5														

Climate 5000 Series - Gen 4

48K Btu Multi Zone Max Performance Outdoor Unit



Heating Performance - Indoor Dry Bulb Temperature at 1618 CFM (Ducted)										
Outdoor DB(°F)	TC Total Heating Capacity(BTU/hr)					PI Power Input(kW)				
	Indoor Conditions(DB °F)					Indoor Conditions(DB °F)				
	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)
-22°F(-30.0°C)	25974	25455	25327	25226	24999	5.73	5.78	5.79	5.80	5.83
-13°F(-25.0°C)	31688	31054	30899	30775	30498	6.01	6.06	6.07	6.08	6.11
-4°F(-20.0°C)	38469	37700	37512	37361	37025	6.15	6.20	6.21	6.22	6.25
0°F(-17.8°C)	44113	43231	43014	42842	42457	6.27	6.32	6.33	6.34	6.37
5°F(-15.0°C)	51167	50144	49893	49693	49246	6.42	6.47	6.48	6.50	6.52
14°F(-10.0°C)	52826	51769	51510	51304	50843	6.42	6.47	6.48	6.50	6.52
17°F(-8.3°C)	53379	52311	52049	51841	51375	6.42	6.47	6.48	6.50	6.52
22°F(-5.6°C)	56902	55764	55485	55263	54766	6.28	6.33	6.34	6.35	6.38
27°F(-2.8°C)	60425	59217	58921	58685	58157	6.14	6.19	6.20	6.21	6.24
32°F(-0.0°C)	63949	62670	62356	62107	61548	6.00	6.05	6.06	6.07	6.10
35°F(1.7°C)	66063	64742	64418	64160	63583	5.92	5.97	5.98	5.99	6.01
37°F(2.8°C)	66112	64789	64466	64208	63630	5.76	5.81	5.82	5.83	5.85
42°F(5.6°C)	66234	64909	64585	64326	63747	5.37	5.41	5.43	5.44	5.46
44.6°F(7.0°C)	66283	64957	64632	64374	63794	5.21	5.26	5.27	5.28	5.30
47°F(8.3°C)	66356	65029	64704	64445	63865	4.98	5.02	5.03	5.04	5.06
52°F(11.1°C)	67272	65927	65597	65335	64747	4.62	4.66	4.67	4.68	4.70
57°F(13.9°C)	68189	66825	66491	66225	65629	4.26	4.29	4.30	4.31	4.33
59°F(15.0°C)	68555	67184	66848	66581	65981	4.12	4.15	4.16	4.17	4.18
62°F(16.7°C)	69105	67723	67384	67115	66511	3.90	3.93	3.94	3.95	3.96
64.4°F(18.0°C)	69471	68082	67742	67471	66863	3.76	3.79	3.79	3.80	3.82

Bolded values were tested. All other values are simulated and for reference only.

Climate 5000 Series - Gen 4

48K Btu Multi Zone Max Performance Outdoor Unit



BOSCH

Heating Performance - Indoor Dry Bulb Temperature at 2206 CFM (Non-Ducted)										
Outdoor DB(°F)	TC Total Heating Capacity(BTU/hr)					PI Power Input(kW)				
	Indoor Conditions(DB °F)					Indoor Conditions(DB °F)				
	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)	60.8°F (16.0°C)	68°F (20.0°C)	70°F (21.1°C)	71.6°F (22.0°C)	75.2°F (24.0°C)
-22°F(-30.0°C)	25370	24862	24738	24639	24417	5.61	5.66	5.67	5.68	5.71
-13°F(-25.0°C)	31284	30659	30505	30383	30110	5.98	6.03	6.04	6.05	6.08
-4°F(-20.0°C)	37116	36374	36192	36047	35723	6.40	6.45	6.46	6.48	6.50
0°F(-17.8°C)	42757	41902	41692	41526	41152	6.33	6.38	6.40	6.41	6.43
5°F(-15.0°C)	49808	48812	48568	48374	47939	6.25	6.30	6.31	6.32	6.35
14°F(-10.0°C)	52124	51081	50826	50622	50167	6.72	6.77	6.79	6.80	6.83
17°F(-8.3°C)	52895	51837	51578	51372	50910	6.87	6.93	6.94	6.96	6.99
22°F(-5.6°C)	54774	53678	53410	53196	52717	6.73	6.79	6.80	6.81	6.84
27°F(-2.8°C)	56652	55519	55241	55020	54525	6.59	6.64	6.65	6.67	6.69
32°F(-0.0°C)	58530	57360	57073	56845	56333	6.44	6.50	6.51	6.52	6.55
35°F(1.7°C)	59657	58464	58172	57939	57418	6.36	6.41	6.42	6.44	6.46
37°F(2.8°C)	59609	58417	58124	57892	57371	6.15	6.20	6.21	6.23	6.25
42°F(5.6°C)	59487	58297	58006	57774	57254	5.64	5.68	5.70	5.71	5.73
44.6°F(7.0°C)	59438	58250	57958	57727	57207	5.43	5.48	5.49	5.50	5.52
47°F(8.3°C)	59366	58178	57887	57656	57137	5.12	5.17	5.18	5.19	5.21
52°F(11.1°C)	59427	58238	57947	57715	57196	4.66	4.70	4.71	4.72	4.73
57°F(13.9°C)	59488	58298	58006	57774	57254	4.19	4.23	4.24	4.25	4.26
59°F(15.0°C)	59512	58322	58030	57798	57278	4.01	4.04	4.05	4.06	4.07
62°F(16.7°C)	59549	58358	58066	57834	57313	3.73	3.76	3.77	3.78	3.79
64.4°F(18.0°C)	59573	58382	58090	57857	57337	3.54	3.57	3.58	3.59	3.60

Bolded values were tested. All other values are simulated and for reference only.