




Revision Dates	
1	08.15.24
2	01.01.25
SHEET TITLE	
Roof / Framing Plan	
Drawing Date	
08.27.26	
Check By	
-	
Drawn By	
FRANCIS N.	
Scale	
As indicated	
Job Number	
022225	
Sheet Number	

NOTES: ROOF DECK SHALL BE SLOPED
MIN. 1/4" PER FOOT
TO ROOF DRAINS. PROVIDE EMERGENCY
OVERFLOW
DRAINS / SCUPPERS PER CRC R903.4.1.

NEW ROOF DECK - CLASS
A
WATERPROOF DECK
SYSTEM

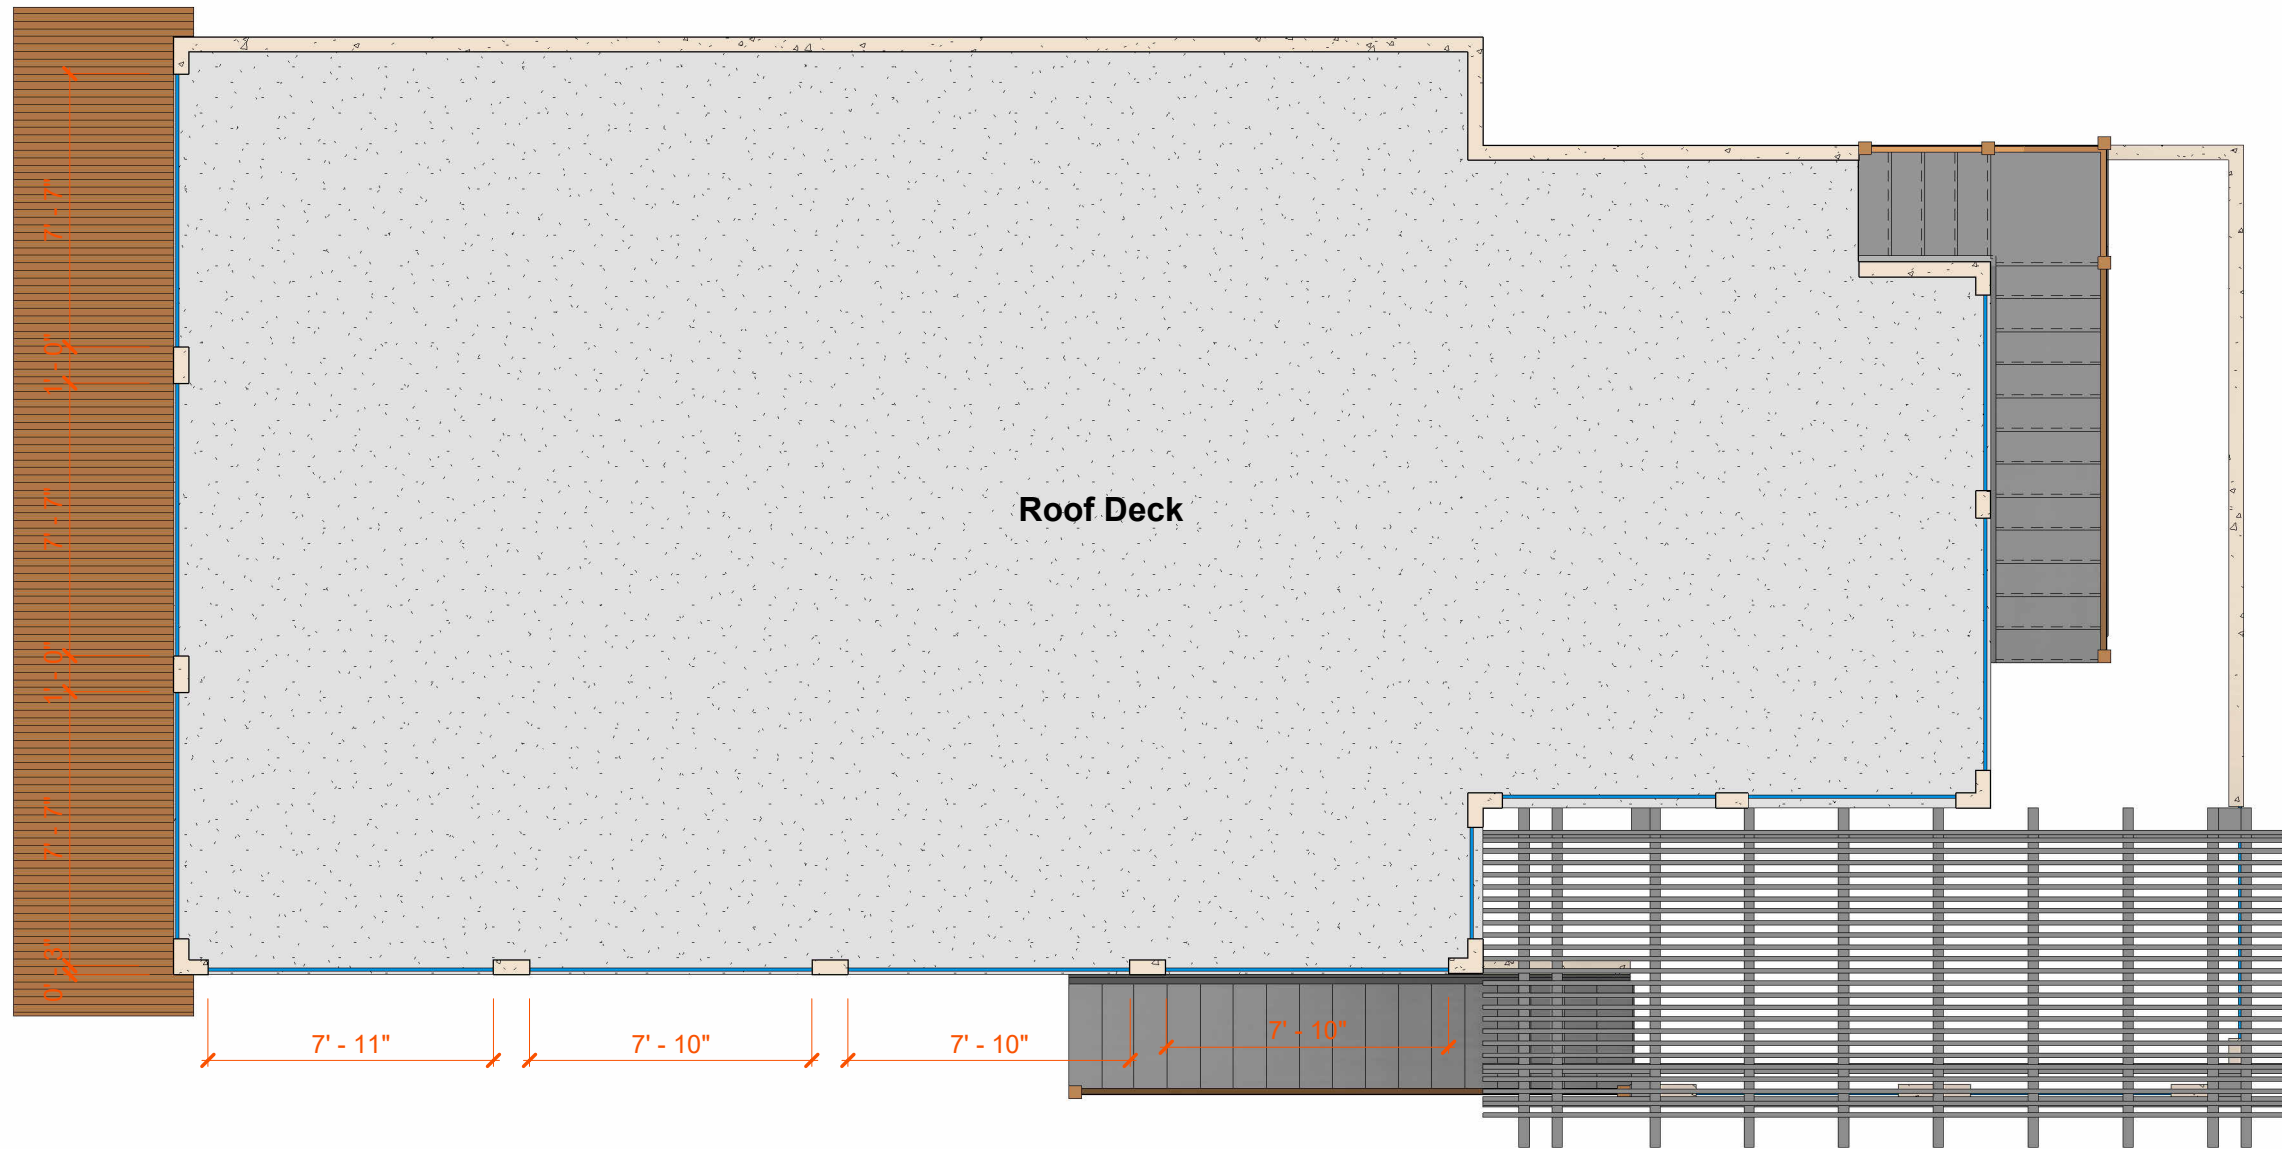


1 Roof Plan

3/16" = 1'-0"

ROOF MATERIALS INFO:
ROOF DECK: CLASS A FIRE-RATED WALKABLE WATERPROOF
DECK SYSTEM (ICC-ES LISTED), INSTALLED PER
MANUFACTURER SPECIFICATION.
SLOPE 1/4" PER FOOT MIN. TO ROOF DRAINS.
PROVIDE OVERFLOW DRAINS / SCUPPERS PER CRC R903.4.1

GUARDRAIL: 42" HIGH MIN. AT ROOF DECK PERIMETER.
OPENINGS SHALL REJECT A 4" SPHERE PER CRC R312.

OPEN WOOD TRELLIS: PER PLAN, PRESSURE TREATED OR
NATURALLY DURABLE WOOD.

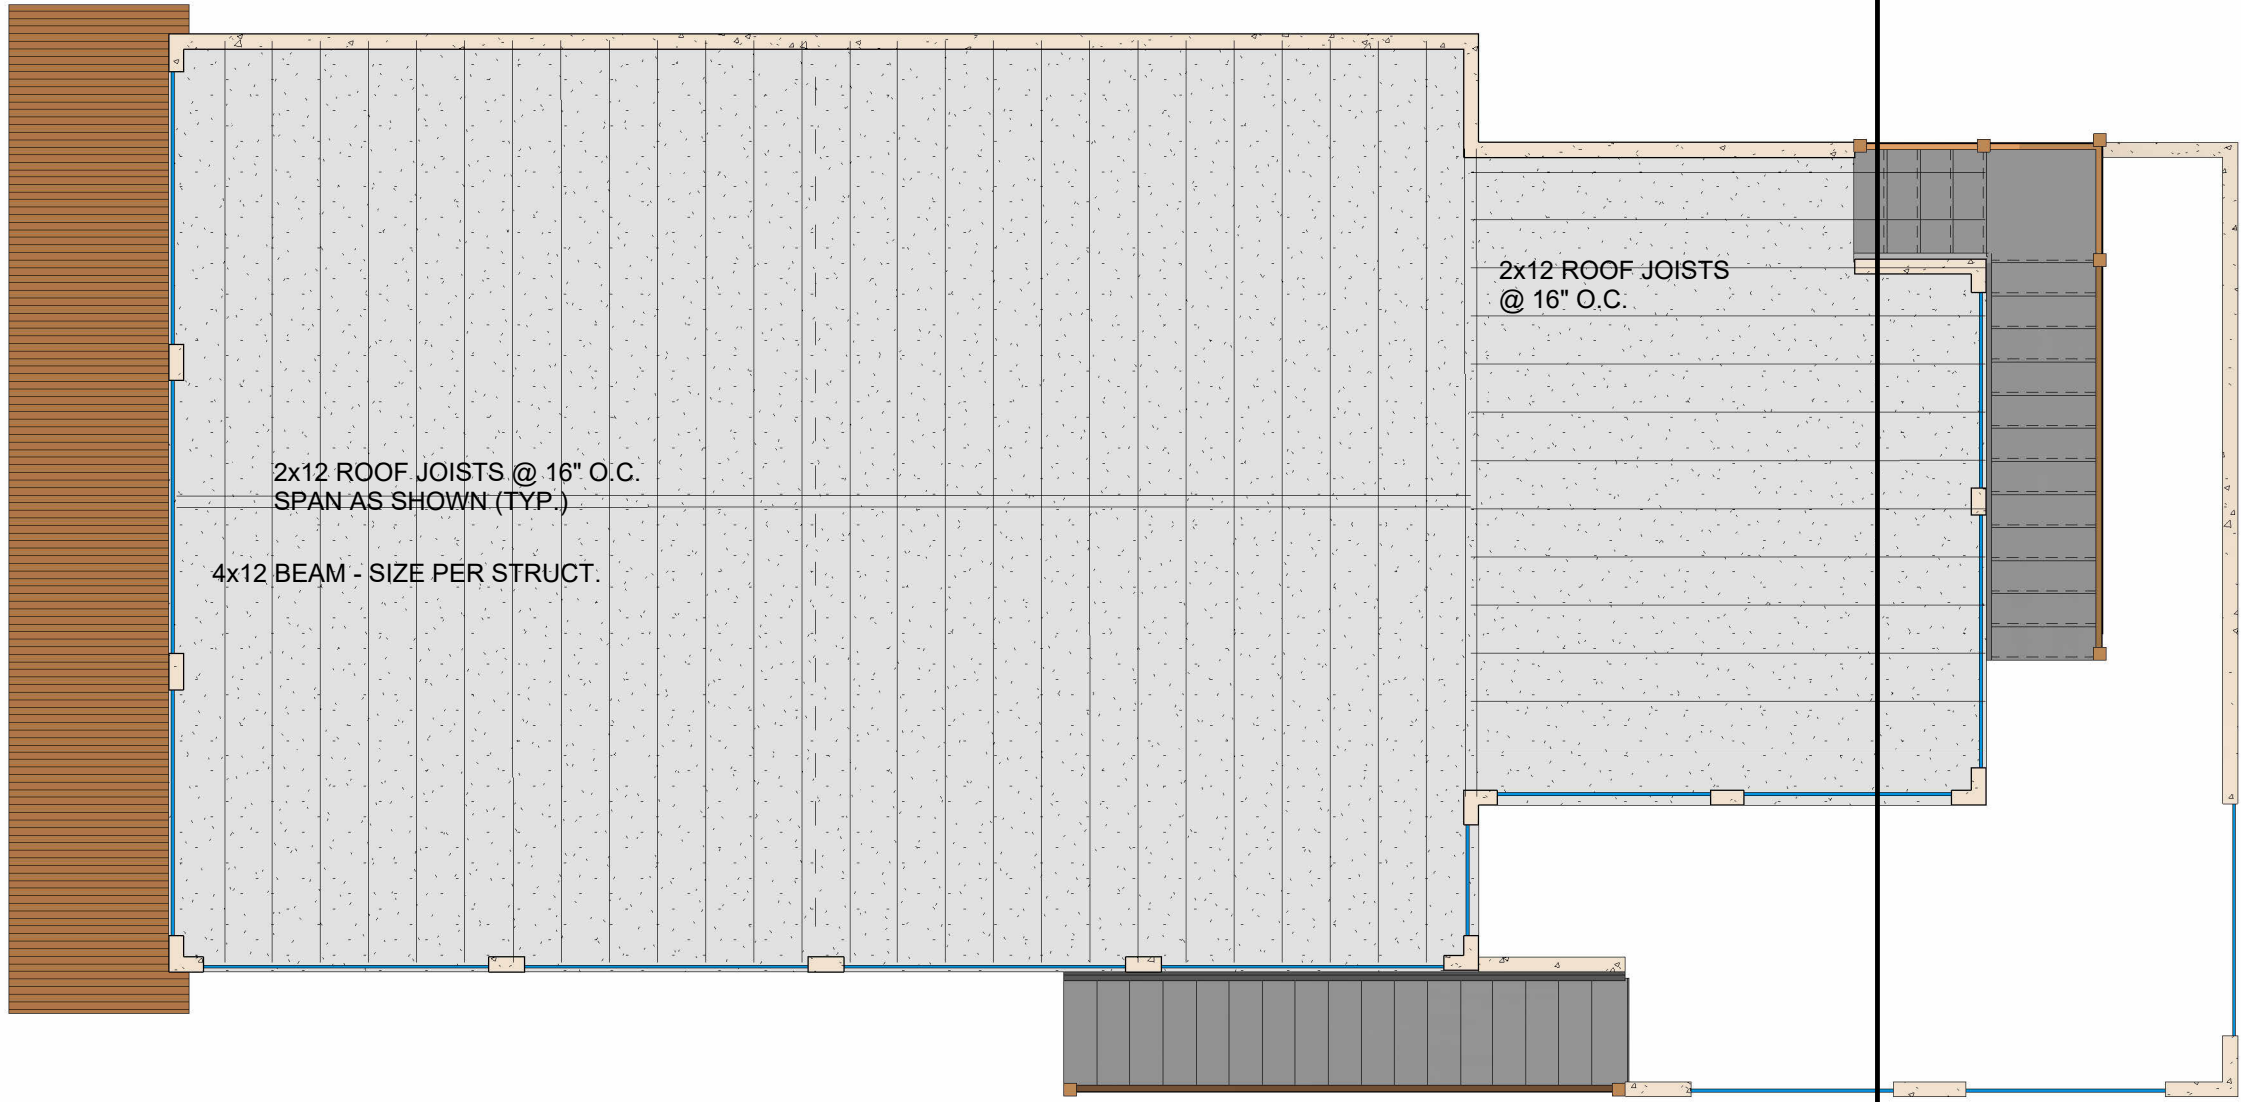

ROOF FRAMING PLAN - ALL MEMBER SIZES, CONNECTIONS, HOLD-DOWNS AND
SHEAR TRANSFER PER STRUCTURAL ENGINEER'S CALCULATIONS.
ROOF DECK SLOPED 1/4" PER FT MIN. TO DRAINS; SEE ROOF PLAN.

2 Roof Framing Plan

3/16" = 1'-0"