

LEGEND:

	NEW WALL
	WALL (INTERIOR) 2x4 WOOD STUD W/ 5/8" GYP. BD. BOTH SIDES
	WALL (EXTERIOR) 2x4 WOOD STUD W/ 5/8" GYP. BD. INSIDE & STUCCO OUT SIDE
	WALL (EXTERIOR) 2x6 WOOD STUD W/ 5/8" GYP. BD. & STUCCO OUT SIDE
	DOOR (NEW)
	DOOR (EXISTING)
	WINDOW (NEW)
	WINDOW (EXISTING)
	SMOKE DETECTOR INTERCONNECTED AND HARD-WIRED WITH BATTERY BACK-UP [CRC R314]
	CARBON MONOXIDE ALARM
	EXHAUST FAN 90 CFM. MIN. 5 AIR CHANGES PER HOUR
	EXTERIOR LIGHT
	W.I.C./W.I.P. WALK-IN CLOSET / WALK-IN PANTRY
	WASHER / DRYER
	22"X30" ATTIC ACCESS

Floor Plan Legend

1/4" = 1'-0"



2 ADU - 2nd Floor Plan

1/4" = 1'-0"

Kitchens: At least half the installed wattage of luminaires in kitchens shall be high efficacy and the ones that are not must be switched separately.

Other Rooms: All luminaires shall either be high efficacy or shall be controlled by an vacancy sensor or dimmer. Closet that are less than 70 square foot are exempt from this requirements.

Outdoor Lighting All luminaires mounted to the building or to other buildings on the same lot shall be high efficacy luminaires or must be controlled by a motion sensor AND controlled by one of these: Photo control or Astronomical time clock or Energy management control system (EMCS).

Permanent vacuum breakers shall be included with all new hose bibs

Provide ultra low flush toilets

All ABS and PVC piping and fittings shall be enclosed within walls and floors covered with "type X gypsum board" or similar assemblies that provide the same level of fire protection. Protection of membrane penetrations is not required.

Per 2013 CGBSC Sec 4.303.2, plumbing fixtures (water closets and urinals) and fittings (faucets and showerheads) shall be installed in accordance with the California Plumbing Code (CPC) and Table 1401.1 of the CPC.

Automatic irrigation system controllers for landscaping provided by the builder and installed at the time of final inspection shall comply with the following:


1. Controllers shall be weather- or soil moisture-based controllers that automatically adjust irrigation in response to changes in plants' needs as weather conditions change.
2. Weather-based controllers without integral rain sensors or communication systems that account for local rainfall shall have a separate wired or wireless rain sensor

Per 2013 Green Code Sec 4. 506. 1 Mechanical exhaust fans which exhaust directly from bathrooms shall comply with the following:

1. Fans shall be ENERGY STAR compliant and be ducted to terminate outside the building.
2. Unless functioning as a component of a whole house ventilation system, fans must be controlled by a humidistat which shall be readily accessible. Humidistat controls shall be capable of adjustment between a relative humidity range of 50 to 80 percent

Floor Plan Notes

1/4" = 1'-0"

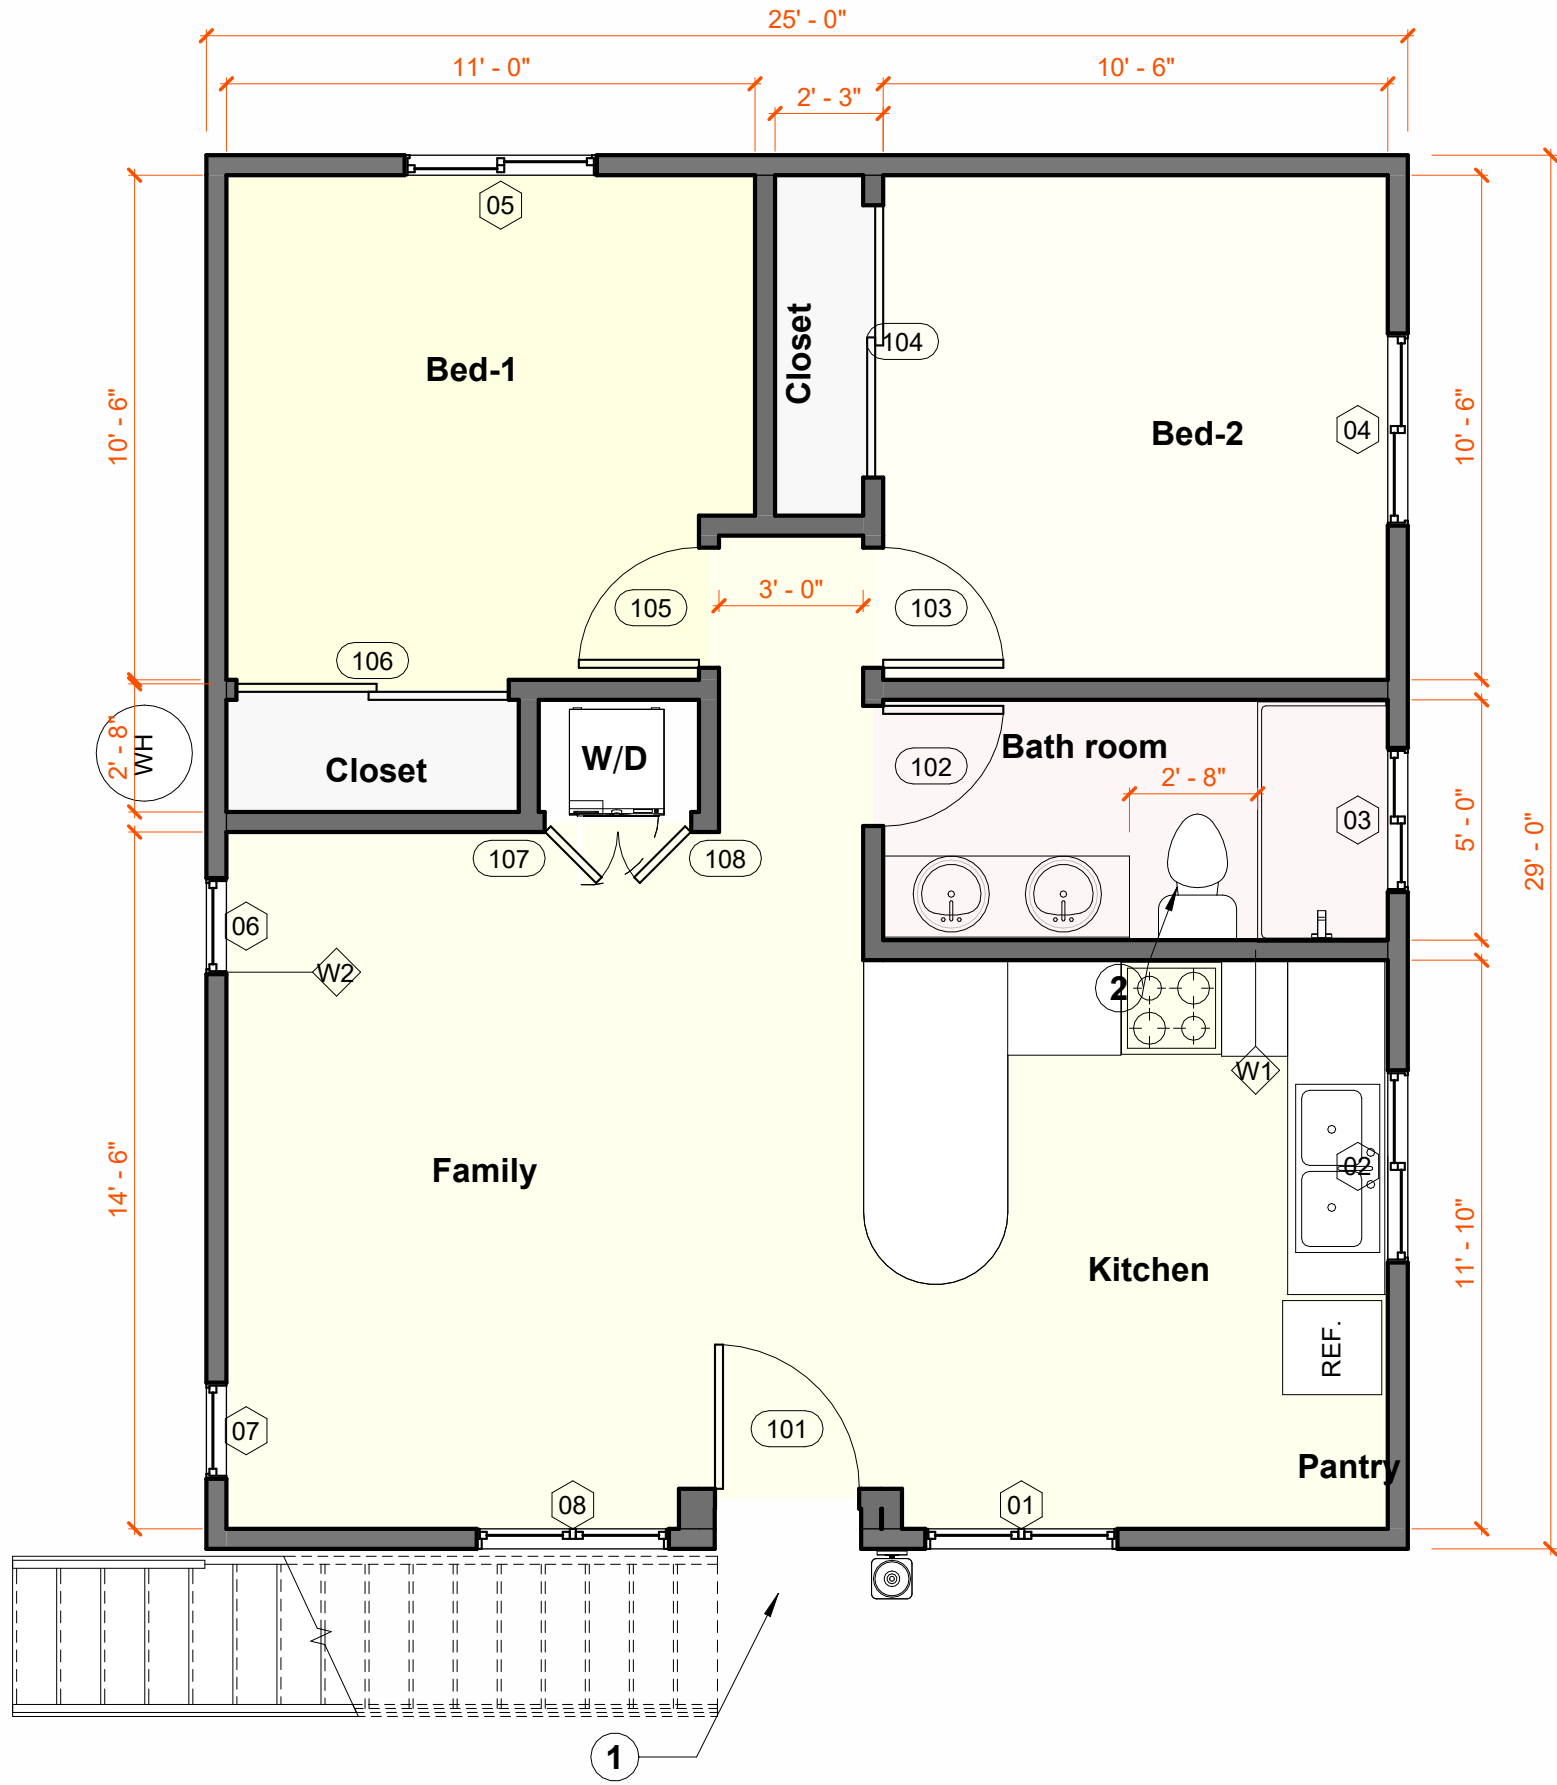

1 ADU - 1st Floor Plan

1/4" = 1'-0"

KEYNOTES

- 1 EXTERIOR LANDING OR FINISHED FLOOR AT THE REQUIRED EGRESS DOORS THAT IS NOT MORE THAN 1 1/2 INCHES BELOW THE TOP OF THE THRESHOLD (NOT MORE THAN 7.75 INCHES IF THE DOOR DOES NOT SWING OVER THE LANDING OR FLOOR). MINIMUM 36" DEEP FLOOR OR LANDING ON EACH SIDE OF EACH EXTERIOR DOOR, WITH A SLOPE NOT EXCEEDING 1/4 UNIT VERTICAL IN 12 UNITS HORIZONTAL (2%). THE WIDTH OF EACH LANDING SHALL NOT BE LESS THAN THE DOOR SERVED. [CRC R311.3].
- 2 AT LEAST ONE BATHROOM ON THE ENTRY LEVEL SHALL BE PROVIDED WITH REINFORCEMENT INSTALLED IN ACCORDANCE WITH THIS SECTION. WHERE THERE IS NO BATHROOM ON THE ENTRY LEVEL, AT LEAST ONE BATHROOM ON THE SECOND OR THIRD FLOOR OF THE DWELLING SHALL COMPLY WITH THIS SECTION. R327.1.1

A. REINFORCEMENT SHALL BE SOLID LUMBER OR OTHER CONSTRUCTION MATERIALS APPROVED BY THE ENFORCING AGENCY.

B. REINFORCEMENT SHALL NOT BE LESS THAN 2 BY 8 INCH (51 MM BY 203 MM) NOMINAL LUMBER, [1 1/2 INCH BY 7 1/4 INCH (38 MM BY 184 MM) ACTUAL DIMENSION] OR OTHER CONSTRUCTION MATERIAL PROVIDING EQUAL HEIGHT AND LOAD CAPACITY. REINFORCEMENT SHALL BE LOCATED BETWEEN 32 INCHES (812.8 MM) AND 39 1/4 INCHES (997 MM) ABOVE THE FINISHED FLOOR FLUSH WITH THE WALL FRAMING.

C. WATER CLOSET REINFORCEMENT SHALL BE INSTALLED ON BOTH SIDE WALLS OF THE FIXTURE, OR ONE SIDE WALL AND THE BACK WALL.

D. SHOWER REINFORCEMENT SHALL BE CONTINUOUS WHERE WALL FRAMING IS PROVIDED.

E. BATHTUB AND COMBINATION BATHTUB/SHOWER REINFORCEMENT SHALL BE CONTINUOUS ON EACH END OF THE BATHTUB AND THE BACK WALL. ADDITIONALLY, BACK WALL REINFORCEMENT FOR A LOWER GRAB BAR SHALL BE PROVIDED WITH THE BOTTOM EDGE LOCATED NO MORE THAN 6 INCHES (152.4 MM) ABOVE THE BATHTUB RIM