
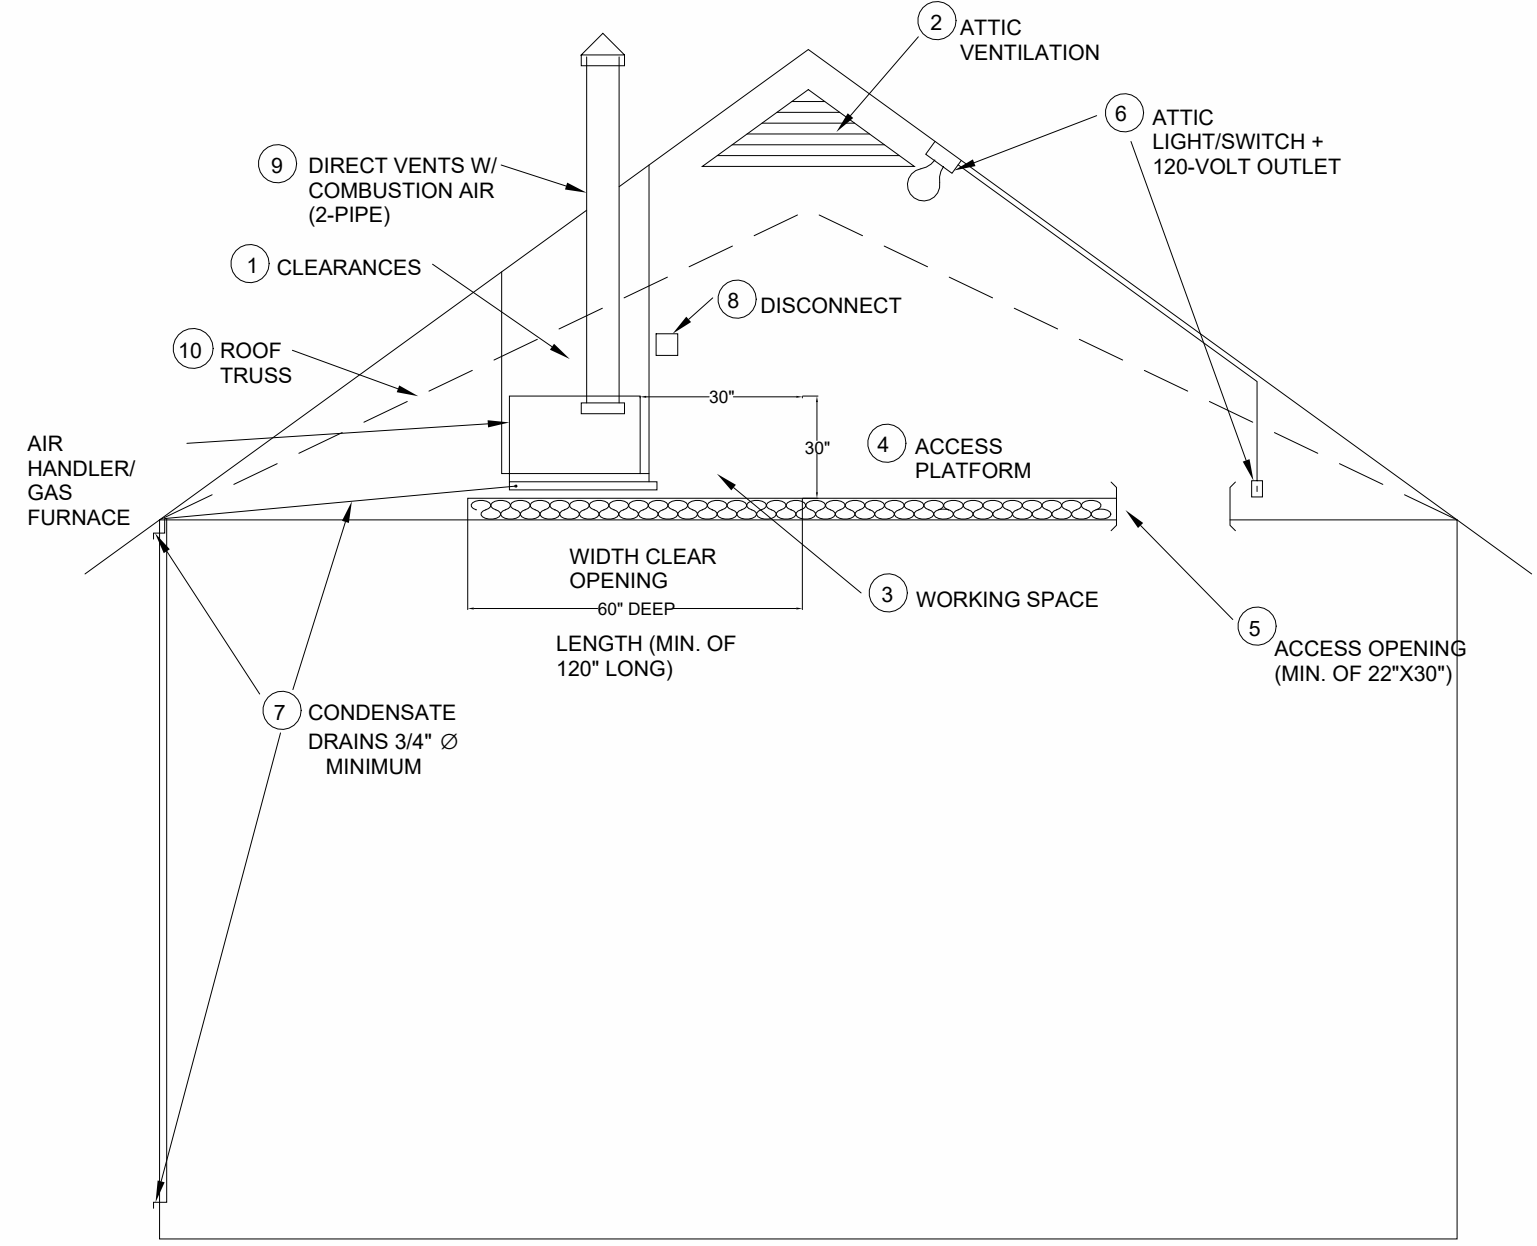
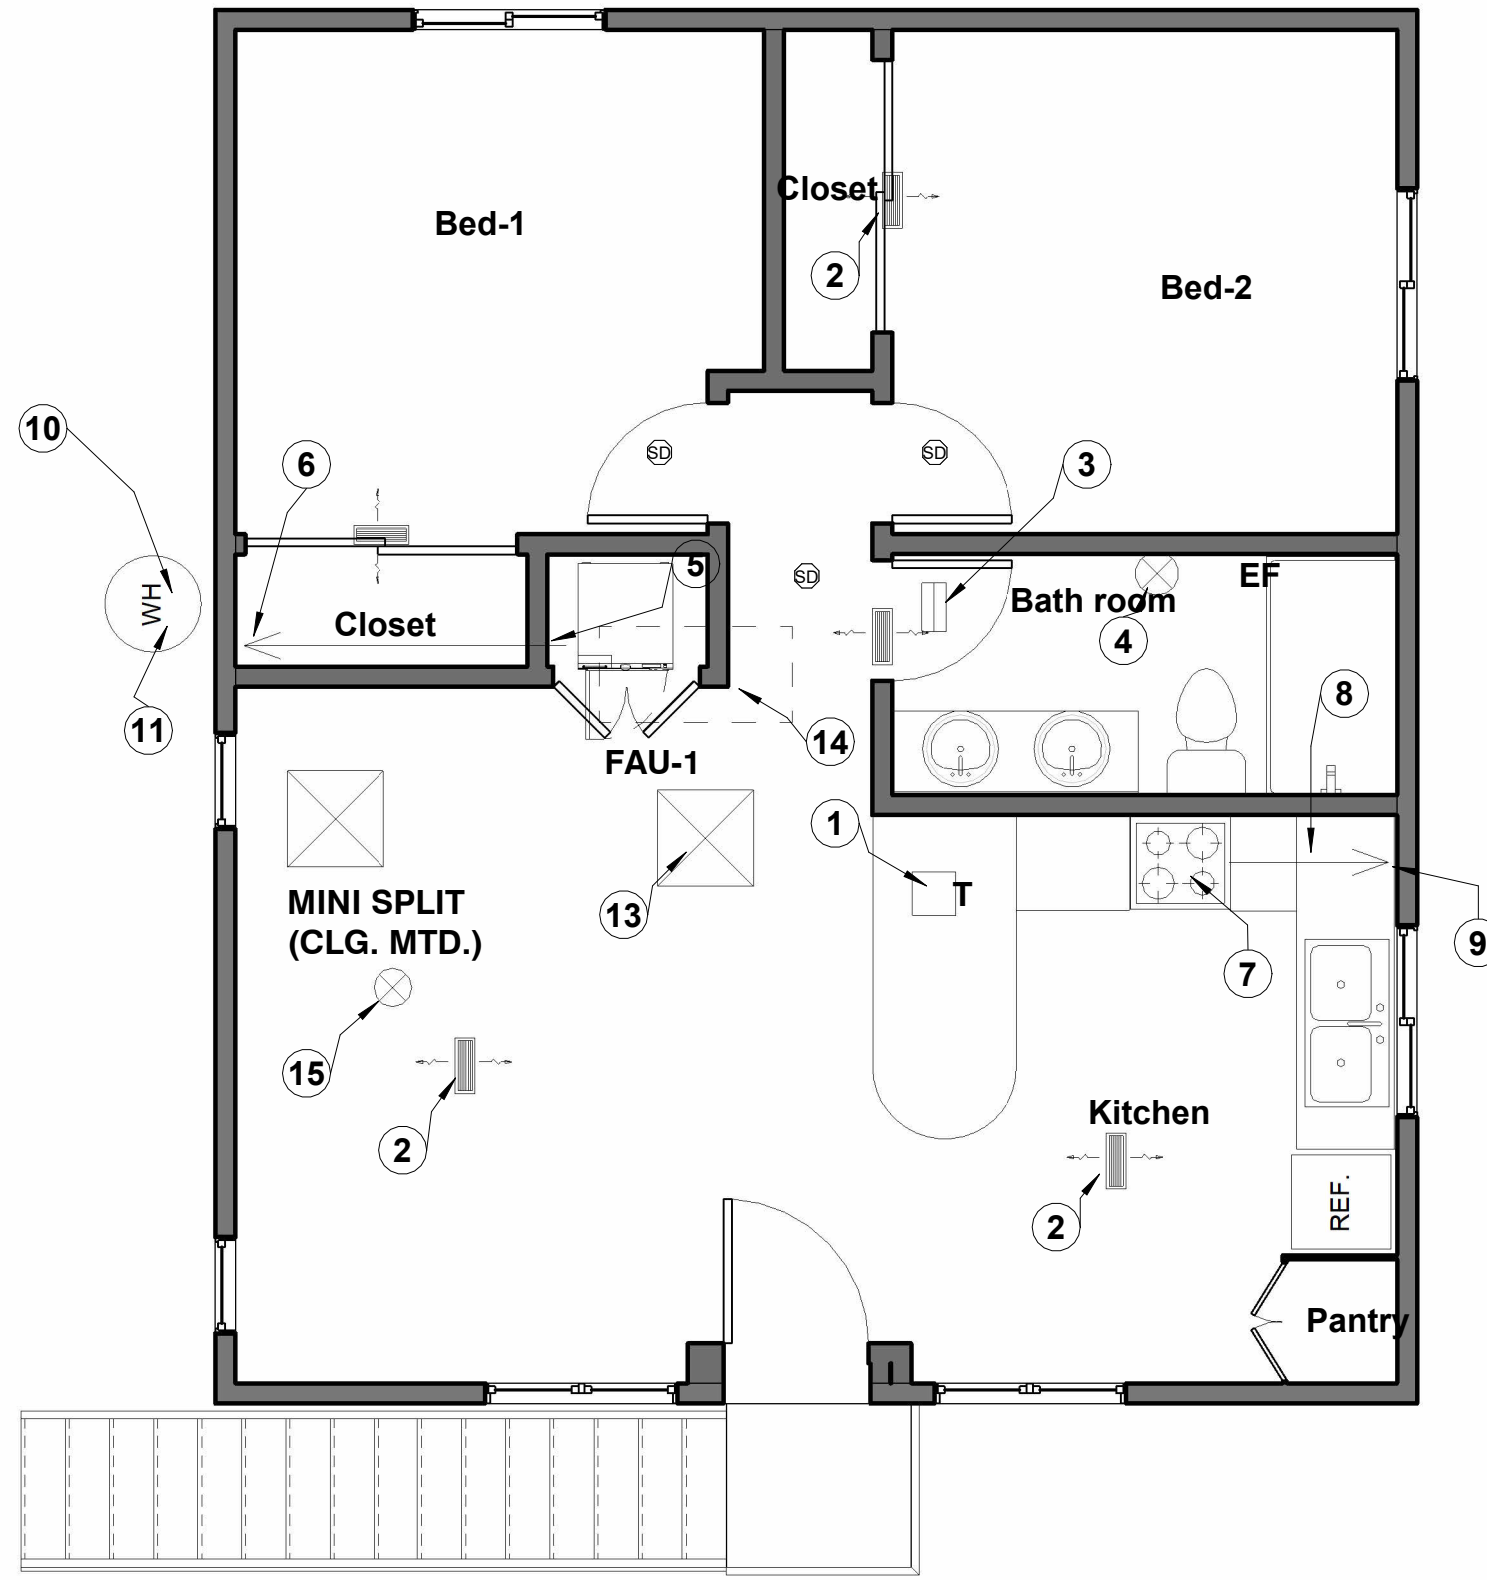


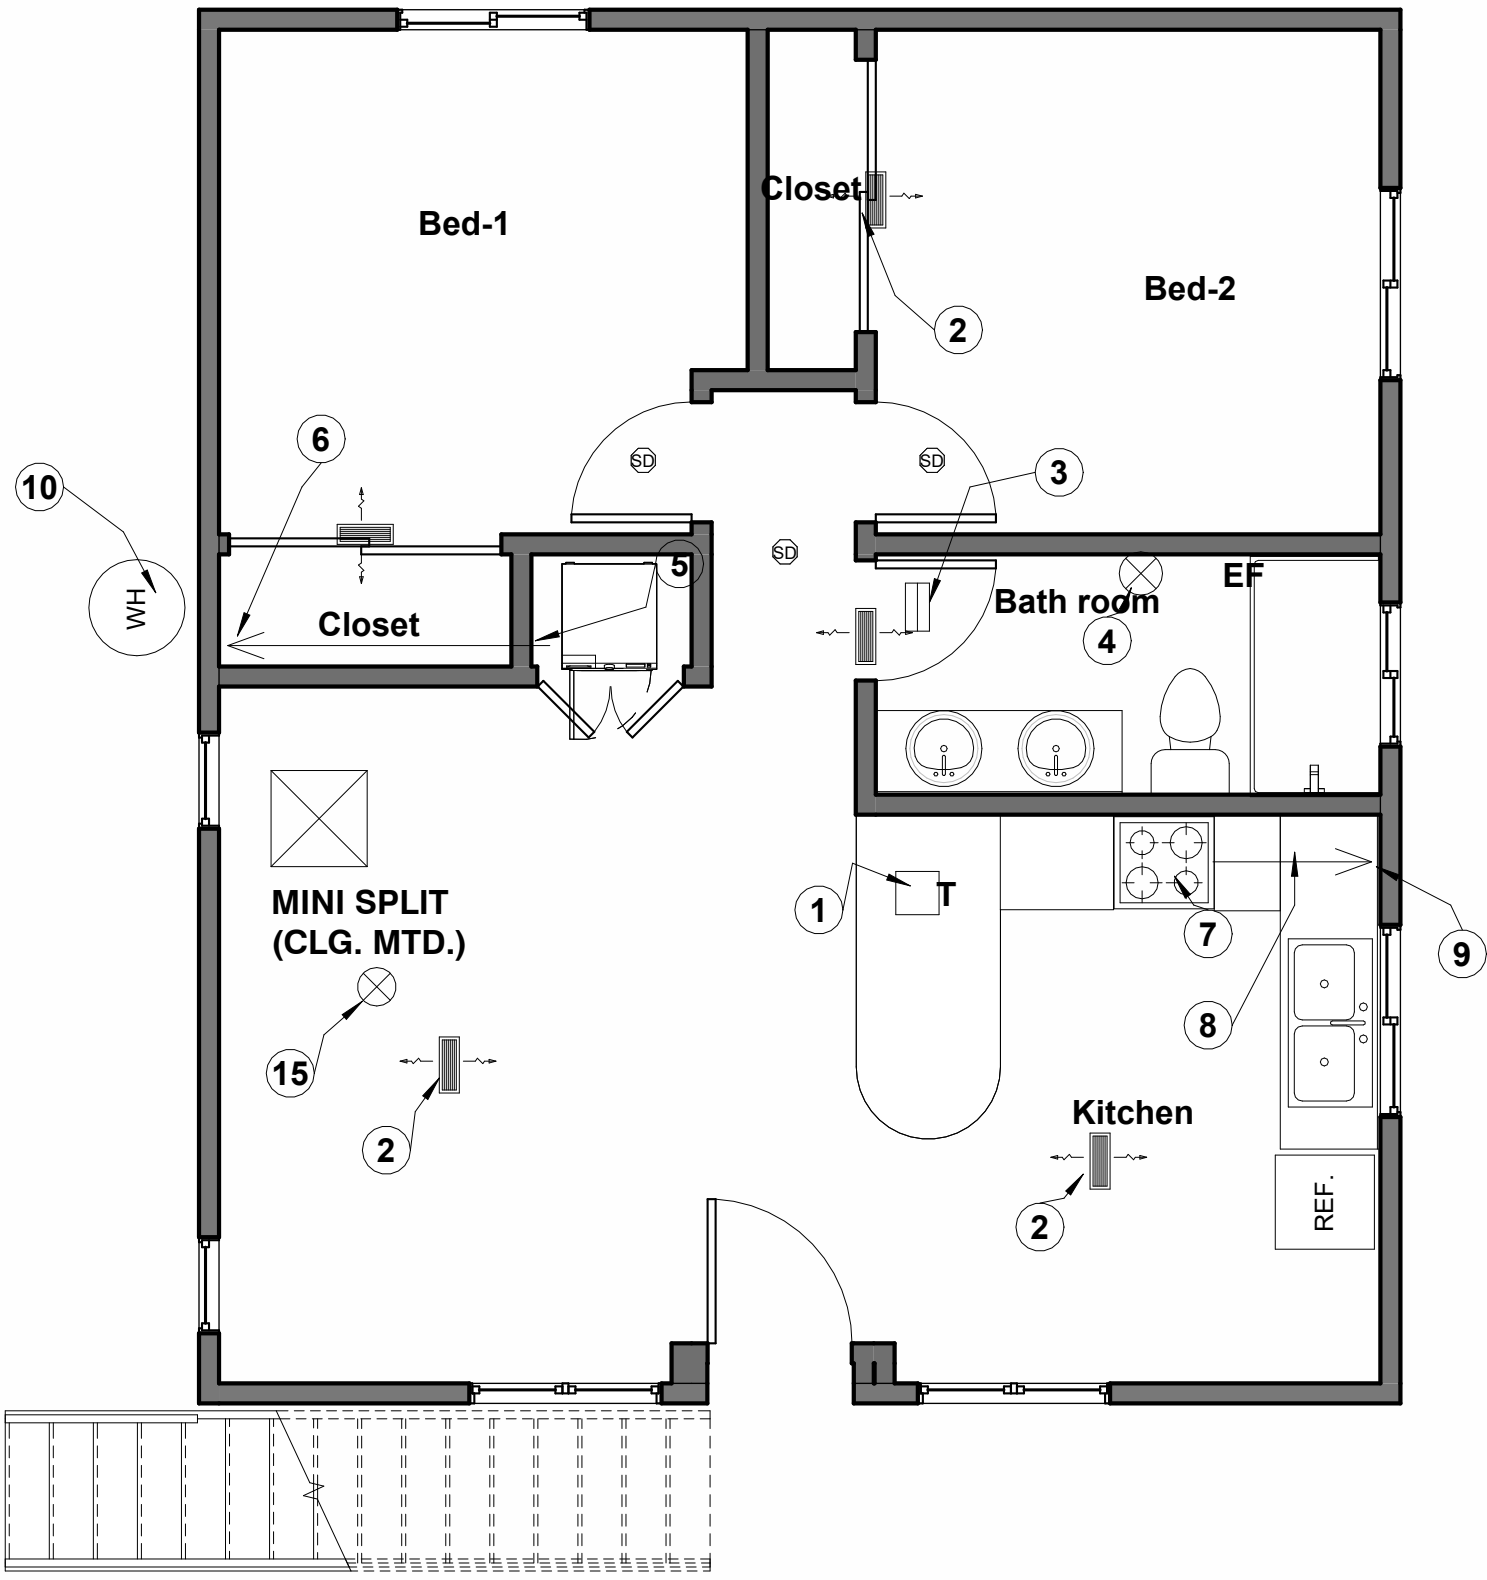

1 ADU- 1st Floor Mechanical Plan

2 ADU- 2nd Floor Mechanical Plan

MECHANICAL KEY NOTES:

- 1 THERMOSTAT MOUNTED AT 5'-0"
- 2 6"x12" CEILING DIFFUSER
- 3 6"x12" WALL DIFFUSER
- 4 CEILING EXHAUST FAN (MIN. OF 75CFM) MIN. OF 4" DIA. DUCTED TO OUTSIDE
- 5 4" DIA. DRYER EXHAUST DUCT TO OUTSIDE - TWO 90 DEG. ELBOWS MAX., 14' MAX. LENGTH
- 6 DRYER EXHAUST DUCT TERMINATION LOCATION
- 7 KITCHEN HOOD EXHAUST FAN (SEE SCHEDULE) MIN. OF 250CFM FOR INTERMITTENT
- 8 6" DIA. KITCHEN EXHAUST DUCT TO OUTSIDE BLDG
- 9 KITCHEN EXHAUST DUCT TERMINATION LOCATION (PROVIDE W/ RAIN CAP)
- 10 WATER HEATER P&T LINE TO OUTSIDE BLDG
- 11 WATER HEATER FLUE VENT TO OUTSIDE BLDG (UP TO ROOF)
- 12 ATTIC ACCESS LOCATION MIN. OF 22"x30" (MIN. 30"x30" IF EQUIPMENT REQUIRES)
- 13 24"x24" REGISTER AIR RETURN GRILLE
- 14 FAU-1 LOCATION IN CEILING ATTIC
- 15 IAQ EF FAN 64CFM

MECHANICAL KEYNOTES

HEATING FURNACE SCHEDULE						
MANUFACTURE	MODEL	HEATING CAPACITY	EFFICIENCY	AIR FLOW	GAS CONNECTION SIZE (INCH)	WEIGHT (LBS)
CARRIER	58MEB04012	40,000	94.4	875	1/2	175

DRYER SCHEDULE							
MARK	DESCRIPTION	MANUFACTURER	Model	LOCATION	DUCT SIZE	FUEL TYPE	DUCT TYPE
DRYER 1	CLOTHES DRYER	LG	DLGX3471W		4" DIA.	GAS	RIGID METAL

Exhaust Fan Schedule									
MARK	DESCRIPTION	LOCATION	MANUFACTURE	MODEL	AIR FLOW (CFM)	SONE	DUCT SIZE	WEIGHT (LBS)	NOTES
EF1	Ceiling Exhaust Fan	Bath room	Broan	QTRE100S	110	1.5	4"	12.6	
EF2	Kitchen Hood Exhaust Fan	Kitchen	Broan	E6436ss	600	1.5	3-1/2"x10"		UL#E17814

WATER HEATER SCHEDULE (HEATPUMP)												
DESCRIPTION	MANUFACTURE	MODEL	CAPACITY	KW	Supply Fitting	Supply Pipe	VOLTAGE	VENT TYPE	DIAMETER	HEIGHT (FT)	RECOVER RATE	ENERGY FACTOR
WATER HEATER	AO SMITH	FPTU 50 120	50 GAL	4.5	3/4"	1"	208/240V	PVC	22"	5' - 3"		