

Revision Dates	
1	08.15.24
2	01.01.25

1	
2	
3	
4	

SHEET TITLE
Floor Plan

Drawing Date
08.16.23

Check By
-

Drawn By
Francis N.

Scale
As indicated

Job Number
081623

Sheet Number

A101

LEGEND:

	NEW WALL
	WALL (INTERIOR) 2x4 WOOD STUD W/ 5/8" GYP. BD. BOTH SIDES
	WALL (EXTERIOR) 2x4 WOOD STUD W/ 5/8" GYP. BD. INSIDE & STUCCO OUT SIDE
	WALL (EXTERIOR) 2x6 WOOD STUD W/ 5/8" GYP. BD. & STUCCO OUT SIDE
	DOOR (NEW)
	DOOR (EXISTING)
	WINDOW (NEW)
	WINDOW (EXISTING)
	SMOKE DETECTOR INTERCONNECTED AND HARD-WIRED WITH BATTERY BACK-UP [CRC R314]
	CARBON MONOXIDE ALARM
	EXHAUST FAN 90 CFM. MIN. 5 AIR CHANGES PER HOUR
	EXTERIOR LIGHT
	WALK-IN CLOSET / WALK-IN PANTRY
	WASHER / DRYER
	22"X30" ATTIC ACCESS

KEYNOTES

- EXTERIOR LANDING OR FINISHED FLOOR AT THE REQUIRED EGRESS DOORS THAT IS NOT MORE THAN 1 1/2 INCHES BELOW THE TOP OF THE THRESHOLD (NOT MORE THAN 7.75 INCHES IF THE DOOR DOES NOT SWING OVER THE LANDING OR FLOOR). MINIMUM 36" DEEP FLOOR OR LANDING ON EACH SIDE OF EACH EXTERIOR DOOR, WITH A SLOPE NOT EXCEEDING 1/4 UNIT VERTICAL IN 12 UNITS HORIZONTAL (2%). THE WIDTH OF EACH LANDING SHALL NOT BE LESS THAN THE DOOR SERVED. [CRC R311.3].
- AT LEAST ONE BATHROOM ON THE ENTRY LEVEL SHALL BE PROVIDED WITH REINFORCEMENT INSTALLED IN ACCORDANCE WITH THIS SECTION. WHERE THERE IS NO BATHROOM ON THE ENTRY LEVEL, AT LEAST ONE BATHROOM ON THE SECOND OR THIRD FLOOR OF THE DWELLING SHALL COMPLY WITH THIS SECTION. R327.1.1


- A. REINFORCEMENT SHALL BE SOLID LUMBER OR OTHER CONSTRUCTION MATERIALS APPROVED BY THE ENFORCING AGENCY.
- B. REINFORCEMENT SHALL NOT BE LESS THAN 2 BY 8 INCH (51 MM BY 203 MM) NOMINAL LUMBER. [11/2 INCH BY 71/4 INCH (38 MM BY 184 MM) ACTUAL DIMENSION] OR OTHER CONSTRUCTION MATERIAL PROVIDING EQUAL HEIGHT AND LOAD CAPACITY. REINFORCEMENT SHALL BE LOCATED BETWEEN 32 INCHES (812.8 MM) AND 391/4 INCHES (997 MM) ABOVE THE FINISHED FLOOR FLUSH WITH THE WALL FRAMING.
- C. WATER CLOSET REINFORCEMENT SHALL BE INSTALLED ON BOTH SIDE WALLS OF THE FIXTURE, OR ONE SIDE WALL AND THE BACK WALL.
- D. SHOWER REINFORCEMENT SHALL BE CONTINUOUS WHERE WALL FRAMING IS PROVIDED.
- E. BATHTUB AND COMBINATION BATHTUB/SHOWER REINFORCEMENT SHALL BE CONTINUOUS ON EACH END OF THE BATHTUB AND THE BACK WALL. ADDITIONALLY, BACK WALL REINFORCEMENT FOR A LOWER GRAB BAR SHALL BE PROVIDED WITH THE BOTTOM EDGE LOCATED NO MORE THAN 6 INCHES (152.4 MM) ABOVE THE BATHTUB RIM

TABLE 4.303.2	
FIXTURE TYPE	MAXIMUM FLOW RATE AT 20% REDUCTION
SHOWERHEADS	2 GPM @80PSI
LAVATORY FAUCETS, RESIDENTIAL	1.5 GPM @ 60 PSI (SHALL NOT HAVE FLOW RATE LESS THAN 0.8 GPM AT 20PSI)
KITCHEN FAUCETS	1.8 GPM @ 60 PSI
GRAVITY TANK-TYPEWATER CLOSETS	1.28 GAL/FLUSH
SINGLE FLUSH TOILETS	NOT EXCEED 1.28 GAL (4.8 LITERS)
DUAL FLUSH TOILETS	NOT EXCEED 1.28 GAL (4.8 LITERS)

NOTE: ALL PLUMBING FIXTURES AND FITTINGS WILL BE WATER CONSERVING AND WILL COMPLY WITH THE 2013 CGBSC SEC. 4.303.1


THE MINIMUM SIZE OF ATTIC ACCESS MAY BE 22X30 INCHES IF THE LARGEST PIECE OF EQUIPMENT CAN BE MOVED THROUGH THE OPENING

ALL ABS AND PVC PIPING AND FITTINGS SHALL ENCLOSED WITHIN WALLS AND FLOORS COVERED WITH TYPE X GYP. BD. OR SIMILAR ASSEMBLIES THAT PROVIDE THE SAME LEVEL OF FIRE PROTECTION OF MEMBRANCE PENETRATIONS IS NOT REQUIRED

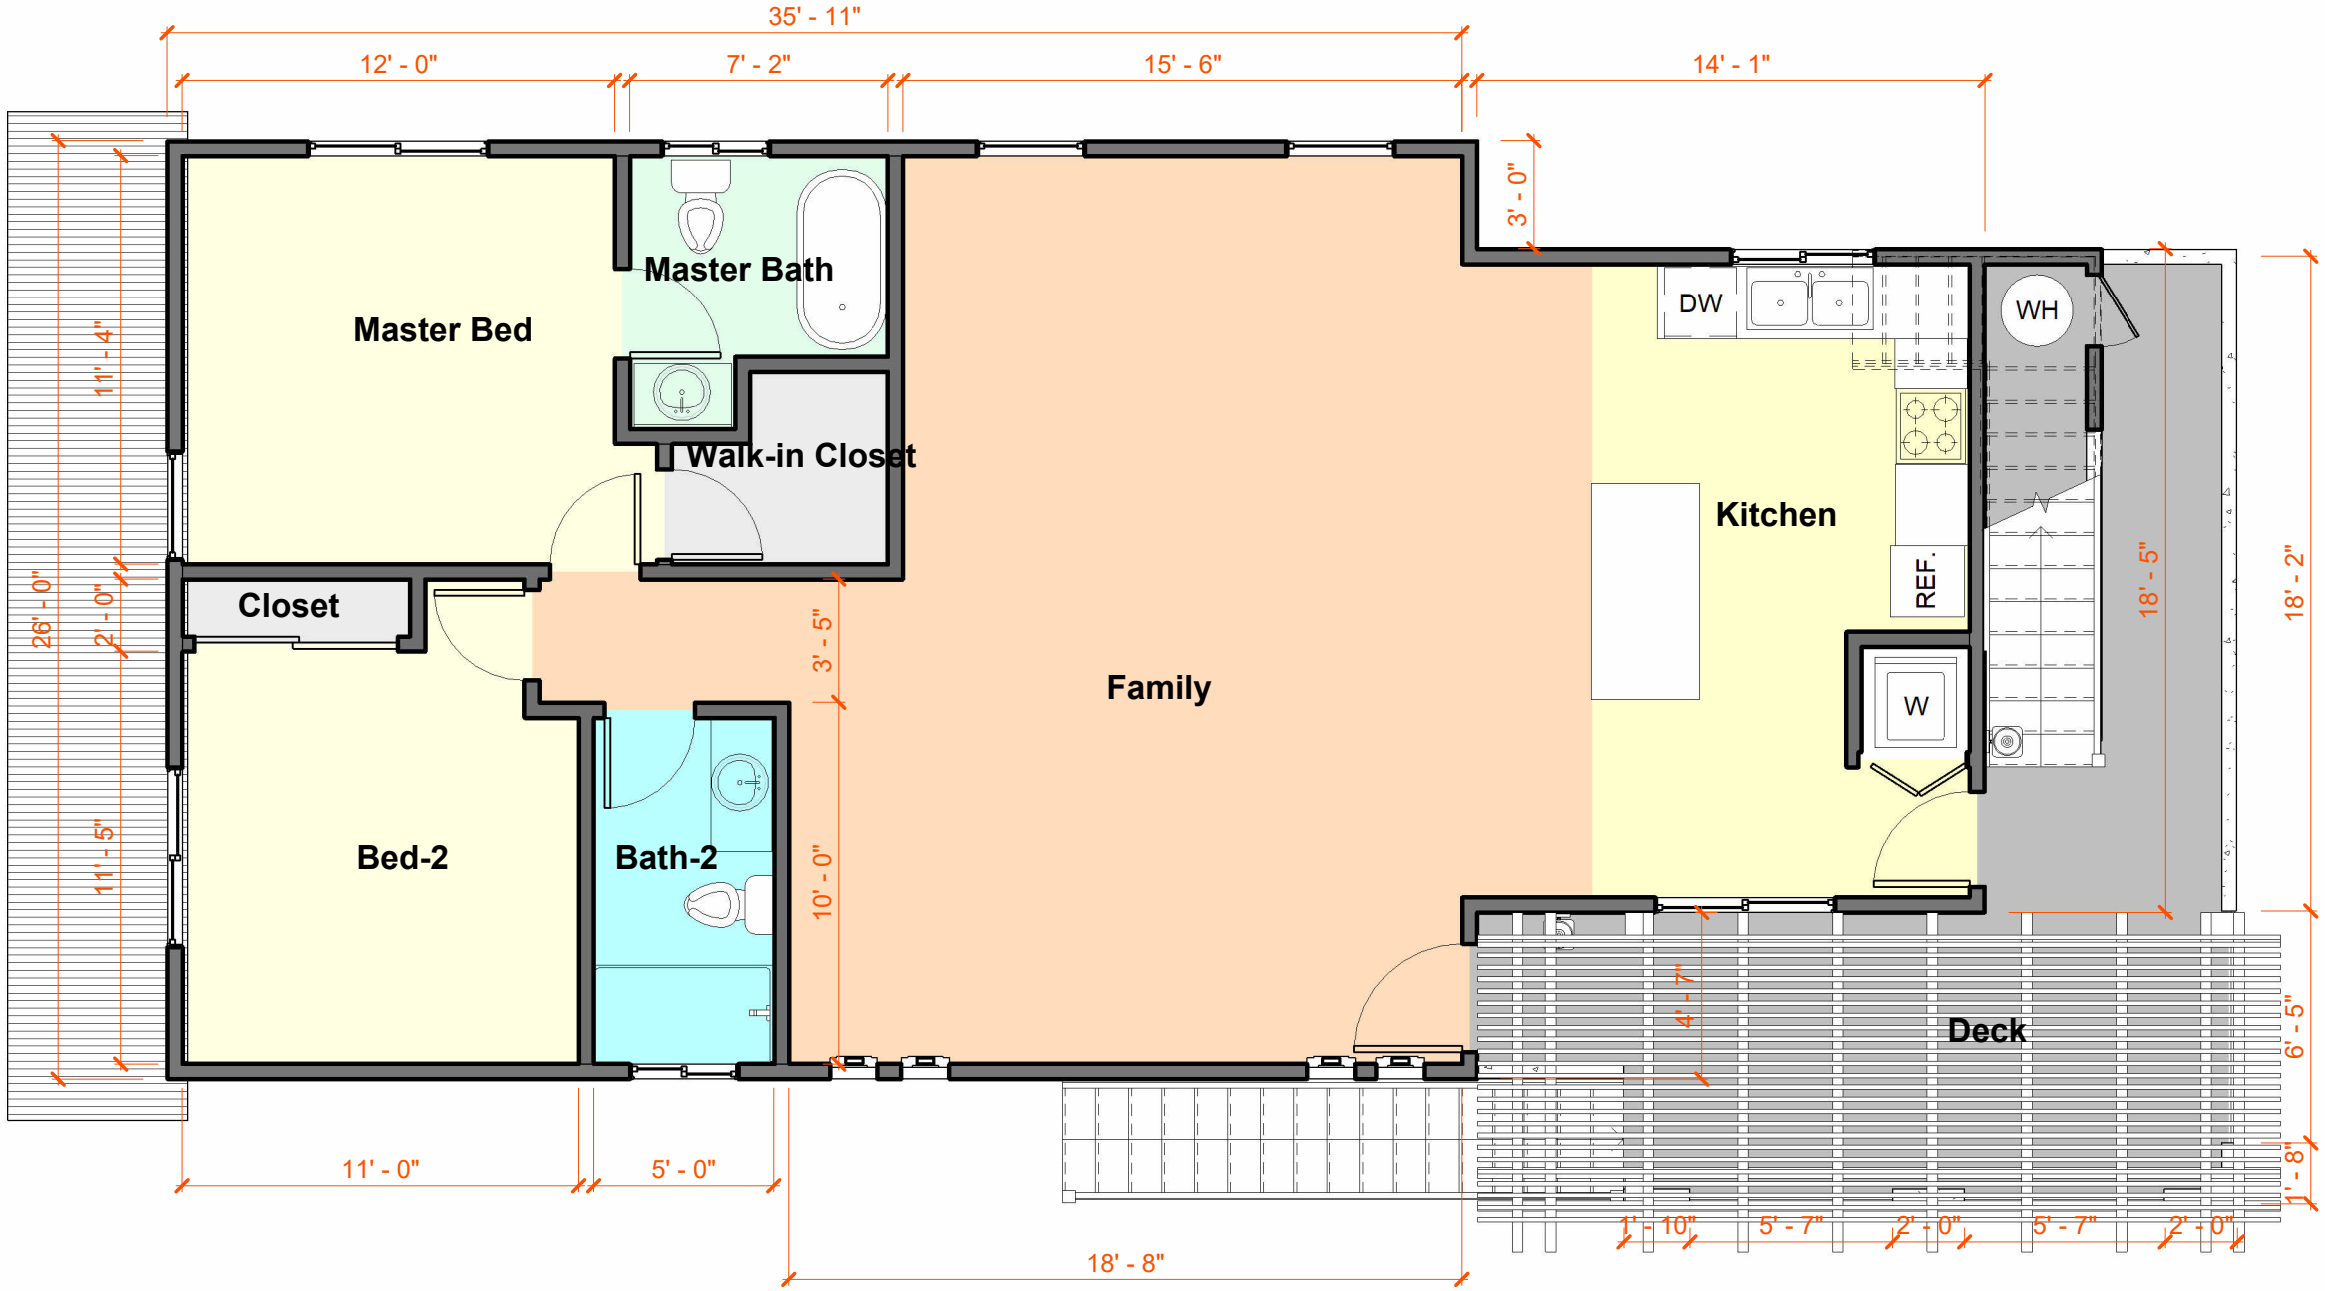

2nd Floor Level

3/16" = 1'-0"

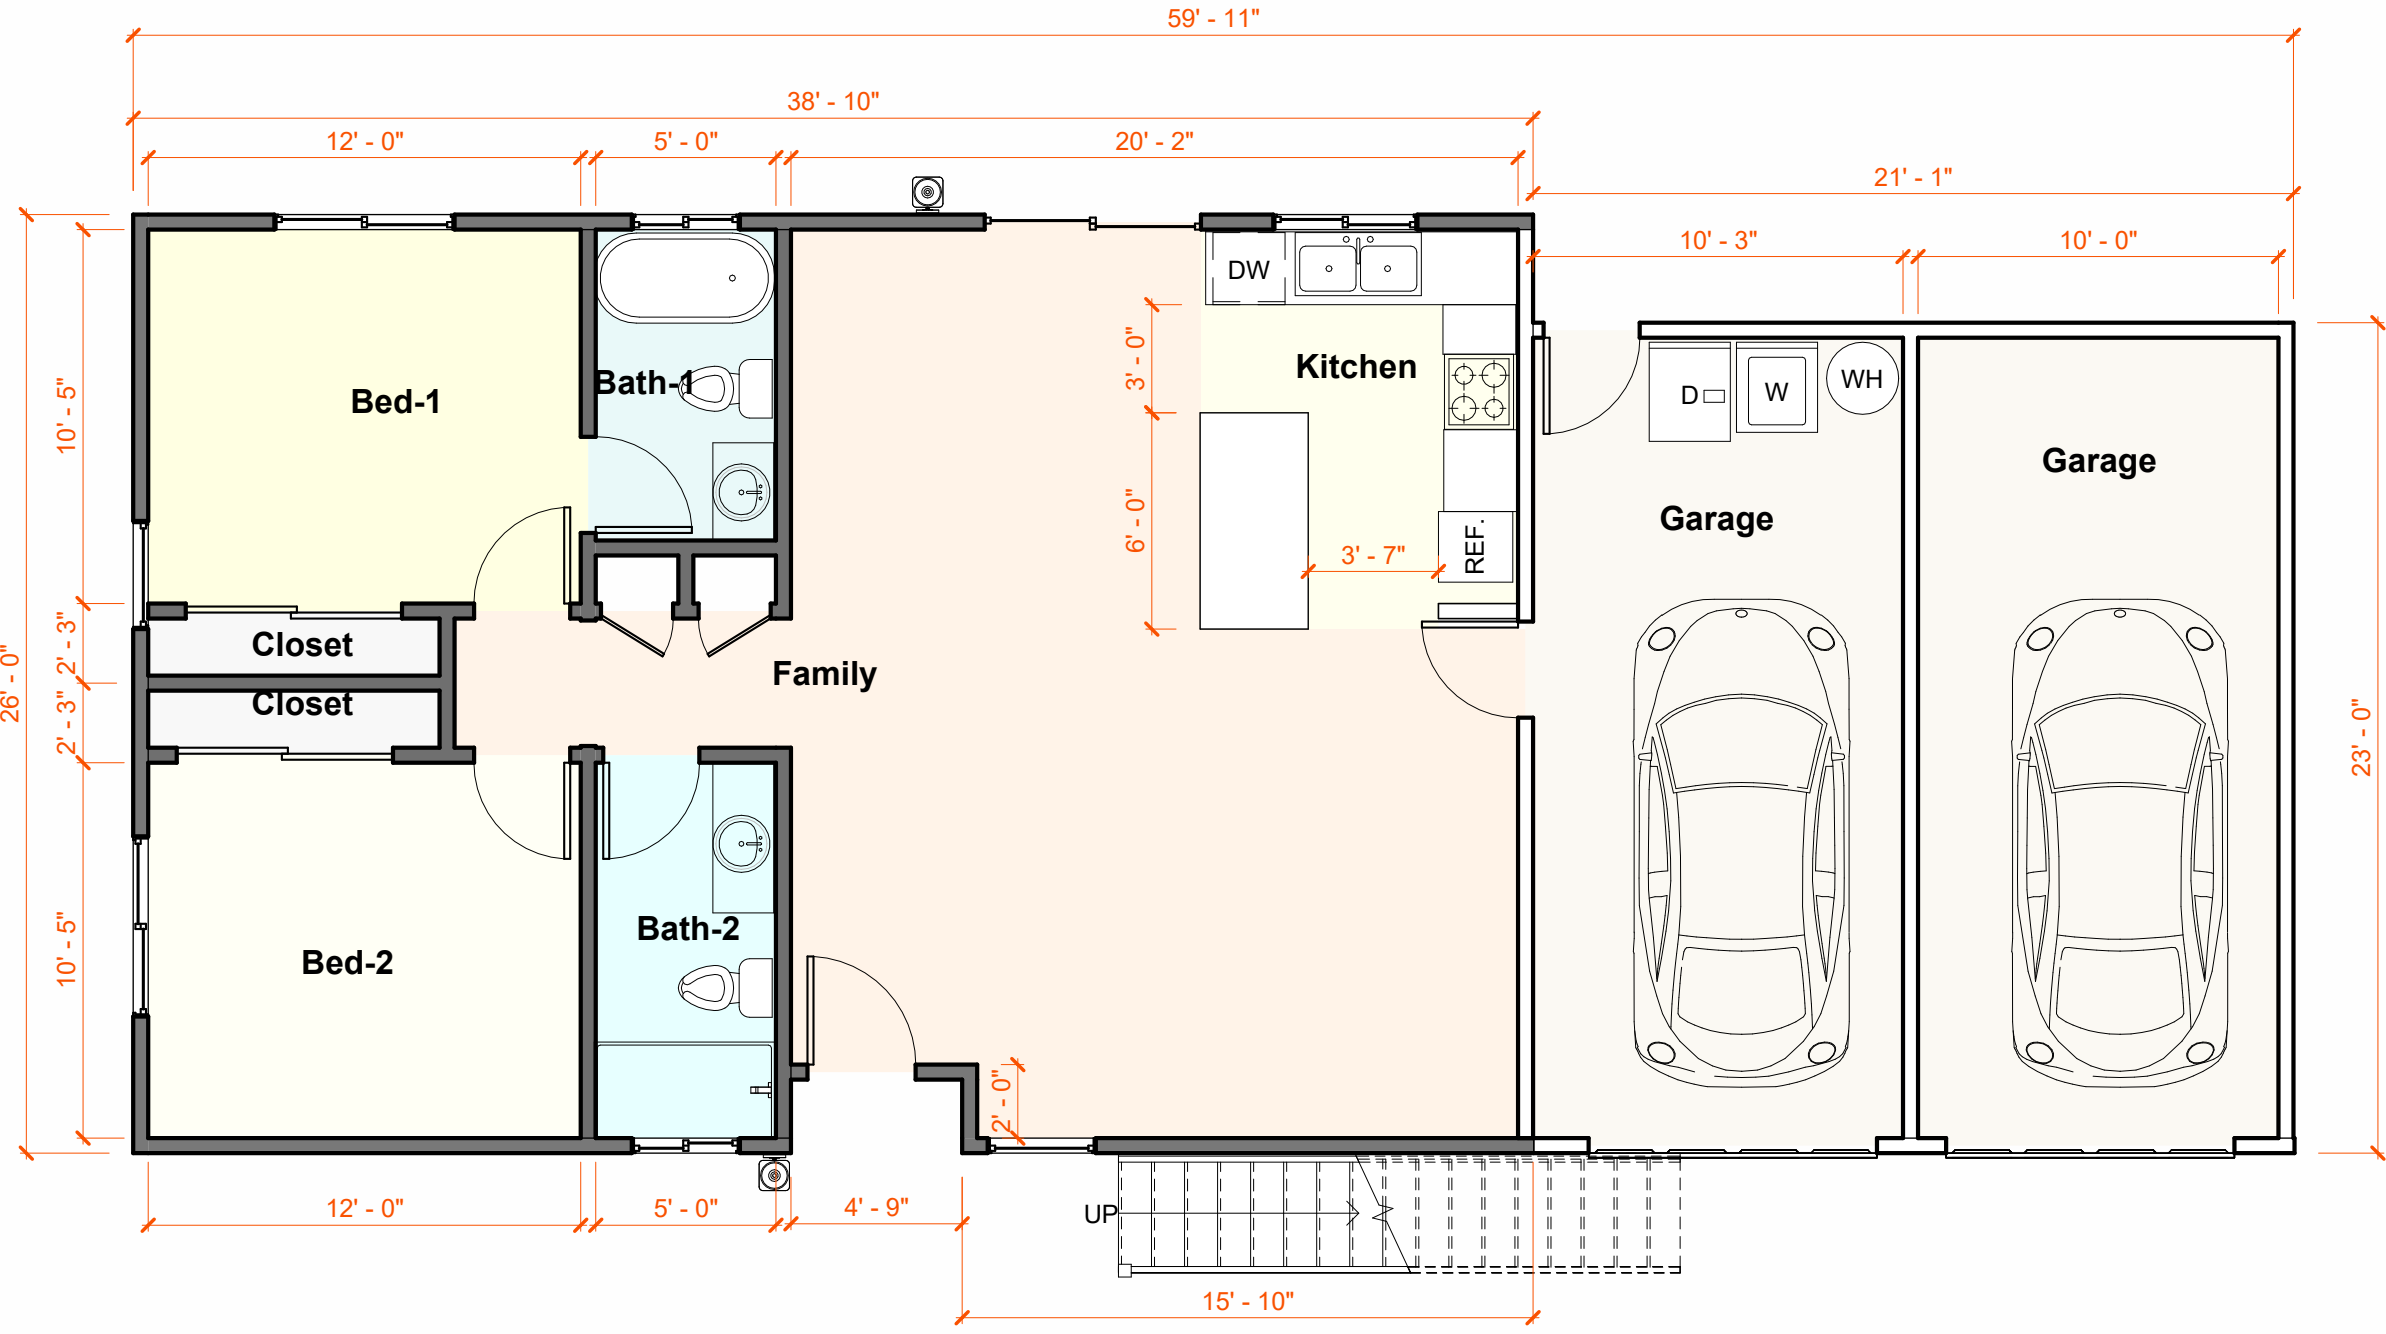

1st Floor Plan

3/16" = 1'-0"

BOTH BLDG 3 & 4 ARE IDENTICAL FLOOR PLAN AND DESIGN

THE PROPOSED STRUCTURE IS LOCATED ON A LOT THAT IS IN A VERY HIGH FIRE SEVERITY ZONE. THE MATERIALS AND METHODS OF CONSTRUCTION USED FOR THE STRUCTURE, INCLUDING ATTACHED ACCESSORY BUILDINGS (E.G. GARAGES) AND STRUCTURES (E.G. PATIO COVERS), SHALL BE IN ACCORDANCE WITH CRC R337, AS ADOPTED AND AMENDED BY THE CITY OF SAN DIEGO [CRC R337.1.3; SDMC149.0327].

1- EXTERIOR WINDOWS, SKYLIGHTS AND EXTERIOR GLAZED DOOR ASSEMBLIES SHALL COMPLY WITH CRC R337.8.2.1. THEY SHOULD BE CONSTRUCTED OF MULTIPANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE MEETING THE REQUIREMENTS OF SECTION R308 SAFETY GLAZING, OR BE CONSTRUCTED OF GLASS BLOCK UNITS, OR HAVE A FIRE-RESISTANCE RATING OF NOT LESS THAN 20 MINUTES WHEN TESTED ACCORDING TO NFPA 257, OR BE TESTED TO MEET THE PERFORMANCE REQUIREMENTS OF SFM STANDARD 12.7A.2

2- EXTERIOR DOORS SHALL COMPLY WITH CRC R337.8.3. THE EXTERIOR SURFACE OR CLADDING SHALL BE OF NONCOMBUSTIBLE MATERIAL, OR THE EXTERIOR SURFACE OR CLADDING SHALL BE OF IGNITION RESISTANT MATERIAL, OR THE EXTERIOR DOOR SHALL BE CONSTRUCTED OF SOLID CORE WOOD THAT COMPLIES WITH THE FOLLOWING REQUIREMENTS:

A) STILES AND RAILS SHALL NOT BE LESS THAN 13/8 INCHES THICK;

B) PANELS SHALL NOT BE LESS THAN 1 1/4 INCHES THICK, EXCEPT FOR THE EXTERIOR PERIMETER OF THE PANEL THAT SHALL BE PERMITTED TO TAPER TO A TONGUE NOT LESS THAN 3/8 INCH THICK. THE EXTERIOR DOOR ASSEMBLY SHALL HAVE A FIRE-RESISTANCE RATING OF NOT LESS THAN 20 MINUTES WHEN TESTED ACCORDING TO NFPA 252.; THE EXTERIOR SURFACE OR CLADDING SHALL BE TESTED TO MEET THE PERFORMANCE REQUIREMENTS OF SECTION R337.7.3.1 WHEN TESTED IN ACCORDANCE WITH ASTM E2707; THE EXTERIOR SURFACE OR CLADDING SHALL BE TESTED TO MEET THE PERFORMANCE REQUIREMENTS OF SFM STANDARD 12.7A.1.

3-D RIP EDGE FLASHING USED AT THE FREE EDGES OF ROOFING MATERIALS SHALL BE NON-COMBUSTIBLE. [SDMC 149.0327]

4- ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER. ALL ROOF GUTTERS AND DOWNSPOUTS SHALL BE CONSTRUCTED OF NON-COMBUSTIBLE MATERIALS. [CRC R337.5.4].

5-GLAZING FRAMES MADE OF VINYL MATERIALS SHALL HAVE WELDED CORNERS, METAL REINFORCEMENT IN THE INTERLOCK AREA, AND BE CERTIFIED TO THE MOST CURRENT EDITION OF ANSI/AAMA/NWDA 101/I.S.2 STRUCTURAL REQUIREMENTS. [SDMC 149.0327(G)].

6-SHOW THE VENT OPENING(S) ARE PROTECTED BY NONCOMBUSTIBLE, CORROSION RESISTANT MESH AND MEETS ALL THE FOLLOWING REQUIREMENTS [CRC R337.6.2]:

- INDIVIDUAL VENT OPENINGS SHALL NOT EXCEED 144 SQUARE INCHES
- THE DIMENSIONS OF THE OPENINGS SHALL BE A MINIMUM OF 1/16-INCH AND SHALL NOT EXCEED 1/8-INCH

7- THE WALKING SURFACE MATERIAL OF DECKS, PORCHES, BALCONIES AND STAIRS SHALL COMPLY WITH THE REQUIREMENT OF CRC R337.9