

Revision Dates

1 08.15.24
2 01.01.25

SHEET TITLE
Electrical Plan

Drawing Date 08.27.26

Check By

Drawn By FRANCIS N.

Scale As indicated

Job Number 022225

Sheet Number

A201

ELECTRICAL LEGEND


- § LIGHT SWITCH (SINGLE POLE)
- §₂ LIGHT SWITCH (DOUBLE POLE)
- §₃ LIGHT SWITCH (THREE WAY)
- §_{OC} LIGHT SWITCH (OCCUPANCY SENSOR)
- ◆ 26 WATT CFL RECESSED CAN WITH ELECTRONIC BALLAST AND WHITE OR ALLUMINUM REFLECTOR AND TRIM (HIGH-EFFICACY LIGHT)
- FLUORESCENT VANITY LIGHT FIXTURE WITH T8 LAMPS AND ELECTRONIC BALLAST (HIGH-EFFICACY LIGHT)
- SURFACE-MOUNTED DECORATIVE INCANDESCENT LIGHT FIXTURE (LOW-EFFICACY LIGHT)
- ⊞ EXTERIOR INCANDESCENT SCONE WITH MOTION SENSOR AND PHOTOCELL
- ⊞ DUPLEX RECEPTACLE OUTLET (MOUNTED AT 18" A.F.F. CENTERLINE U.O.N.)
- GFI ⊞ DUPLEX RECEPTACLE OUTLET - GFI
- WP ⊞ DUPLEX RECEPTACLE OUTLET (WEATHER PROOF)
- ⊞ DUPLEX RECEPTACLE OUTLET - CEILING MOUNTED
- ⊞ DUPLEX RECEPTACLE OUTLET - FLOOR MOUNTED

NOTES:


- ALL RECEPTACLES IN DWELLING SHALL BE TAPER RESISTANT RECEPTACLE
- ALL OUTLETS LOCATED IN ROOM (FAMILY, LIVING, BEDROOMS, DINING, HALLS, ETC.) SHALL BE ARC-FAULT PROTECTION TYPE.

ELECTRICAL NOTES:

- VERIFY ALL HVAC AND KITCHEN EQUIPMENT PRIOR TO ROUGH IN. PROTECT EXISTING A/C UNIT BRANCH
- ALL WIRES SHALL BE IN METALLIC CONDUIT
- ALL WIRES SHALL BE COPPER TYPE, THWN, UNLESS OTHERWISE NOTED ON PLANS.
- ALL CIRCUIT BREAKERS CONTROLLING ELECTRIC DISCHARGE LAMPS SHALL HAVE HANDLES WITH PROVISION TO LOCK CIRCUIT BREAKERS IN THE OPEN POSITION.
- ALL WORK SHALL BE DONE TO COMPLY WITH ALL THE LATEST LOCAL, STATE AND 2005 NATIONAL ELECTRICAL CODES.
- ALL PANELBOARDS SHALL BE LOAD CENTERS CIRCUIT BREAKER TYPE AND SHALL BE EQUAL TO CUTLER HAMMER, GENERAL ELECTRIC, ITE OR SQUARE "D" .
- ALL PACKAGE AIR CONDITIONING UNITS SHALL BE LABELED BY A RECOGNIZED ELECTRICAL AGENCY.
ALL PACKAGE AIR CONDITIONING UNITS SHALL BE LABELED BY A RECOGNIZED ELECTRICAL AGENCY.
- ALL FUSE PROTECTION OF AIR CONDITIONING UNITS SHALL CONFORM WITH LISTING ON THE NAMEPLATE OF THE SPECIFIC UNIT
- CIRCUIT BREAKER INTERRUPTING CAPACITY (SYMMETRICAL) SHALL BE 10,000 FOR ALL CIRCUIT BREAKERS, UNLESS OTHERWISE NOTED ON PLANS.
- VERIFY ALL TELEPHONE REQUIREMENTS WITH TELEPHONE COMPANY, OR TELEPHONE CONTRACTOR, AS THE CASE MAY BE.
- THE ELECTRICAL CONTRACTOR SHALL COORDINATE HIS WORK WITH OTHER TRADE FOR THE INSTALLATION OF HIS EQUIPMENT. FOR EXAMPLE, THE LIGHTING FIXTURES SHALL CLEAR THE PLUMBING PIPES AND TRACK SUPPORTS HANGING FROM THE CEILING.
- ELECTRICAL CONTRACTOR SHALL VERIFY LOCATION OF ALL MOTORS ALL CONNECTIONS FOR THE KITCHEN AND SIMILAR EQUIPMENT SHALL BE PART OF THE ELECTRICAL CONTRACT.
- ELECTRICAL WORK SHALL COMPLY WITH THE 2005 NEC AS AMENDED BY THE 2007 CALIFORNIA ELECTRICAL CODE
- ALL DOCUMENTATION REGARDING THE SERIES BREAKERS TO BE USED ON THIS PROJECT WILL BE AVAILABLE FOR THE INSPECTOR UPON REQUEST. THE SERIES RATED COMBINATIONS SHOULD BE HIGHLIGHTED AND TABBED FOR INSPECTOR'S USE.
- AC CABLE IS NOT ALLOWED IN A, B, E, H, F, M, S AND I OCCUPANCIES. NM CABLE IS RESTRICTED (WITHOUT CITY APPROVAL) TO ONE AND TWO FAMILY DWELLINGS.
- AN EQUIPMENT GROUND CONDUCTOR IS TO BE INSTALLED IN ALL FLEXIBLE CONDUIT
- ELECTRICAL SUBJECT TO INSPECTIONS.
- ALL EQUIPMENT SHALL BE LISTED BY A NATIONALLY RECOGNIZED TESTING LABORATORY.
- ALL ELECTRICAL EQUIPMENT EXPOSED TO WEATHER SHALL BE LISTED FOR EXTERIOR USE.
- ALL EQUIPMENT FASTENED IN PLACE OR CONNECTED BY PERMANENT WIRING METHOD SHALL BE GROUNDED
- CONTRACTOR SHALL USE A CODE APPROVED WIRING METHOD OF THE FOLLOWING:

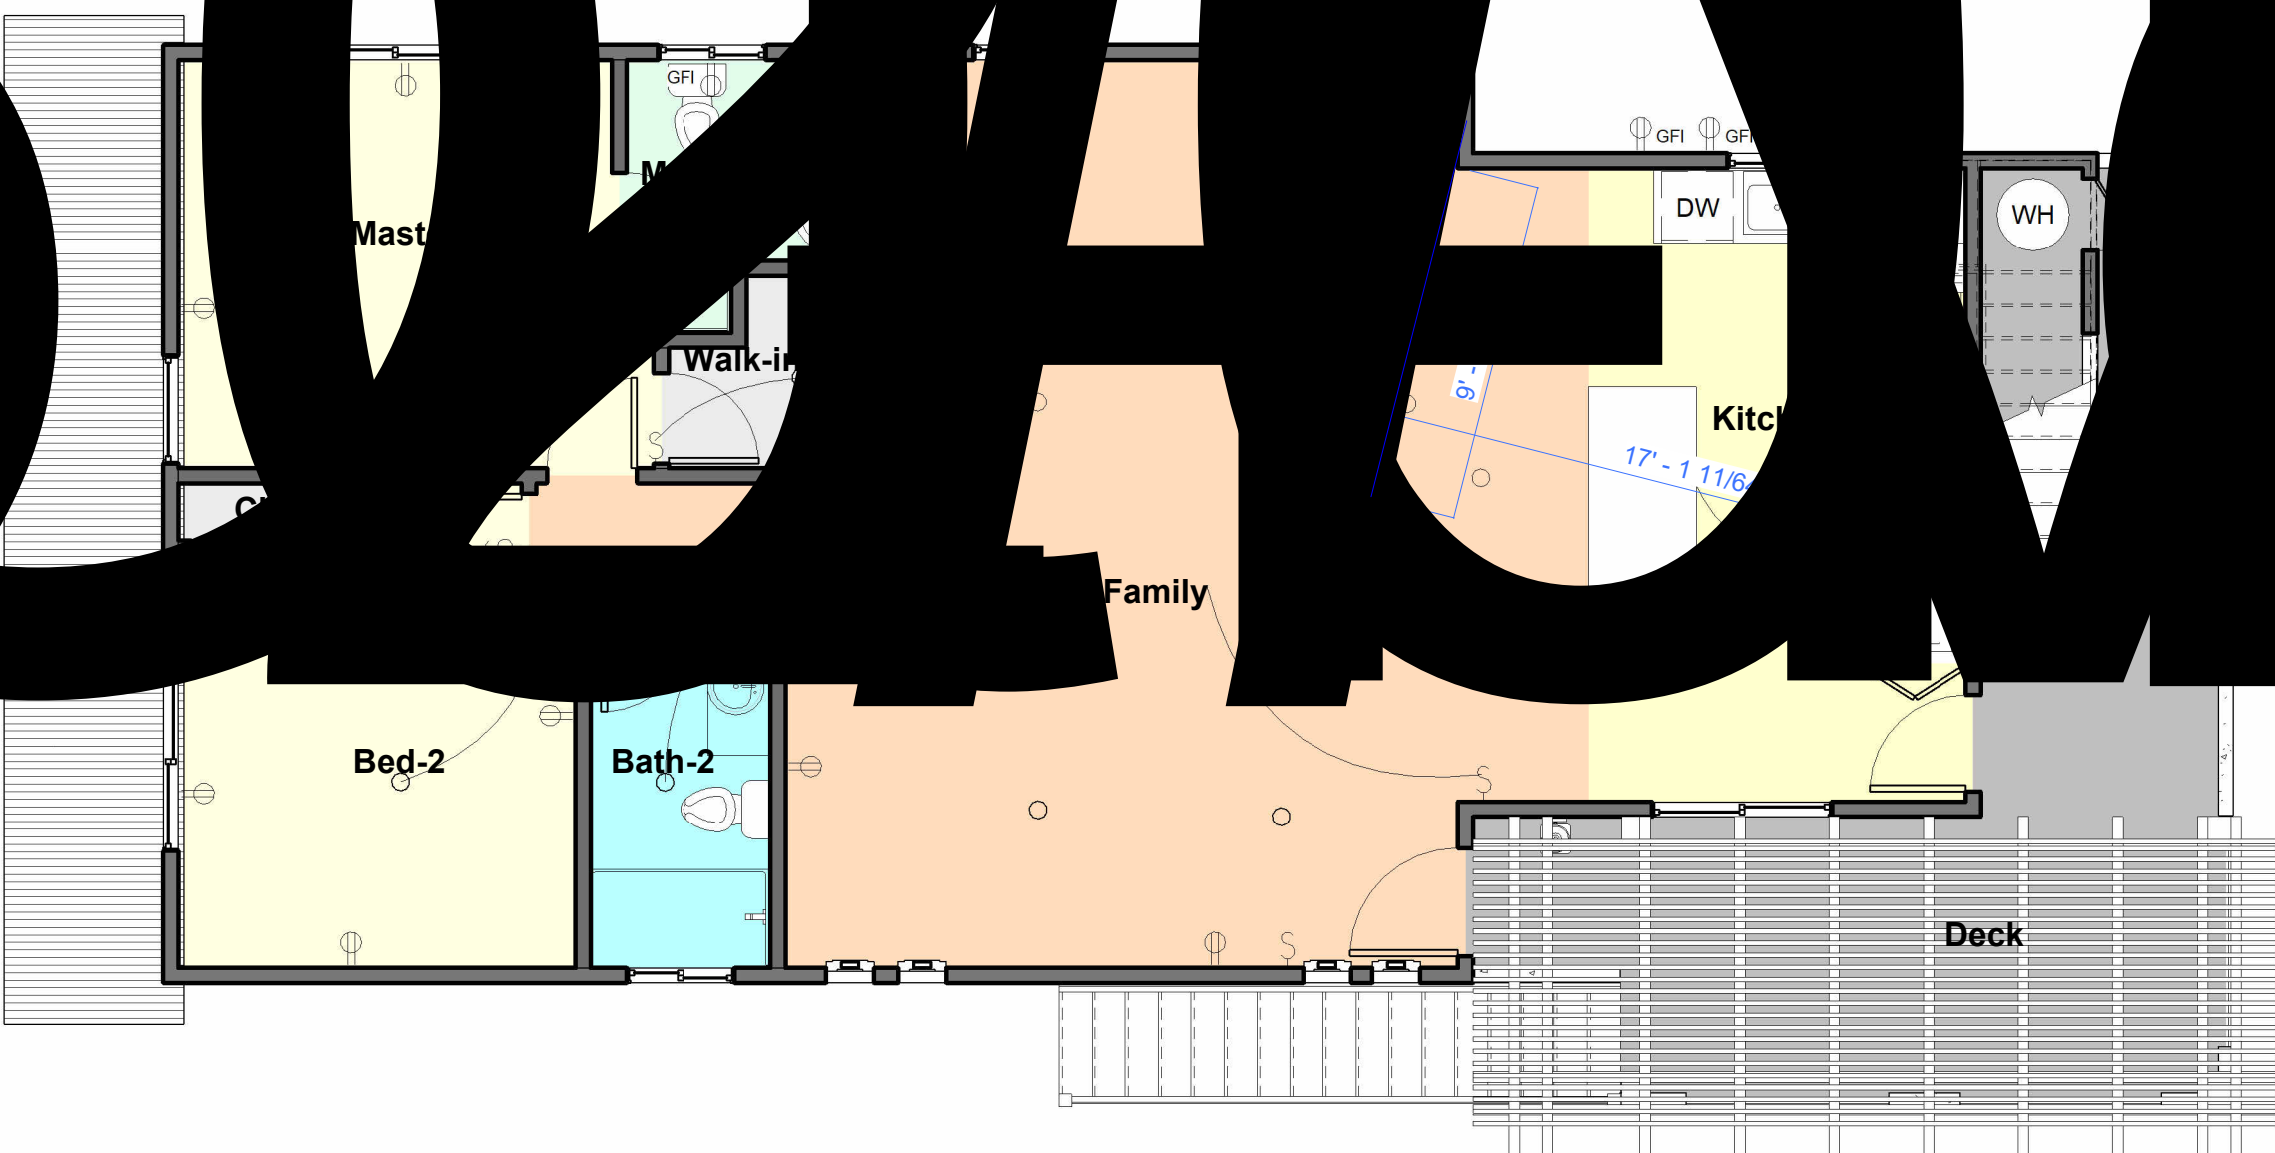

2 2nd Floor Electrical Plan
3/16" = 1'-0"

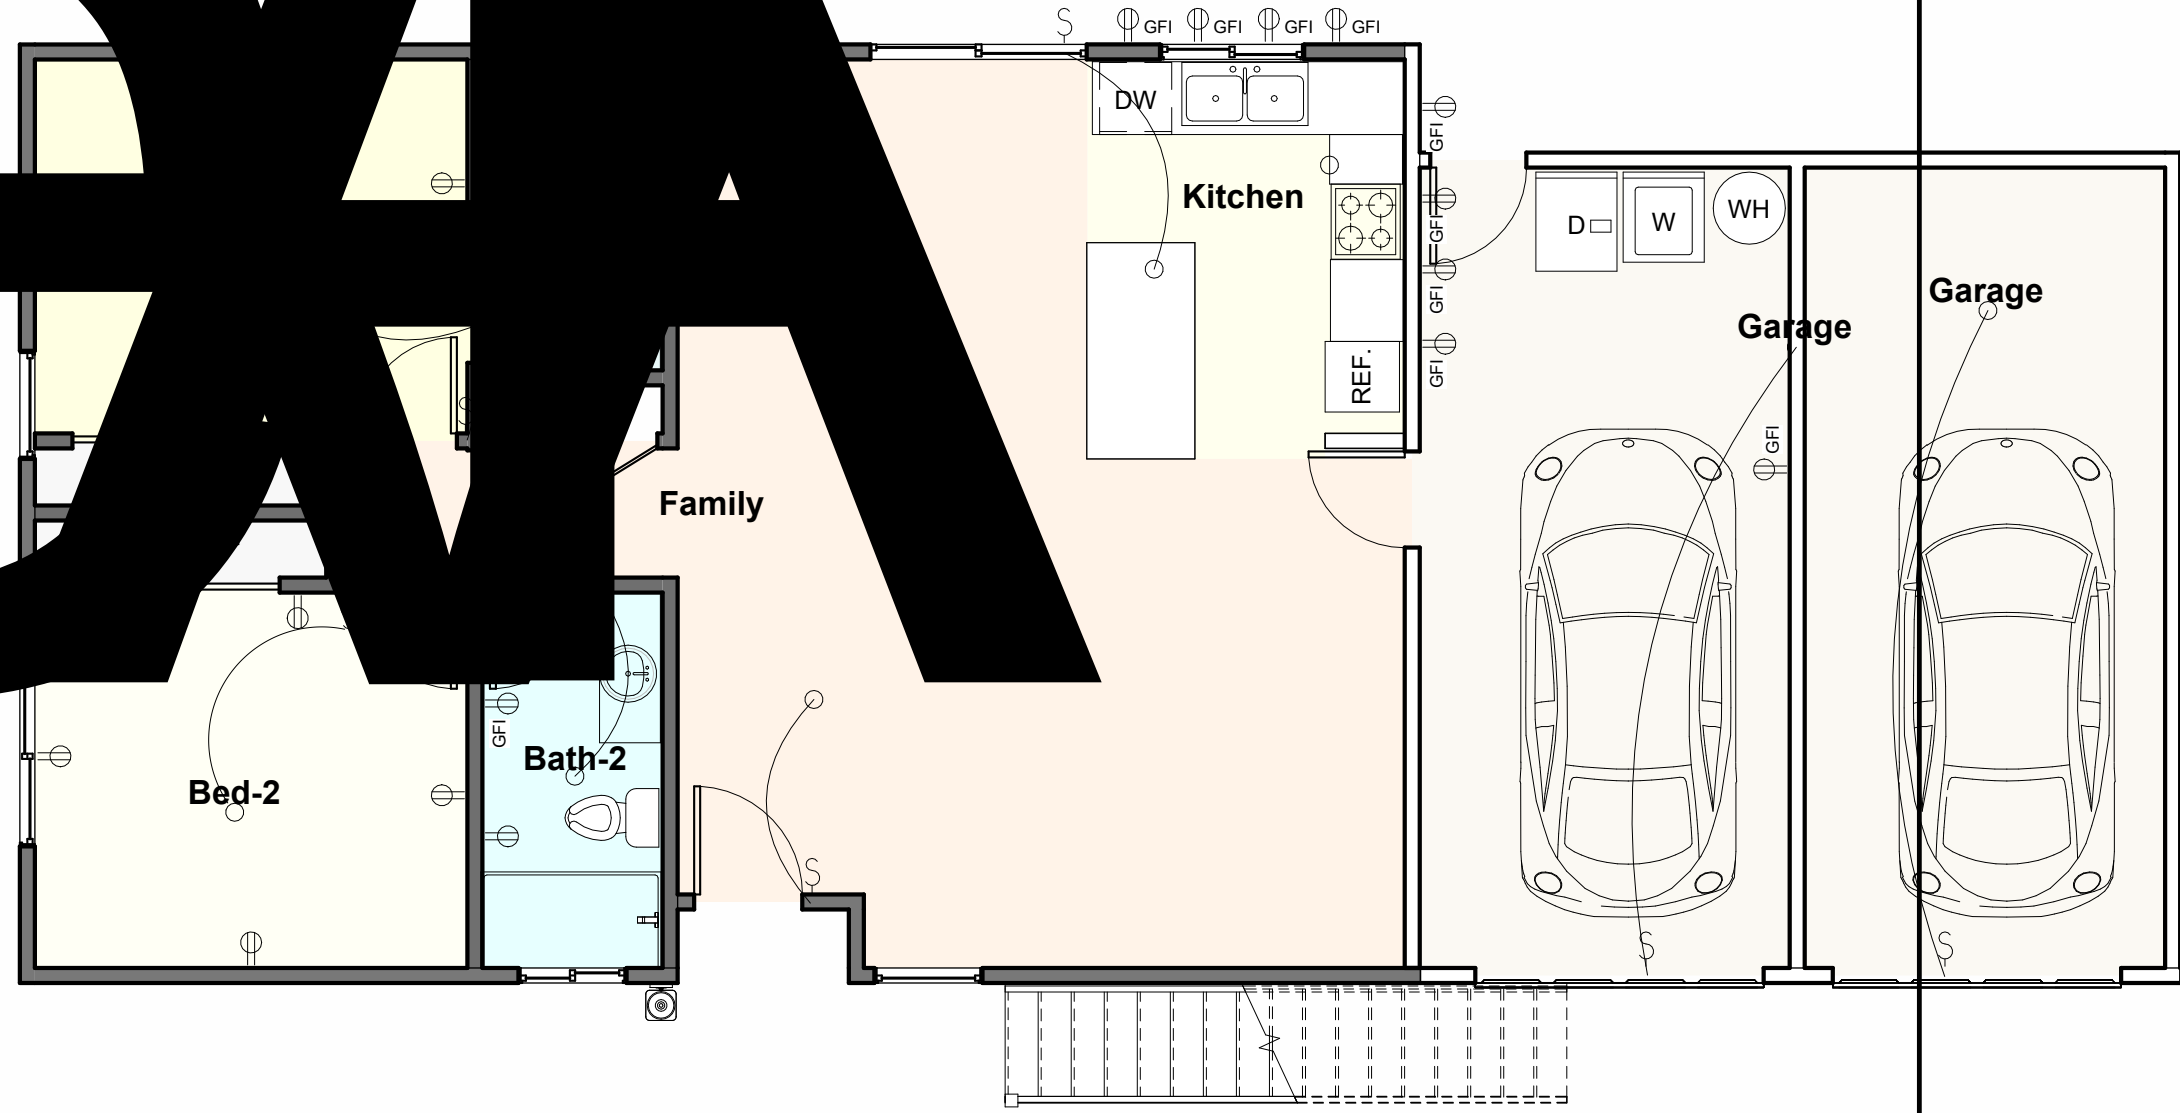

1 1st Floor Electrical Plan
3/16" = 1'-0"

ELECTRICAL RECEPTACLE OUTLETS, SWITCHES AND CONTROLS (INCLUDING CONTROLS FOR HEATING, VENTILATION AND AIR CONDITIONING) INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE OUTLET BOX ABOVE THE FINISH FLOOR. [CRC R327.1.2]

EXCEPTIONS:
1. DEDICATED RECEPTACLE OUTLETS; FLOOR RECEPTACLE OUTLETS; CONTROLS MOUNTED ON CEILING FANS AND CEILING LIGHTS; AND CONTROLS LOCATED ON APPLIANCES.
2. RECEPTACLE OUTLETS REQUIRED BY THE CALIFORNIA ELECTRICAL CODE ON A WALL SPACE WHERE THE DISTANCE BETWEEN THE FINISHED FLOOR AND A BUILT-IN FEATURE ABOVE THE FINISH FLOOR, SUCH AS A WINDOW, IS LESS THAN 15 INCHES".

WHEN DOORBELL BUTTONS OR CONTROLS ARE INSTALLED SHOW THE LOCATION AND REQUIREMENTS
ON PLAN " DOORBELL BUTTONS OR CONTROLS SHALL NOT EXCEED 48 INCHES ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY. WHERE DOORBELL BUTTONS INTEGRATED WITH OTHER FEATURES ARE REQUIRED TO BE INSTALLED ABOVE 48 INCHES MEASURED FROM THE EXTERIOR FLOOR OR LANDING, A STANDARD DOORBELL BUTTO NOR CONTROL SHALL ALSO BEPRO VIDED AT A HEIGHT NO T EXCEEDING 48 INCHES ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FRO M THE TOP OF THE DOORBELL BUTTON OR CONTROL". [CRC R327.1.4]