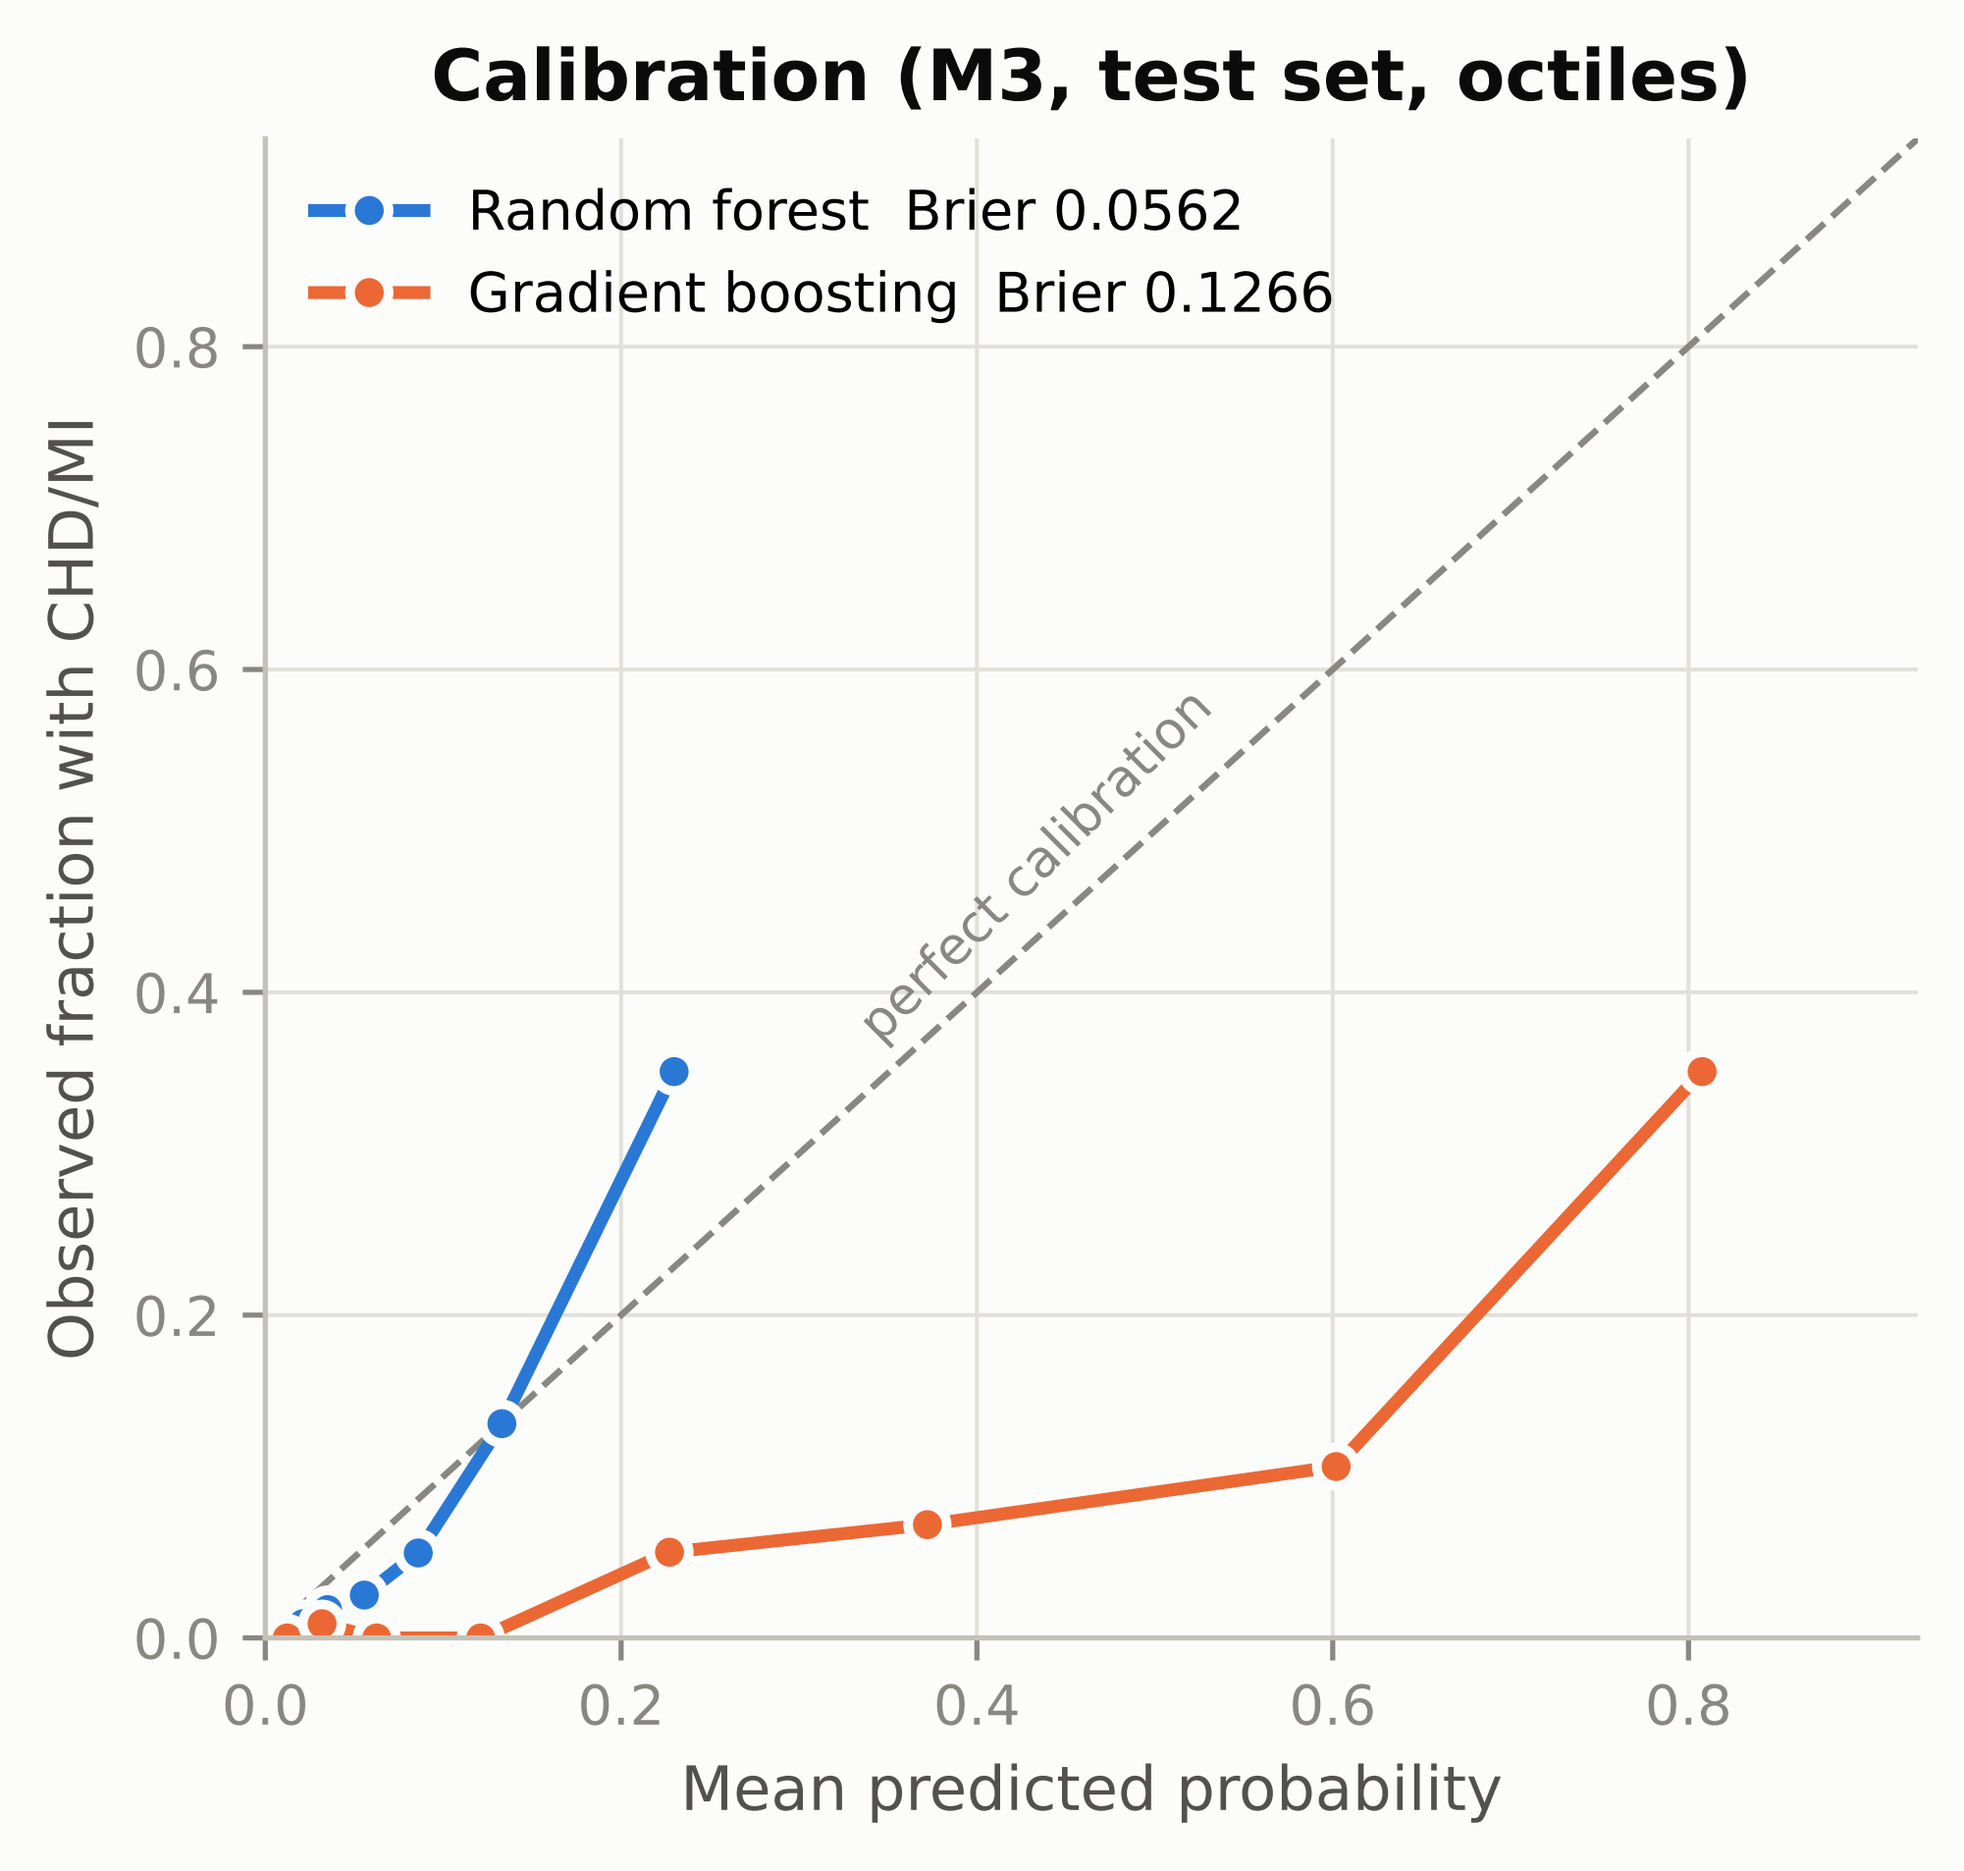
Calibration (M3, test set, octiles)
Random forest Brier 0.0562
Gradient boosting Brier 0.1266
perfect calibration
Observed fraction with CHD/MI
Mean predicted probability
0.0
0.2
0.4
0.6
0.8