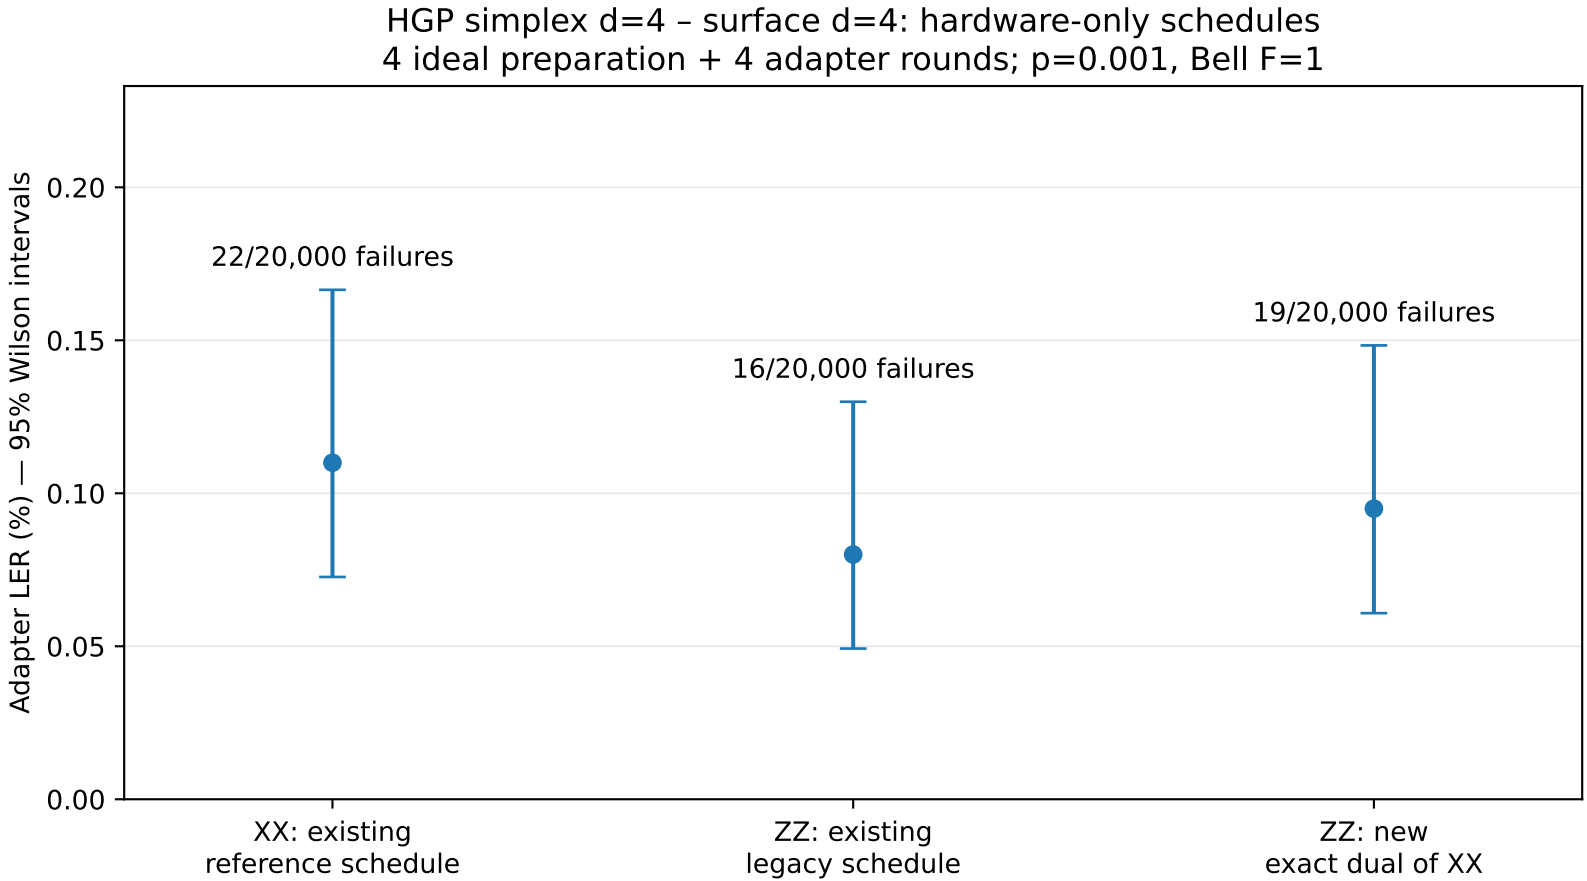
HGP simplex d=4 – surface d=4: hardware-only schedules
4 ideal preparation + 4 adapter rounds; p=0.001, Bell F=1
Adapter LER (%) — 95% Wilson intervals
0.00
0.05
0.10
0.15
0.20
22/20,000 failures
16/20,000 failures
19/20,000 failures
XX: existing
reference schedule
ZZ: existing
legacy schedule
ZZ: new
exact dual of XX
Dual ZZ has the same ordered detector-error model as reference XX; samples are independent.
This comparison does not test block-only faults or full-surgery LER.