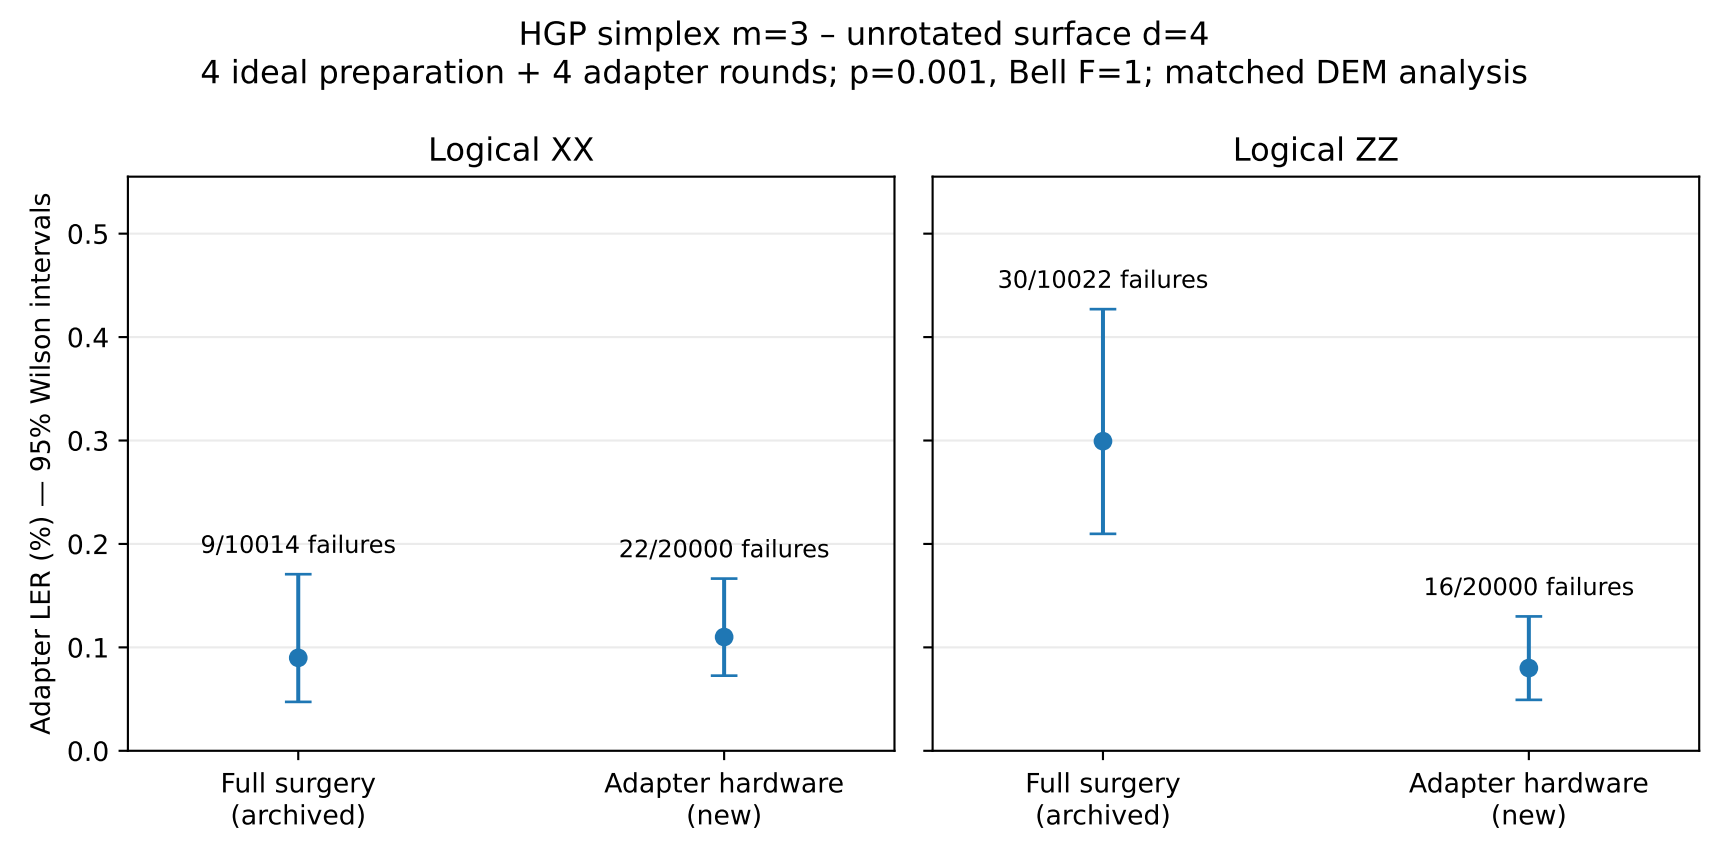
HGP simplex m=3 – unrotated surface d=4
4 ideal preparation + 4 adapter rounds; p=0.001, Bell F=1; matched DEM analysis
Logical XX
Logical ZZ
Adapter LER (%) — 95% Wilson intervals
0.0
0.1
0.2
0.3
0.4
0.5
9/10014 failures
22/20000 failures
30/10022 failures
16/20000 failures
Full surgery
(archived)
Adapter hardware
(new)
Full surgery
(archived)
Adapter hardware
(new)