28V DC TR BUS 1 24-54-11 — C525 ZONE 1 TEMP IND (P12)
DC
33-12-21
N196 IND-ZONE 1 TEMP AND DUCT TEMP
DT471 T471 BULB-ZONE 1 DUCT TEMP STA 970, WL 187, LBL 107
DT472 SAME AS T471 T472 BULB-ZONE 1 TEMP STA 365, WL 344, LBL 60

28V DC TR BUS 2 24-54-21 — C526 ZONE 2 TEMP IND (P12)
SAME AS N196
N116 IND-ZONE 2 TEMP AND DUCT TEMP
DT473 SAME AS T471 T473 BULB-ZONE 2 DUCT TEMP STA 1127, WL 321, RBL 72
DT474 SAME AS T471 T474 BULB-ZONE 2 TEMP STA 336, WL 295, RBL 0


28V DC TR BUS 2 24-54-21 — C527 ZONE 3 TEMP IND (P12)
SAME AS N196
N117 IND-ZONE 3 TEMP AND DUCT TEMP
DT475 SAME AS T471 T475 BULB-ZONE 3 DUCT TEMP STA 1270, WL 333, RBL 7
DT476 SAME AS T471 T476 BULB-ZONE 3 TEMP STA 1110, WL 297, RBL 54

28V DC TR BUS 24-54-31 — C528 ZONE 4 TEMP IND (P12)
SAME AS N196
N118 IND-ZONE 4 TEMP AND DUCT TEMP
DT477 SAME AS T471 T477 BULB-ZONE 4 DUCT TEMP STA 1261, WL 318, RBL 20
DT478 SAME AS T471 T478 BULB-ZONE 4 TEMP STA 2050, WL 297, RBL 54


28V DC TR BUS 3 24-54-31 — C1851 UPPER DECK TEMP IND (P12)
SAME AS N196
N204 IND-UPPER DECK TEMP AND DUCT TEMP
DT517 SAME AS T471 T517 BULB-UD DUCT TEMP STA 1114, WL 329, RBL 76
DT512 SAME AS T471 T512 BULB-UD TEMP STA 810, WL 375, LBL 54

M91(Y8J) MODULE AIR CONDITIONING (P4)


NOTES:
2 DC GROUND TO BE LOCATED NEAR TEMP BULB

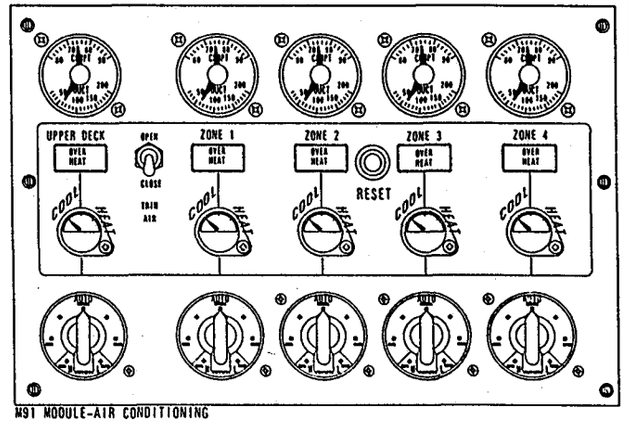


M91 MODULE-AIR CONDITIONING

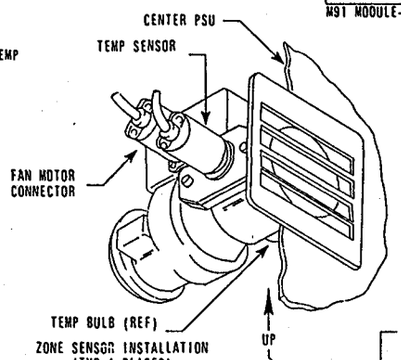


ZONE SENSOR INSTALLATION (TYP 4 PLACES)
DETAIL II

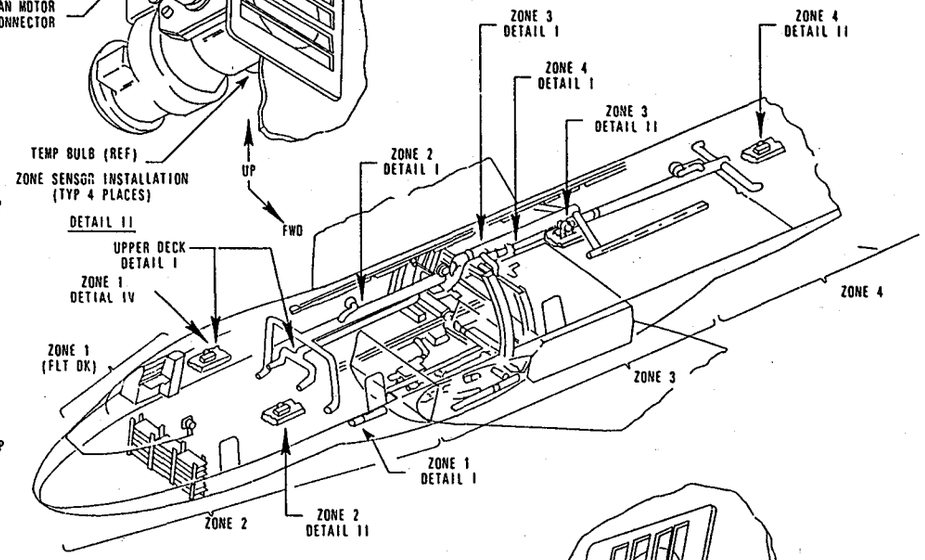

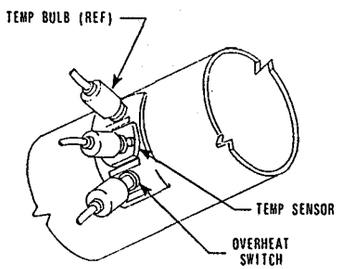

ZONE DUCT SENSOR INSTALLATION (TYP 4 PLACES)
DETAIL I

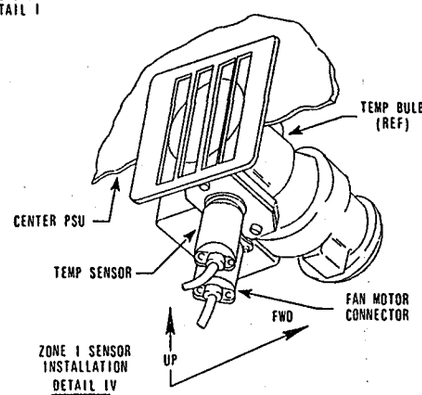

ZONE 1 SENSOR INSTALLATION
DETAIL IV

INDICATOR SYSTEM-ZONE AND ZONE DUCT TEMPERATURE-SCHEMATIC

163,166,170,173,176-179,183-187,189,212-213

RS001-RS010
RS251-RS270

LAST CHANGE DATE: 07-19-88
OPT INTS: LFS 707-8N
3 PAGE DATE: JUN 6/88

DRAWING NO: 61B74707
DCN: BS
CHANGE:

21-65-01
PAGE 107