

Review 1

=====

Comments for the Authors

The subject is interesting, and the paper well written.

My major concern is about the embodied impacts calculation within this study where one can not understand input hypotheses, method, scope, and the share of embodied impact within the results. Also, as the study target the 2080 horizon, a dynamic approach to the carbon content of the grid can't be avoided.

We appreciate your input and the opportunity to improve our writing. Please see our specific responses to your comments below. We have also added one additional plot to the paper that shows the adaptation performance of the strategy sets alongside the mitigation performance.

Please, also consider the following specific comments:

--> The title of this paper is not consistent with the title of the conf.tool page.

Thank you for pointing this error out. We have replaced the title in conf.tool with the paper title.

--> The lack of details about simulation inputs decreases the result's usability. More details about the embodied carbon of building components for instance is required, especially if data sources come from a very large scope around the world.

For brevity this information was left to citations. The inputs come from regional sources first and then where other data was required reach out to foreign sources. Table 1 has been updated to be more explicit about the sources associated with each strategy.

--> The lack of embodied carbon data and its consequences on the study should be discussed within the discussion section.

Embodied carbon of components and technologies was included as an input to the study using cradle-to-gate numbers.

--> Are you performing LCA of your retrofitting scenarios? If so following which norm? What is your scope, the lifetime of the building, etc...

The study only accounted for cradle to gate emissions. Buildings were assigned new embodied emissions after 30 years from construction or most recent retrofit for assumed retrofits such as envelope - in the event that these were not affected by a strategy. This detail was only briefly noted in the original submission and has now been given more attention in the discussion/limitations section.

--> Future carbon content of the grid should lower over time. It means that deep envelope retrofit efficiency will do the same. At the 2080 horizon, the low carbon content of the grid should not be overlooked. At least in a very simple way with a linear regression towards a full decarbonated grid.

BC's grid intensity hasn't moved markedly in the past few years. The standard in the BC Hydro (electrical grid) portfolio is for 93% "clean energy". BC Hydro reports that this is in fact larger (98%). The carbon intensity of the electricity grid is expected to drop closer to 0, due to a 20% decrease in fossil fuel use for generation by 2050.

--> In the end, what happens if the grid is fully carbon-free? It remains embodied carbon only. This should also be discussed.

We agree that this is an important discussion point, particularly as BC's electricity is very near this threshold and is often thought of as ostensibly carbon free. The discussion has been amended to include more on this topic.

--> Within the results, a split between operational and embodied emissions would be very insightful to understand which retrofitting measure is contributing to what.

The most significant reduction in emissions we saw was due to fuel switching. Expanded analysis on the embodied carbon implications of the strategies associated with this practice is outside of the scope of this study, but certainly relevant to the issue at hand where we are seeing the utilization of a more or less clean grid. We have noted one such case in which embodied emissions are likely contributing (mass timber) to a decrease in overall emissions as well as one case where we see an increase (seawater cooling loop).

Review 2

Comments for the Authors

Well written and interesting paper, few questions and recommendations for the revision of the paper:

We appreciate your input and the opportunity to improve our writing. Please see our specific responses to your comments below. We have also added one additional plot to the paper that shows the adaptation performance of the strategy sets alongside the mitigation performance.

Urban Energy Model => morphed climate files were produced: please explain in more detail the morphing process for developing the future climate files and add the limitations of the approach. For the purposes of brevity we relate the details for the morphing procedure back to the original literature for the method that was used. We have updated the methods though to include more details on the underlying climate model data (a 25 member ensemble of global climate model output data from the latest generation of models - those that will support IPCC AR6). However, the discussion has been updated with the limitations of this approach as the limitations of the underlying climate model data are particularly important to note for a coastal and mountainous region such as Southwestern BC.

Total annualized cost: the value for the discount rate seems high, please add source for this assumption. The paper does not mention the assumed growth rate for the energy cost: please add which annual growth rate has been assumed. Indicate in the paper if the rates are real or nominal rates.

Discount rate was initially determined in consultation with the local developers. This detail has been added to the methodology. Energy cost growth rate was left out. This has been added to limitations. TAC uses real rates. This has been indicated in methods.

Figure 5 - marginal abatement cost to meet 80% reduction => why is 'adjust setpoints' not selected / taken into account in this analysis?

This figure shows combinations of strategies that if implemented would bring the community to an 80% reduction of emissions by 2050 under the best-case climate scenario. None of the strategies are necessarily selected, but rather show up because they are a part of strategy sets that meet this threshold. Adjust setpoints was not a part of any of those cases. This deserves closer attention and has been added to the discussion.

A final language check is recommended to correct a few typos noticed in the text.
We appreciate the recommendation and have made an effort to clear up typos and misunderstandings in the text.

Simulation and visualization framework for selecting appropriate urban-scale climate mitigation and adaptation strategies

Abstract

At present mitigation and adaptations strategies compete for constrained resources within a future of uncertain climate impacts. Meeting decarbonisation goals while implementing robust and resilient adaptation strategies requires an analysis structure that can account for uncertainty as well as depict how the intermingling of strategies may hinder or benefit the ultimate trajectory of actions. The marginal abatement cost curve (MACC) is an indispensable tool for planning mitigation pathways, but has historically not relied upon robust experimental analysis making it notional at best nor has it included a view of adaptation pathways. This study utilizes a newly developed, medium-density residential community in Vancouver, British Columbia, Canada as a case study for developing a pathway-based MACC. Multiple mitigation and adaptation measures are modeled individually and through exhaustive combination to test their sensitivity on marginal abatement cost and residual cost of climate change. Several visualizations are created to demonstrate several ways of analyzing the resulting large set of data.

Key Innovations

- Visualization of marginal abatement cost of urban scale building and energy system interventions.
- Intermingling of climate change mitigation and adaptation strategies in a decision making framework for development planning.
- The inclusion of embodied carbon as a metric in determining carbon emissions and marginal abatement cost.
- Contribution of an open-dataset of simulated demand, cost, and emissions for use in reanalysis and further studies.

Practical Implications

Open-source simulation tools can be used to test the sensitivity of different decarbonisation and adaptation strategies for an urban area, allowing planners better models to make well-informed planning decisions. The resulting visualizations of this study offer

a sample of this, as well as an example of a comprehensive urban building energy model. The results also raise questions about decarbonization pathways in British Columbia after strategies such as fuel switching are implemented, reducing the majority of emissions, but not entirely creating zero-carbon communities.

Introduction

Atmospheric concentrations of carbon dioxide are just over 410 parts per million, while recent estimates from the National Centers for Environmental Information (2020) situate the Northern Hemisphere's land and ocean surface temperature anomaly at 1.29°C from baseline (1961-1990). This may not be considered a consistent level of *global warming*, but it does indicate a dangerous warming trend facing human and non-human systems. Climate change impacts are now being recognized as burdens on economic and social systems (Frame et al., 2020). Implementing adaptation strategies within the built environment is necessary to increase social resilience, protect safety and life, and prevent economic damage with the potential to bolster all of the above (Schünemann et al., 2020). Simultaneously, the mitigation of present emissions, the abatement of possible future emissions, and the sequestration of atmospheric carbon is necessary to curtail increasingly dangerous and catastrophic levels of warming. This process of carbon drawdown is very familiar within studies of the built environment with strategies posed for transportation, buildings, agriculture, forestry, and other land-uses. Mitigation and adaptation strategies though are rarely evaluated simultaneously in the context of urban development.

In the presence of limited resources and a range of objectives, the cost and benefit of proposed strategies need to be assessed on their own and while interacting with other strategies, as well as under the uncertainty of climate change and human action. The interaction of strategies is a key factor explored in Rysanek and Choudhary (2013), where exhaustive simulation is applied in the modeling of fifteen individual building retrofit strategies (a total of 32,768

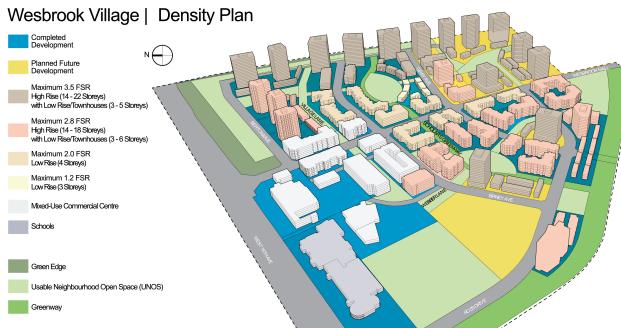


Figure 1: The baseline UBEM for Wesbrook Village in BC.

unique combinations). From this, a database of simulated retrofit-specific pathways for a single building can be generated.

Introducing the scale of a neighborhood or even entire city requires a more extensive modelling framework as described above, as well as the consideration of additional sources of model uncertainty attributed to urban-scale matters. No longer would a model be concerned with answering a single question about a single existing building - how do we mitigate the most carbon at the lowest price? Now, the model would be applied in the context of an existing area where buildings and empty plots could face a *known-unknown* trajectory of either new development, redevelopment, and no change. This brings in the concept of a development timeline during which differing scales of development may occur.

This study integrates several climate adaptation strategies into the urban-scale energy simulation process. Adaptation strategies are evaluated on the basis of marginal costs of mitigation *and* adaptation, vis-a-vis the influence of individual design strategies on the resilience of the urban development to expected climate change. This study will simulate the performance of eight climate mitigation and adaptation strategies alongside one urban development trajectory and two climate change scenarios. The simulations will be also carried out at two individual time periods (2050 and 2080), for a case study community in southwestern Canada: Wesbrook Village, Vancouver, British Columbia (BC). A baseline urban building energy model (UBEM) was created to represent the development of the community to-date.

Wesbrook Village

Wesbrook Village is a new residential community under construction by the University of British Columbia (UBC) (UBC Planning, 2020a,b). On its completion within the next decade, the community will provide permanent housing for over 25,000 residents of Vancouver, BC primarily in mid-rise (4-6 stories) and high-rise residential towers (15-30 stories).

The development, referred to throughout the study as

Wesbrook, is a compelling case study as it can be considered a model of medium-density new development for BC and North America at large. For example, Wesbrook was developed under the auspices of a progressive building code, overseen by UBC, that targets all new campus residential developments to satisfy net-zero energy ready (NZER) performance levels by 2032.

Buildings of the Wesbrook community make use of mix of energy systems. Some buildings provide space heating through hydronic in-floor radiant systems; some through electric baseboard heaters. Some buildings operate dedicated boilers for generating hot water; other buildings receive hot water from a natural gas-fired district energy system. This district heating system is described in the context of a UBEM in McCarty and Rysanek (2020). Centralized space cooling has not been provided for across the development, but concerns around the potential need for future space cooling is a growing concern for naturally-ventilated buildings in the region (Rysanek et al., 2021). With its current building codes, UBC does intend that space cooling may be a required energy service in the community in the next decade (UBC Planning, 2021).

Retrofit and New Development Trajectory

The majority of Wesbrook has been completed as of 2020, with 50% of the total expected build-out of 725,925 sqm. remaining to be constructed. As indicated in Figure 1 the yet-to-be-completed development will be assessed in the model through the future periods. The Wesbrook planning and development scheme is well laid out in master-planning documents (UBC Planning, 2020b). The simulation framework is built from a baseline in 2020 of the completed development up to 2020. Two more time periods are simulated, the first in 2050 and then in 2080. The base-case for each time period assumes that the stock of buildings that were simulated in the previous time-step (existing) were retrofitted with similarly performing technologies and components. New buildings are however built to a performance profile modeled after expected changes in the community's building performance code ((UBC Planning, 2021)).

Mitigation and adaptation decision tools

Rysanek and Choudhary (2013) expanded on the use of marginal abatement cost curves as a tool for planning retrofit pathways in single building optimization. The authors commentary was that by failing to consider technical and economic interactions MACCs such as those proposed by McKinsey & Co. (2010) were more *illustrative* than planning tools. Without accounting for the additionality of measures many MACCs fall into this grouping and limit their overall effectiveness. Kesicki and Ekins (2012) acknowl-

Table 1: Each strategy as it was applied in the simulations.

Strategy	Description	Scale	Embodied CO _e Source
Adjust Comfort Threshold	Raise cooling setpoints 1C and reduce heating setpoints 1C	All Buildings	N/A
Green Roof	Install green roofs for insulation, albedo, and heat gain benefits.	All Buildings	(Jones, 2019)
Deep Envelope and HVAC Retrofit	Install heat pumps for space heating and DHW along with high performance shells and reduced window-wall ratios	Existing Buildings	(Jones, 2019; Rodriguez et al., 2019)
Passive House	Require passive house building codes for envelope.	New Buildings	(Jones, 2019)
Heat Pumps	Install heat pumps for space heating, cooling and DHW.	All buildings	(Rodriguez et al., 2019)
Mass Timber	Construction must utilize mass timber.	New Buildings	(C-Change Labs, 2020)
Seawater Cooling Loop	Buildings get space cooling from heat pump that is amplified with a seawater cooling loop	All Buildings	(Corix, 2014a; Jones, 2019)
Rooftop Photovoltaic	Install grid-tied rooftop solar with net-metering	All Buildings	(Jones, 2019)

edges temporal interactions as an additional dimension that need to be considered when constructing MACCs. Traditionally MACCs were developed for annual-planning and more recently, as ambition has grown, so too have their temporal scales. These interactions can be summarized as understanding how investments made in the past may affect the outcome of the MACC, similar to the issue of technical and economic interactions. In planning buildings or infrastructure with MACCs this becomes a significant feature to consider as selecting investments to implement, one typically does so along an investment pathway.

It is also of particular importance when developing infrastructure or buildings to consider the impact of a changing climate. Adaptation is prevalent in designing buildings in proximity to rising seas, with strategies ranging from hard measures such as levees and dams to soft measures such as wetland restoration (Pachauri et al., 2015). Evidence is pointing to the need to consider other impacts, such as overheating risk due to generally warmer days, nights with less cooling capacity, and more intense heat waves (Lomas and Porritt, 2017; Rysanek et al., 2021). Measuring adaptation is a contentious field, as what defines successful adaptation is not as simple to calculate as net carbon emissions (Pachauri et al., 2015). Brooks (2011) suggests several general criteria by which successful adaptation can be assessed: feasibility, efficacy/effectiveness, efficiency, acceptability/legitimacy, equity, and sustainability. The same authors also discuss the concept of *Maladaptation*, or the inadvertent increase in vulnerability to climate change as a result of development, which has equal importance to adaptation planning of buildings. For all criteria though, measures begin with assessing vulnerability of a subject to a stressor or collection of stressors. In the case of coastal development, a building's adaptive capacity and success can be measured by its vulnerability to increasingly intense sea level rise and storm surge. In the case of this study the stressor is heat gain and the vulnerability of a building to overheating.

Methods

Urban Building Energy Model (UBEM)

The simulation framework utilizes an extension of the City Energy Analyst (CEA) demand forecasting model (Fonseca et al., 2016; The CEA team, 2020). The CEA enables simulations of urban and neighborhood scale energy systems, as well as independently operating buildings.

The constructed UBEM consists of a base-case of development and two future states of development, one in 2050 and another in 2080. The base-case was simulated once to tune the model. Each of the future states of development were simulated once for each combination of strategies under both climate change scenarios for a total of 1024 simulations.

The EnergyPlus Weather (EPW) file for Vancouver, BC produced by Engineering Climate Services Canada (2016) was morphed, following the algorithms set out by Belcher et al. (2005) and expanded upon by Jentsch et al. (2008). A 25-member ensemble of climate model output data from Climate Model Intercomparison Project 6 (CMIP6) models was used in the morphing process. Two climate pathways are followed, discussed in this paper as the *best-case* and *worst-case* scenarios. These are *Shared Socioeconomic Pathway 1* (SSP126) and *Shared Socioeconomic Pathway 5* (SSP585) defined in O'Neill et al. (2017). Two morphed climate files were produced at 2050 and 2080 for each pathway.

Climate mitigation and adaptation strategies

Eight mitigation and adaptation strategies were selected to evaluate under the development pathways and climate change pathways. The strategies, described in Table 1, reflect larger interventions into either existing buildings, new buildings, both, or the underlying energy system in the community. A strategy is implemented alone as well as in combination with the other seven to understand its range of potential impacts, which assists the decision-making framework in determining a pathway to implement strategies.

Adaptation was considered as the capacity of a building to remain within its comfort threshold while also mitigating carbon emissions. The threshold considered is between 18°C and 26°C. For each building in each strategy-set the total amount of hours that interior temperature exceeds the threshold is counted. The median value from the buildings is then taken as the adaptation metric for each strategy-set.

Simulation

For each development period and under each climate change pathway the same eight strategies for carbon mitigation and climate change adaptation to a changing climate were evaluated for their marginal cost of carbon abatement. The simulation procedure for each scenario began with the base-case, under which no strategies were implemented, following with 255 iterations where strategies were implemented alone and in combination with each other. This was repeated across both development pathways and both climate change pathways, leading to 1024 total simulations undertaken by the UBEM.

Total Annualized Cost

Components and technology costs were gathered through several data sources, (Corix, 2014a; Schlueter et al., 2016; Salasovich et al., 2016; Kegel et al., 2012; Gordian, 2020). Cost is a highly uncertain data point to incorporate into building energy models. Cost is assessed as the net difference between a strategy-set and the baseline, each calculated as the 30-year total annualized cost (TAC), shown in Eq. 1, from within the City Energy Analyst, applying a 5% discount rate, which was chosen after consulting the local developers and planners.

$$C_{ann,tot} = CRF(i, R)C_{NPC,tot} \quad (1)$$

Total Annualized Cost is the annualized value of the total net present cost where CRF is the Cost Recovery Factor, requiring i , the annual real discount rate, and R , the lifetime considered. $C_{NPC,tot}$ is the total net present cost for the lifetime considered.

Operational and embodied carbon

Operational carbon is taken as the carbon emitted over a 30 year period from each building as a result of energy consumption for plug-load, heating and cooling, and ventilation service. BC's electrical grid is served by a hydroelectric power provider and is a low-carbon source, at 10.8 kgCO₂e/kWh (BC Ministry of Environment, 2019). The district heating provider intends for the system to be fed entirely from natural gas boilers until 2023 at which point there will be a transition to a more complex system of natural gas peaking boilers and waste-heat primed electric heat pumps. This system was previously modelled in McCarty and Rysanek (2020). Its carbon intensity was estimated to be between an annual average of 10.8 and 180.0 kgCO₂e/kWh. The range is due to

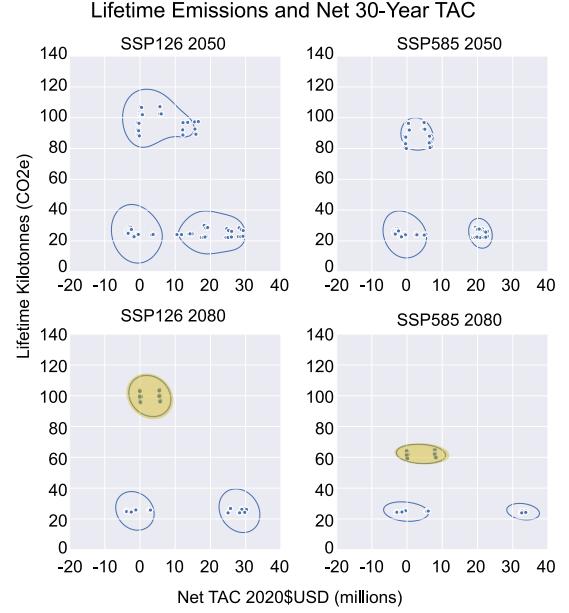


Figure 2: General results from the iterations presented across total emissions over 30 years and net 30-year total annualized cost.

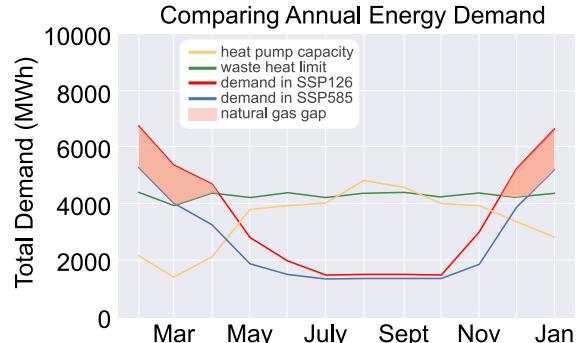


Figure 3: Here we compare the demand on the district heating system and show, in the highlighted gap, where less natural gas was used due to the generally warmer winter in SSP585.

fluctuations in the amount of natural gas used in the system, as well as the amount of waste heat available to create a more efficient lift in the heat pumps. Limits imposed on heat pump and waste heat capacity are drawn from the operator in Corix (2014b).

The embodied carbon of components and technologies of the models was gathered, similar to the cost data, from a variety of sources (Jones, 2019; Drogue, 2019; C-Change Labs, 2020), and are cradle-to-gate. The limitation with disparate data sources in this portion of the research generally has to do with the geography of the components involved. An effort was made to first gather data from sources specific to the BC or the Pacific Northwest region of the US and then from North America as a whole, before seeking data from further away.

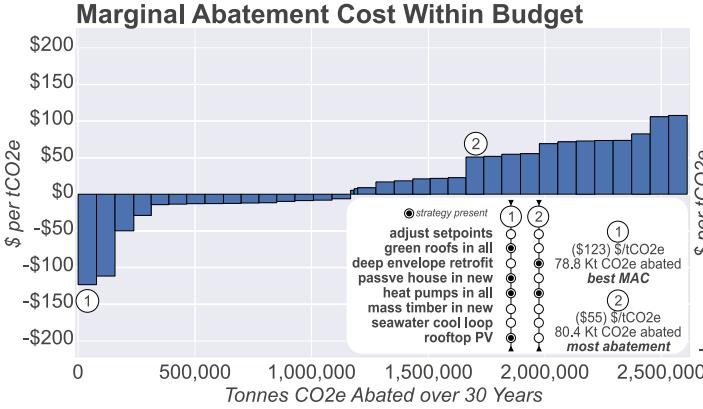


Figure 4: Illustrative MACC made assuming a budget of \$11 million in net cost was permitted for any plotted strategy-set.

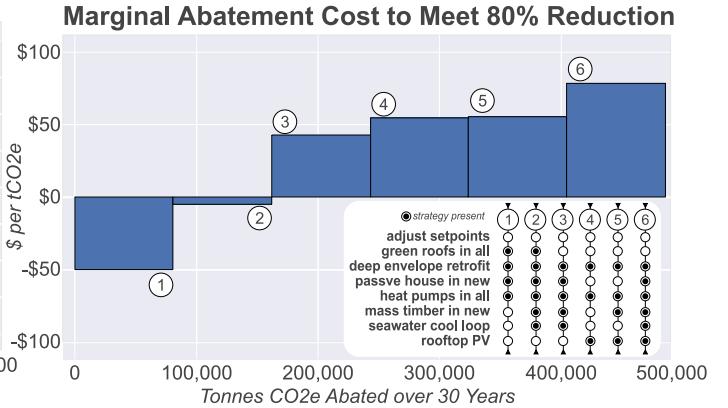


Figure 5: Illustrative MACC made assuming an emissions reduction threshold of 80% was necessary for any plotted strategy-set.

Results

The simulation procedure was executed for 1024 scenarios, producing hourly demand results for each building within the simulation space, as well as annual cost and emissions results for each building. For iterations in which rooftop-photovoltaic was an option a set of results was generated to be used in correcting total grid-demand for the electricity generated by the rooftop-photovoltaic. From these iterations several MACCs were constructed in Figures 4, 5, and 6. The first two are *illustrative* MACCs in that they present a set of possible interventions, but not necessarily a pathway through which those interventions can be connected. The latter two are *true* MACCs as described in 6.

General Performance

Figure 2 displays net-cost and gross emissions for each iteration within each of the four scenarios. Three groups tend to emerge with the most stark difference being that one group is emitting far more than the other two. This is a result of those scenarios still relying on the natural-gas based heating system. This difference is apparent across both climate change pathways, leading to a conclusion that the impacts of a more severe future climate is not disrupting mitigation efforts as predicted by the model. It appears to enable it to an extent. Comparing the highlighted groups of similar strategy-sets between the best-case and worst-case scenarios a decrease in lifetime emissions is apparent. We suspect that this is due to the warmer temperatures reducing the heating seasons as well as enabling the district to remain below the heat pump capacity more of the year. Figure 3 shows this in the operation of the district in the baseline cases from each climate scenario

Visualizing decision making

MACCs were drawn as another form of visualising decision making. Figure 4 is not a *true* MACC in that you can only implement one of the strategy-sets,

represented by the bars. However, it improves on previous *illustrative* MACCs in that the bars do not unnecessarily represent single strategy interventions, but rather a set of strategies. It was drawn to assist in planning under the assumption that planners are expecting a worst-case climate change scenario by the end of the century and have set a budget of an additional \$11,000,000 that could be invested across the development on mitigation and adaptation strategies. The drawn MACC then presents every possible combination under the development and climate change trajectory that falls below the budget, selecting 01011001 at the marginal abatement cost of -\$123. Another *illustrative* MACC was drawn, seen in Figure 5 assuming an emissions reduction threshold of 80% by 2050 under the best-case climate scenario. All bars represent strategy-sets that would reach that reductions total, ultimately 0111000 is chosen at the marginal abatement cost of -\$50.

Of the two *true* MACCs used in this study, the first represents a strategy-set that was chosen based on a high degree of adaptability present, while also abating a large amount of emissions. This was done under the worst-case climate scenario and the selected strategy-set is 00011111 is highlighted in Figure 7. Marginal abatement cost and the adaptation metric were plotted in Figure 7 to evaluate optimal fronts of each scenario.

Figure 6 describes how each strategy contributes to the overall decrease in emissions. The MACC is shown in Figure 6 where the first strategy, the installation of heat pumps in all buildings to service space heating and cooling as well as domestic hot water, contributes to the bulk of the emissions reduction. This is due to the impact that moving away from the district heating system, which has the potential to use natural gas if heating and DHW load exceeds the district's heat pump capacity. The majority of the abatement can be attributed to the heat pump strategy, removing natural gas from the fuel

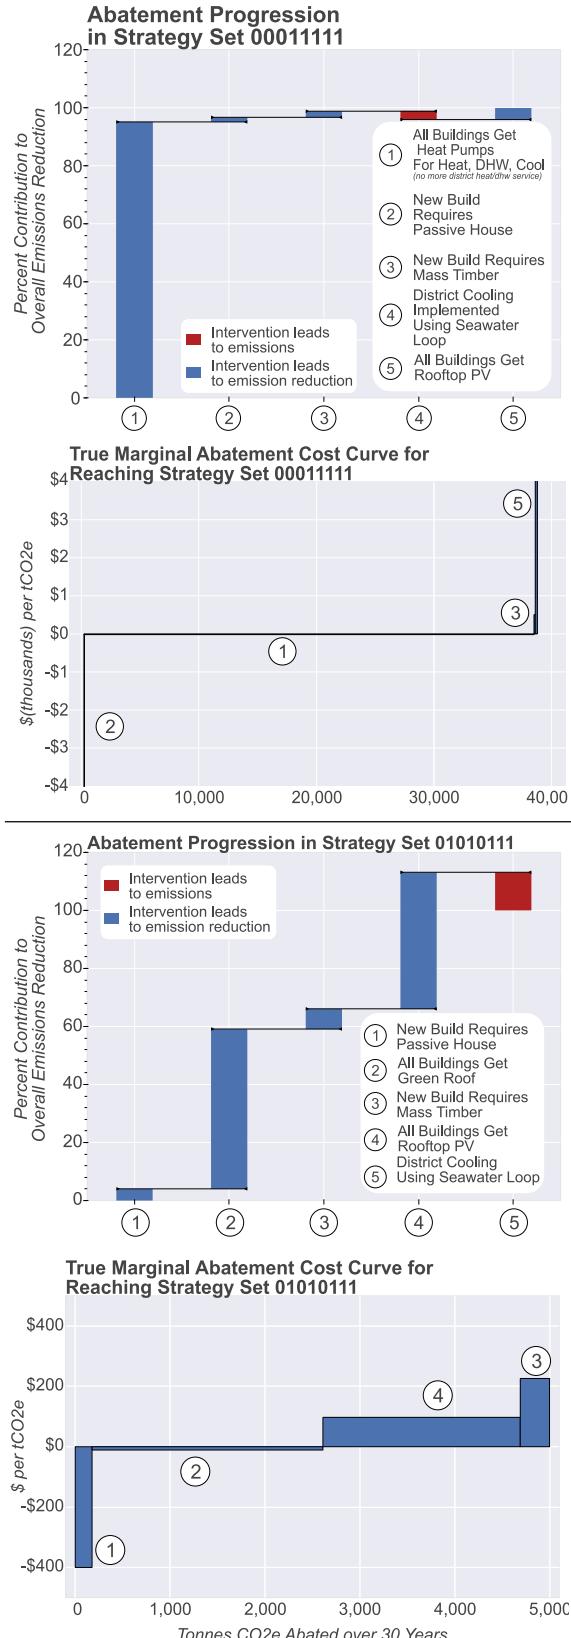


Figure 6: Here two sets of plots are shown for two strategy sets. The top of each set shows the contribution of each strategy to the the strategy set's overall carbon emissions reduction. The bottom shows the MAC breakdown within each strategy set.

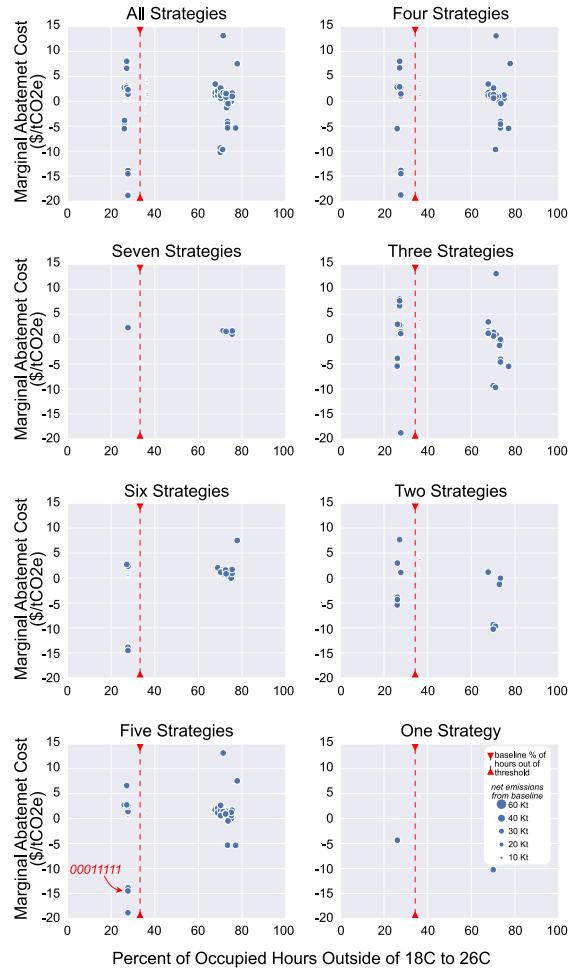


Figure 7: Plotting marginal abatement cost and the adaptation metric to serve as a canvas for pathway planning.

mix, while the other strategies can be said to lending to adaptability. This point about the fuel mix will be returned to more in the discussion, but raises that question about how to affordably meet zero-carbon targets after fuel-switching has been achieved. This scenario only achieves 67% emissions reduction over the baseline by 2080.

A second *true* MACC was generated under the plan to abate as much carbon as possible while continuing to use the district heating system, under the worst-case climate scenario. Figure 6 describes how each measure contributes to overall emissions reduction. The resulting MACC shows a more consistent scale of MAC and overall abatement between measures than the previous example, but total abatement is only 8% of the baseline's emissions.

Discussion

Abatement after fuel-switching

The context for this study sets up an interesting proposition within BC. Electricity in BC is provided primarily via hydroelectricity; the electrical gird is

considered 98% clean energy (BC Ministry of Environment, 2019). Emissions within the building sector are therefore driven by natural gas use, either on-site or within district systems. The two *true* MACC cases show that in order to reach large reductions over the baseline condition, the use of natural gas must be eliminated. This however raises the point of how abatement should continue once the significant reductions are made and systems are then relying on a near-carbon-free grid. At present, BC (and UBC) expects new buildings to be net-zero *energy* ready by the early 2030s, with no clear objectives on whether buildings should be truly net-zero energy (NZE) in a more distant future. There is reason for this, as evidenced by the modelling undertaken in this work. This study showed that in testing rooftop PV systems for medium density developments, PV systems will not yield large emissions reductions under any scenario. In the worst-case climate scenario rooftop panels alone reduced emissions by only 4.4%.

Additionally building-based sequestration methods offer a potential avenue for meeting net-zero *carbon* goals (Skullestad et al., 2016). This study did not consider the Mass Timber strategy to be carbon sequestering, but it is less intensive than cement-based building, leading to between 60 and 300 Tonnes of carbon abated, depending on the development scenario. An increase in emissions is seen with the implementation of a seawater cooling loop, likely due to the fact that conventional methods of space cooling rely on a near-zero carbon grid to begin with and are not as intense from an embodied carbon perspective.

Limitations of approach

The first limitation of this study lies in the not-so-explicit temporal interaction of the interventions. Each building was modeled as having its own unique construction and retrofit dates, which contribute to the emissions and total annualized cost profile for each run of the district energy model. While unique in their start and end date they are all set on a 30-year time horizon for all elements replacement. For some building technologies this may be a realistic time horizon for design-life, for many others it is not. Future efforts need to consider equipment and technology replacements more actively while also engaging the temporal simulation steps at more fine scales, possibly ten-years.

A major limitation in the framework underpinning this study is the finite space of strategy choice. We test eight strategies here that are applied generally across the district. This may not always be a problem if prior to the study a strategy evaluation is conducted or subject-matter experts are brought in to help establish priors. Future efforts need to be more precise with strategy implementation based on building or site need.

In creating the morphed weather files, we used cli-

mate model data from global climate models and not regional climate models. This is typical practice for morphing, particularly if you want to adjust weather variables beyond temperature. However it is a limitation particularly in a region such as Southwestern, BC that is highly mountainous and coastal. Future efforts for morphing should address these limitations with climate model data that is either regionally generated or downscaled.

The increase in cost of energy services was not accounted for dynamically. It would be expected, particularly in a country with a progressive carbon tax, that the cost of natural gas and electricity will increase over the coming decades, and outpace inflation-related increases. Future analysis must take this into account, as well as seek to differ the increase across climate change scenarios, which have different economic assumptions underpinning their respective increases in greenhouse gas emissions.

Conclusion

In this study the output of 1024 different urban building energy simulations was used to generate marginal abatement cost curves and complimentary visualizations to make decisions on climate mitigation and adaptation at an urban scale. A case study of Westbrook Village, a planned 25,000-member residential community in Vancouver, Canada was used.

The resulting MACCs were created from two perspectives. First the *illustrative* MACCs (Figures 5 and 4) sought to provide general guidance on which strategies achieve targeted mitigation under different planning constraints. The *true* MACCs (Figure 6) reveal how the individual strategies within a set interact technically and financially to ultimately abate a certain amount of carbon. The candidate for the one of the *true* MACCs was selected based on a mixture of adaptation and mitigation criteria.

The analysis had limitations discussed in the literature on using MACCs for decision-support. These include being more realistic about building technology and component lifetimes, which requires the framework to consider retirement. As well the study is constrained by computational resources (each 1024 iteration took 64 hours) and known mitigation and adaptation strategies for the site. Future studies should seek to better understand either through exploratory analysis or expert elicitation, which strategies are reasonable for the market and context. This will also aide in developing a cost and carbon database.

The results of the simulation provide more than an example for decision-support visualization. In comparing the results we see a large difference in abatement between systems that continue to rely on natural gas into the latter half of the century and those that transition to a hydroelectric fed grid. The large jump between the two provokes the thought of how

deep emissions reductions will be achieved when demand from space heating, cooling, DHW, and plug load are being met by affordable near-zero carbon electricity.

Acknowledgment

This project was funded by the Pacific Institute for Climate Solutions (PICS) Energy Efficiency in the Built Environment Project (grant number PICS 36170-50280).

References

- BC Ministry of Environment (2019). BC Hydro Methodological Guidance For Quantifying Greenhouse Gas Emissions.
- Belcher, S. E., J. N. Hacker, and D. S. Powell (2005, January). Constructing design weather data for future climates. *Building Services Engineering Research & Technology; London* 26(1), 49–61.
- Brooks, N. (2011). Tracking adaptation and measuring development. OCLC: 824360250.
- C-Change Labs (2020, November). Embodied Carbon in Construction Calculator (EC3) Tool.
- (2014a, August). *CPCN Application for The University of British Columbia Neighbourhood District Energy System Project*.
- Corix (2014b, September). Infrastructure Agreement by and between The University of British Columbia and Corix Multi-Utility Services Inc. BCUC Filing Copy.
- Droguett, B. X. R. (2019). *Embodied Carbon of Heating, Ventilation, Air Conditioning and Refrigerants (HVAC+R) Systems*. Ph. D. thesis, University of Washington, College of the Built Environment, Seattle, WA.
- (2016). *Canadian Weather Energy and Engineering Datasets*.
- Fonseca, J. A., T.-A. Nguyen, A. Schlueter, and F. Marechal (2016, February). City Energy Analyst (CEA): Integrated framework for analysis and optimization of building energy systems in neighborhoods and city districts. *Energy and Buildings* 113, 202–226.
- Frame, D. J., S. M. Rosier, I. Noy, L. J. Harrington, T. Carey-Smith, S. N. Sparrow, D. A. Stone, and S. M. Dean (2020, September). Climate change attribution and the economic costs of extreme weather events: a study on damages from extreme rainfall and drought. *Climatic Change* 162(2), 781–797.
- Gordian (2020). RSMeans Online: BC Corrected.
- Jentsch, M. F., A. S. Bahaj, and P. A. B. James (2008, January). Climate change future proofing of buildings—Generation and assessment of building simulation weather files. *Energy and Buildings* 40(12), 2148–2168.
- Jones, C. (2019, November). ICE Database.
- Kegel, M., R. Sunye, and J. Tamasauskas (2012). Life Cycle Cost Comparison and Optimisation of Different Heat Pump Systems in the Canadian Climate. In *Proceedings of eSim 2012: The Canadian Conference on Building Simulation*, Halifax, Nova Scotia, pp. 492–505. IBPSA.
- Kesicki, F. and P. Ekins (2012, March). Marginal abatement cost curves: a call for caution. *Climate Policy* 12(2), 219–236.
- Lomas, K. J. and S. M. Porritt (2017, February). Overheating in buildings: lessons from research. *Building Research & Information* 45(1-2), 1–18. Publisher: Routledge eprint: <https://doi.org/10.1080/09613218.2017.1256136>.
- McCarty, J. and A. Rysanek (2020, September). (accepted). Climate Change Impact on Utility of District Heating in New Development Context. In *eSIM2020 Conference Proceedings*, Vancouver, BC. International Building Performance Simulation Association.
- (2010). *Climate Change Special Initiative – Greenhouse Gas Abatement Cost Curves*.
- NOAA (2020, October). *State of the Climate: Global Climate Report for October 2020*.
- O'Neill, B. C., E. Kriegler, K. L. Ebi, E. Kemp-Benedict, K. Riahi, D. S. Rothman, B. J. van Ruijen, D. P. van Vuuren, J. Birkmann, K. Kok, M. Levy, and W. Solecki (2017, January). The roads ahead: Narratives for shared socioeconomic pathways describing world futures in the 21st century. *Global Environmental Change* 42, 169–180.
- Pachauri, R. K., L. Mayer, and I. P. on Climate Change (edited by) (2015). *Climate change 2014: Synthesis Report*. Geneva, Switzerland: Intergovernmental Panel on Climate Change. OCLC: 914851124.
- Rodriguez, B. X., L. Amany, and K. Simonen (2019, August). Embodied and Operational Carbon of Typical Heating, Ventilation and Air Conditioning (HVAC) Systems in Office Buildings in Washington State: A study of buildings registered under LEED v3 2009. *IOP Conference Series: Earth and Environmental Science* 294, 012057. Publisher: IOP Publishing.
- Rysanek, A. and R. Choudhary (2013, August). Using building simulation to create marginal abatement cost curves of individual buildings. In *Proceedings of BS2013*, Chambéry, France, pp. 1877–1884. IBPSA.
- Rysanek, A., R. Nuttall, and J. McCarty (2021, March). Forecasting the impact of climate change on thermal comfort using a weighted ensemble of supervised learning models. *Building and Environment* 190, 107522.
- (2016, January). *Energy Efficiency, Water Efficiency, and Renewable Energy Site Assessment: Mendenhall Glacier Visitor Center, Juneau, Alaska*.
- Schlueter, A., A. Rysanek, C. Miller, J. Pantelic, F. Meggers, M. Mast, M. Bruegisauer, and C. Kian Wee (2016). 3for2: realizing spatial material and energy savings through integrated design. *CTBUH Journal* (II), 40–46.
- Schiunemann, C., A. Olfert, D. Schiela, K. Gruhler, and R. Ortlepp (2020, May). Mitigation and adaptation in multifamily housing: overheating and climate justice. *Buildings and Cities* 1(1), 36–55. Number: 1 Publisher: Ubiquity Press.
- Skullesstad, J. L., R. A. Bohne, and J. Lohne (2016, September). High-rise Timber Buildings as a Climate Change Mitigation Measure – A Comparative LCA of Structural System Alternatives. *Energy Procedia* 96, 112–123.
- The CEA team (2020, December). City Energy Analyst v3.15.0.
- The University of British Columbia (2020a). *UBC Stadium Neighbourhood Plan*.
- The University of British Columbia (2020b, April). *UBC Westbrook Place Community Plan*.
- UBC Planning (2021, January). Residential Environmental Assessment Program (REAP) 3.2.