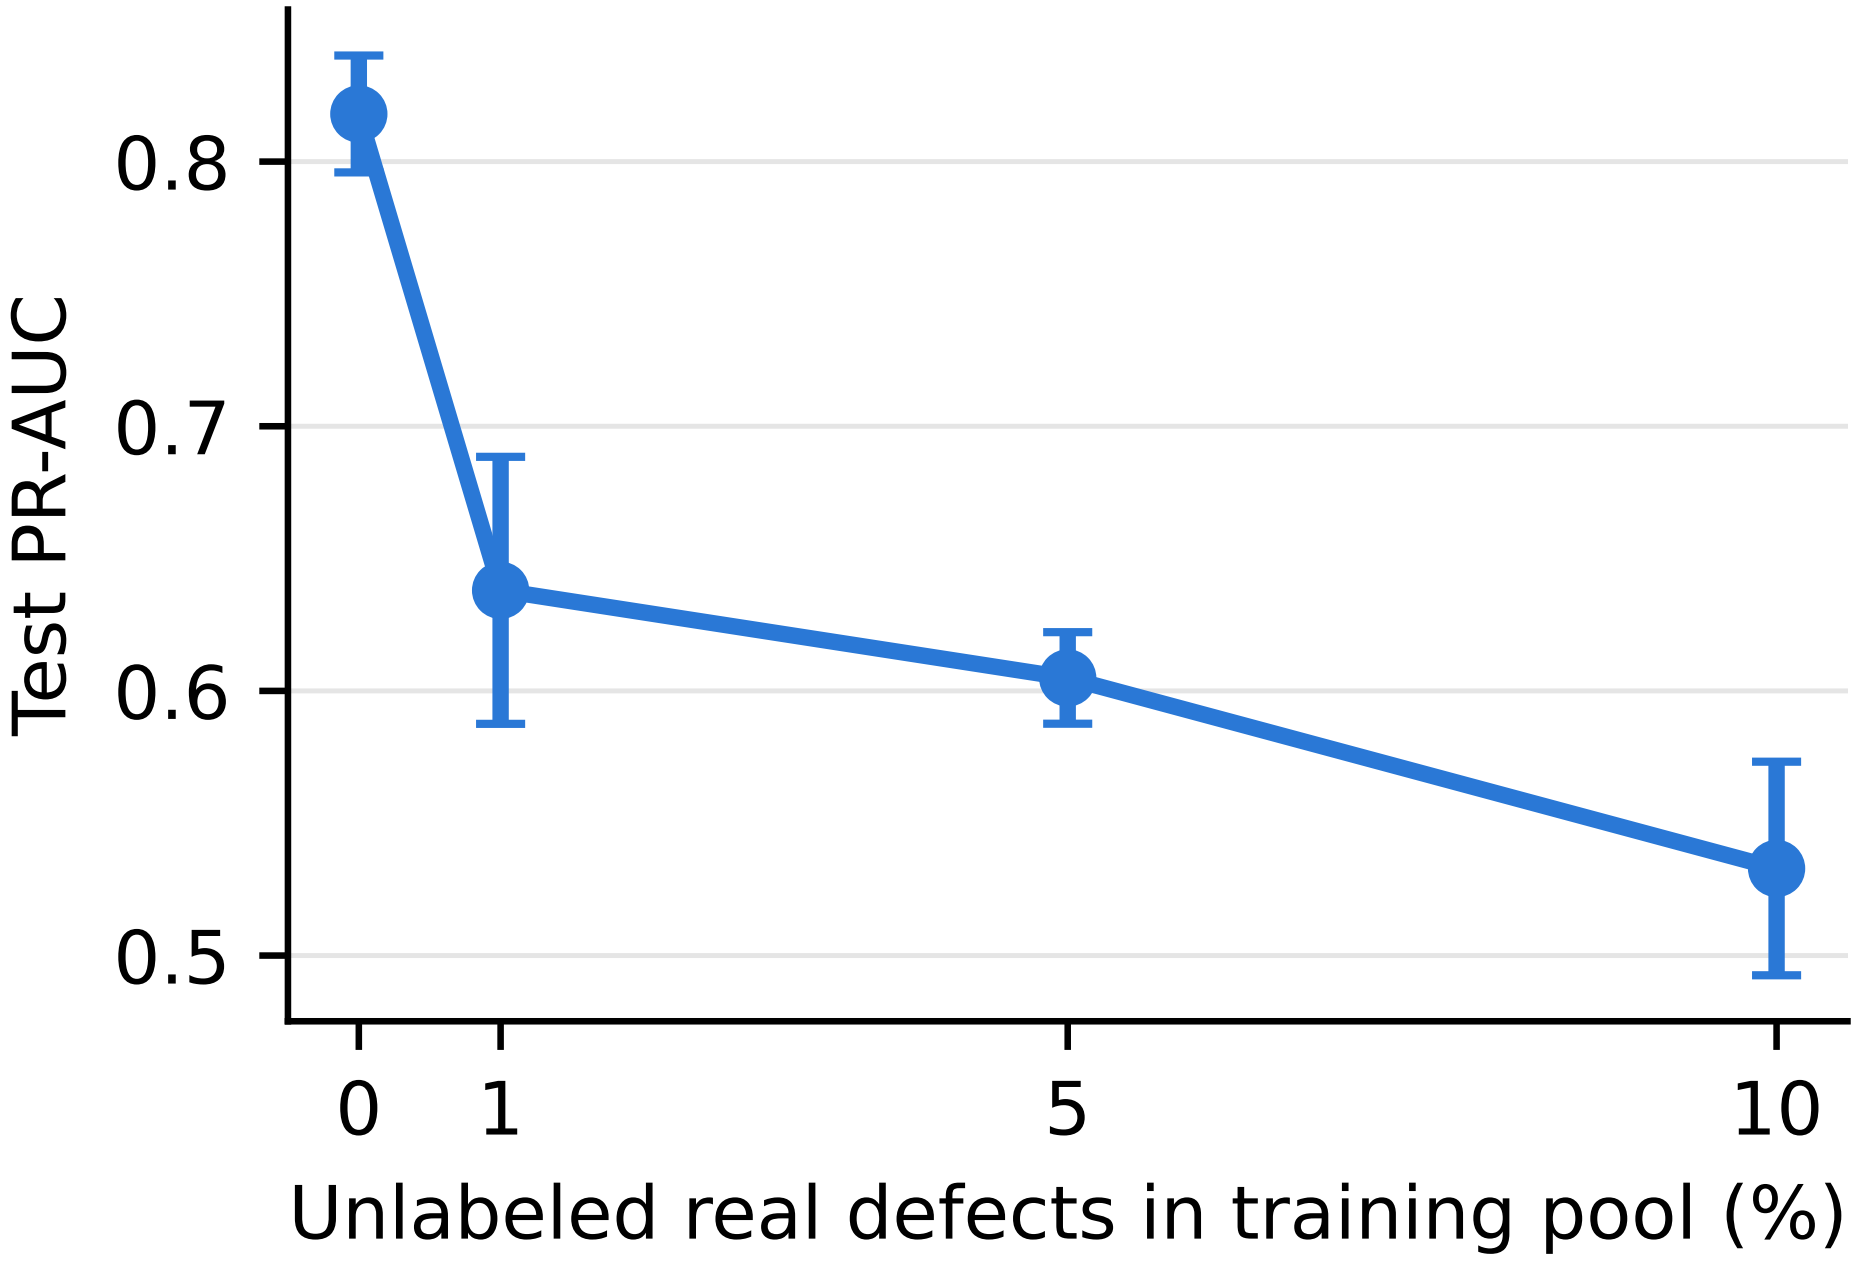
0.8
0.7
0.6
0.5
Test PR-AUC
0
1
5
10
Unlabeled real defects in training pool (%)