McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Hut Ten

Location ID: B010

Used as a community center for parties and conferences. Includes living and dining rooms, a kitchen, three bedrooms, and two bathrooms. It also provides special housing for distinquished visitors (DV's).



Photo 1: *Hut Ten*

General Structure Information

Usage	Community Center (Hut 10)
Occupancy Group	A-3 Assembly
Maximum Occupancy	60
Construction Type	Type V, N, combustible; T-5 plywood panel structure, aluminum siding, wood-framed plywood floor, wood-framed plywood and sheetmetal roof, wood-framed gypsum board interior partitions.
Year Constructed	1957 with a major remodel in 1988
Dimensions	61'6" x 24'

Floor Area

Floor	Area
Floor 1	1,476 sq ft
Total	1,476 sq ft

HVAC System

Heating	One Lennox forced-air, oil-burning furnace (130,000 Btu/hr)
Air Handling Units	None

Fuel Tank	300 gallon fuel tank

Water and Sewer

Water Service	2" stub off the 4" main
Sewer Service	4" stub off the 4" main
Connections	Sinks: 3 Toilets: 2 Showers: 2 Washer: 1 Dryer: 1 Dishwasher: 1
Water Heater	66 gallon, electric water heater located in furnace room.

Electrical Service

Service Feeder	Feeder B
Electrical Service	208/120V, 3PH, 125A Main

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrual radio and control system (IRACS) panel, pull stations, and alarm horns
Heat Detectors	Hallway, bathrooms, and kitchen
Suppression Type	Automatic dry-chemical fire extinguisher located over furnace.

Floorplans

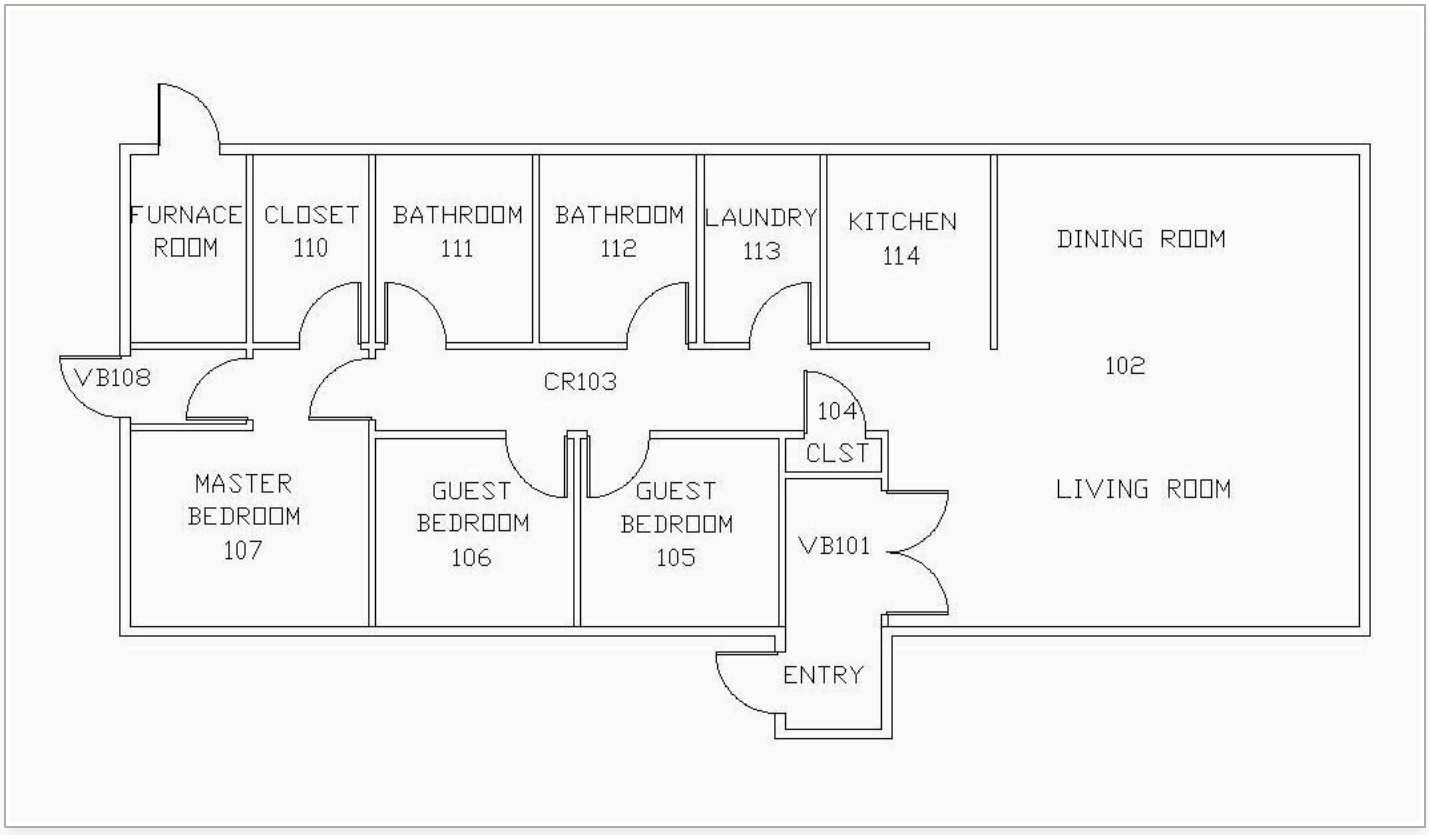


Figure 1: *Hut Ten*