McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Equipment Operations

Location ID: B017

Single-story, skid-mounted building used as office space and tool storage for the Equipment Operations work center.



Photo 1: *Equipment Operations*

General Structure Information

Usage	Equipment Operations office
Occupancy Group	B-2 Office
Maximum Occupancy	3
Construction Type	Type V, N, combustible; single story, wood- framed structure with plywood exterior sheathing finished with sheet metal siding. Wood-framed, wood-paneled interior walls.
Year Constructed	Unknown
Dimensions	16' x 24'

Floor Area

Floor	Area
Floor 1	384 sq ft
Total	384 sq ft

HVAC System

Heating	One Lennox forced-air, oil-burning furnace (84,000 Btu/hr)
Air Handling Units	None

Fuel Tank	300 gallon fuel tank

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Fountains: 0
Water Heater	None

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH, 100A Main

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat detectors, pull station, alarm horns.
Heat Detectors	Located throughout building
Suppression Type	Automatic dry-chemical fire extinguisher located over furnace.

Floorplans

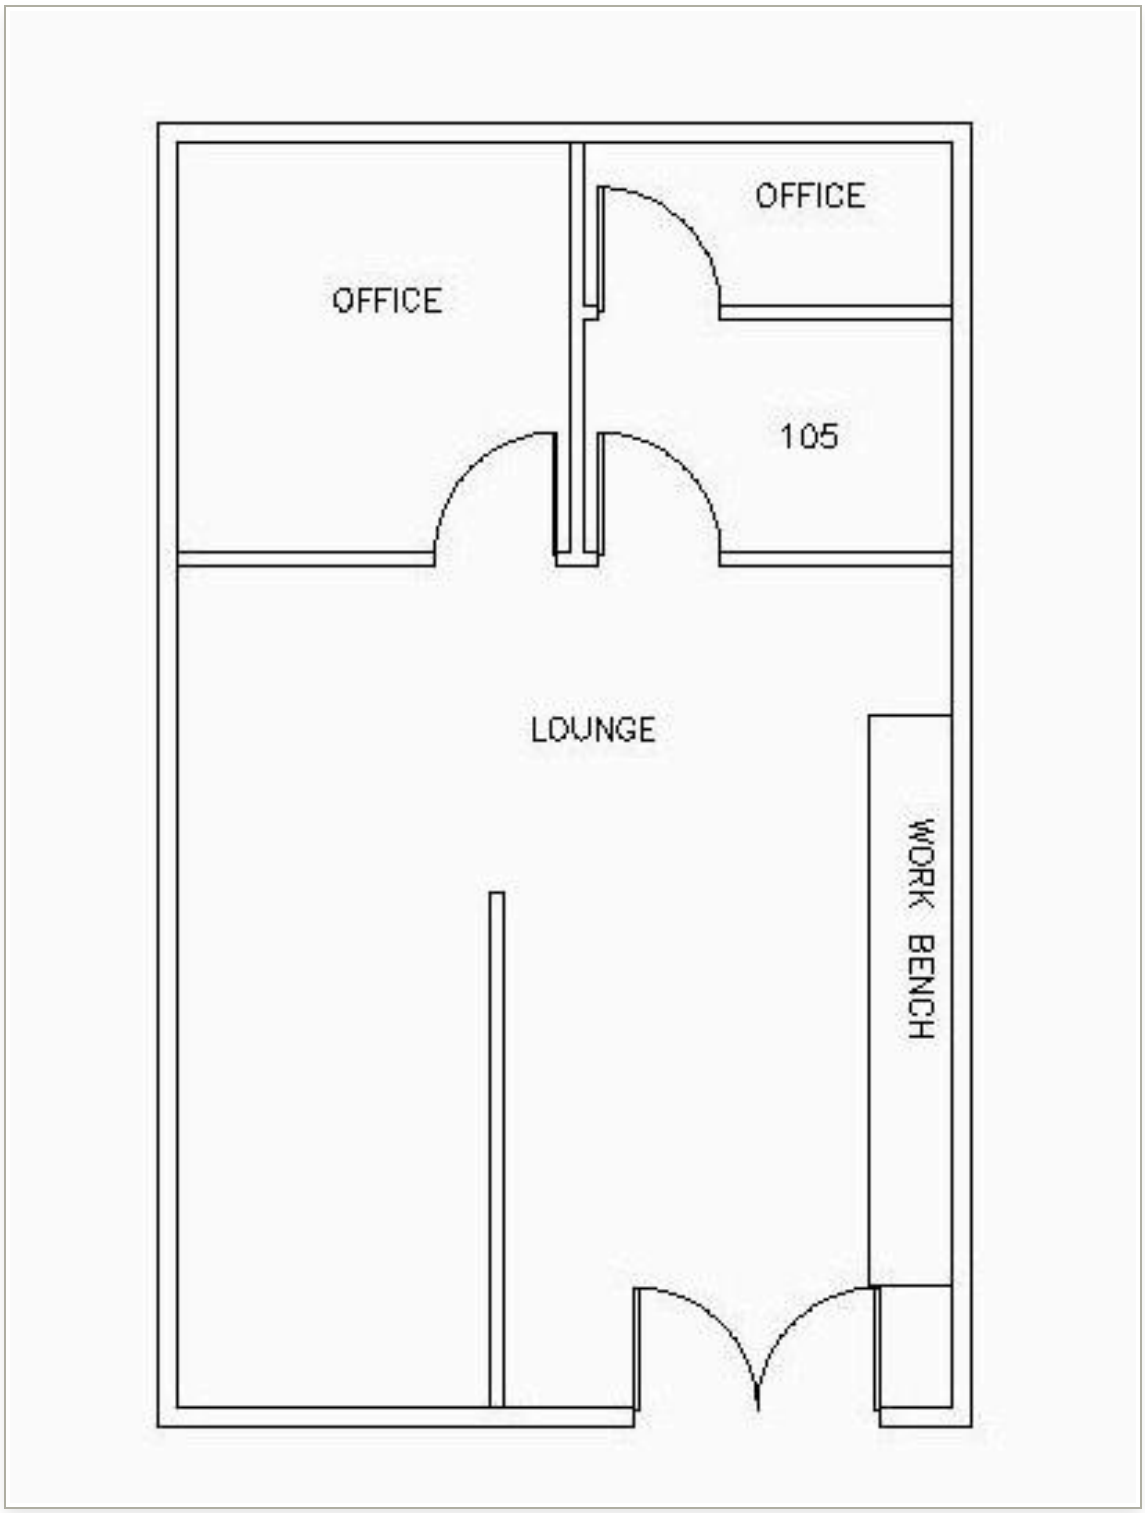


Figure 1: *Equipment Operations*