McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Gym

Location ID: B075

Gymnasium facility used for various indoor sports. Contains a court area marked as a full-sized volleyball court and an undersized basketball court.



Photo 1: *Gym*

General Structure Information



Automatic External Defibrillator (AED) Locations

This building contains one or more AED devices that may be used in the event of life-threatening cardiac arrhythmia.

- **Mounted in inner entrance near Rock Wall.**

Usage	Gymnasium
Occupancy Group	A-3 Assembly
Maximum Occupancy	248
Construction Type	Type V, N, combustible; insulated metal Quonset hut with wood-framed gypsum board interior partitions. Wood-framed plywood floor.
Year Constructed	1959
Dimensions	40' x 100'

Floor Area

Floor	Area
Floor 1	4,000 sq ft
Total	4,000 sq ft

HVAC System

Heating	One Precision Monolithic forced-air, oil-burning furnace (500,000 Btu/hr).
Air Handling Units	None
Fuel Tank	1,000 gallon fuel tank

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: Urinals: Showers: 0 Water Fountains: 0
Water Heater	None

Electrical Service

Service Feeder	Feeder C

Electrical Service	208/120V, 3PH, 125A main

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat detectors, pull station, alarm horns
Heat Detectors	Located throughout building
Suppression Type	Automatic dry-chemical fire extinguisher located over furnace.

Floorplans

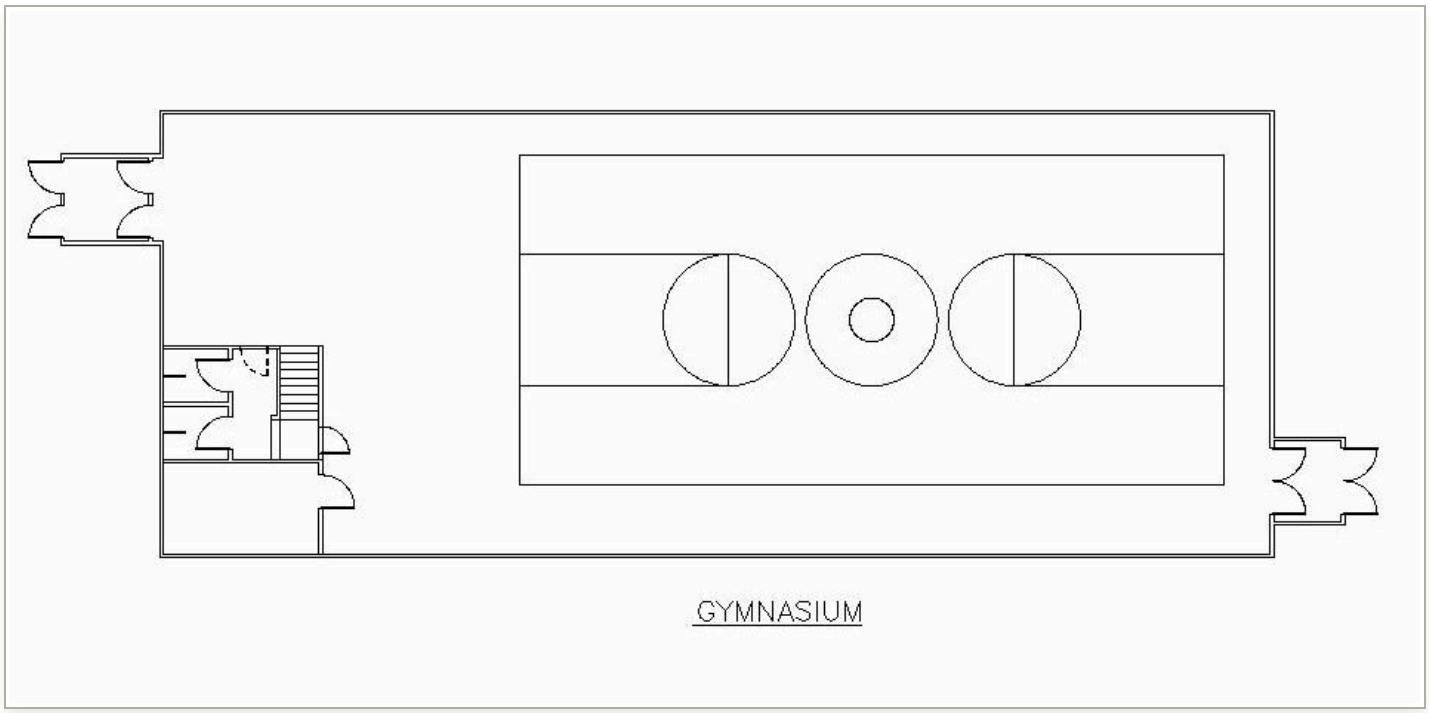


Figure 1: *Gym*