McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Areobics & Exercise Room

Location ID: B078

Single-story building used as an exercise gym, housing aerobic and Nautilus equipment such as stair climbers and treadmills. The building includes a restroom and janitor's closet.



Photo 1: *Areobics & Exercise Room*

General Structure Information



Automatic External Defibrillator (AED) Locations

This building contains one or more AED devices that may be used in the event of life-threatening cardiac arrhythmia.

- **Mounted on right-hand wall after the entrance door**

Usage	Exercise Facility
Occupancy Group	B-2 Exercise room
Maximum Occupancy	27
Construction Type	Type V, N, combustible; T-5 wood insulated plywood panel system, wood-framed plywood floor, wood-framed gypsum board interior partitions.
Year Constructed	1960
Dimensions	20' x 76'

Floor Area

Floor	Area
Floor 1	1,520 sq ft
Total	1,520 sq ft

HVAC System

Heating	One Jackson-Church forced-air, oil-burning unit (250,000 Btu/hr)
Air Handling Units	None
Fuel Tank	300 gallon fuel tank

Water and Sewer

Water Service	2' stub off of a 4" main
Sewer Service	4" stub off of a 4" main
Connections	Sinks: 2 Toilets: 1 Urinals: 1 Showers: 0 Water Fountains: 1
Water Heater	6 gallon electric water heater

Electrical Service

Service Feeder	Feeder B

Electrical Service	208/120V, 3PH

Fire System

Fire Panel Type	King-Fisher KF-24-DS control panel and KFRTI-WP-8 radio interface/transmitter panel, heat detectors, pull stations, and alarm horn.
Suppression Type	Automatic dry-chemical fire extinguisher in furnace room.

Floorplans

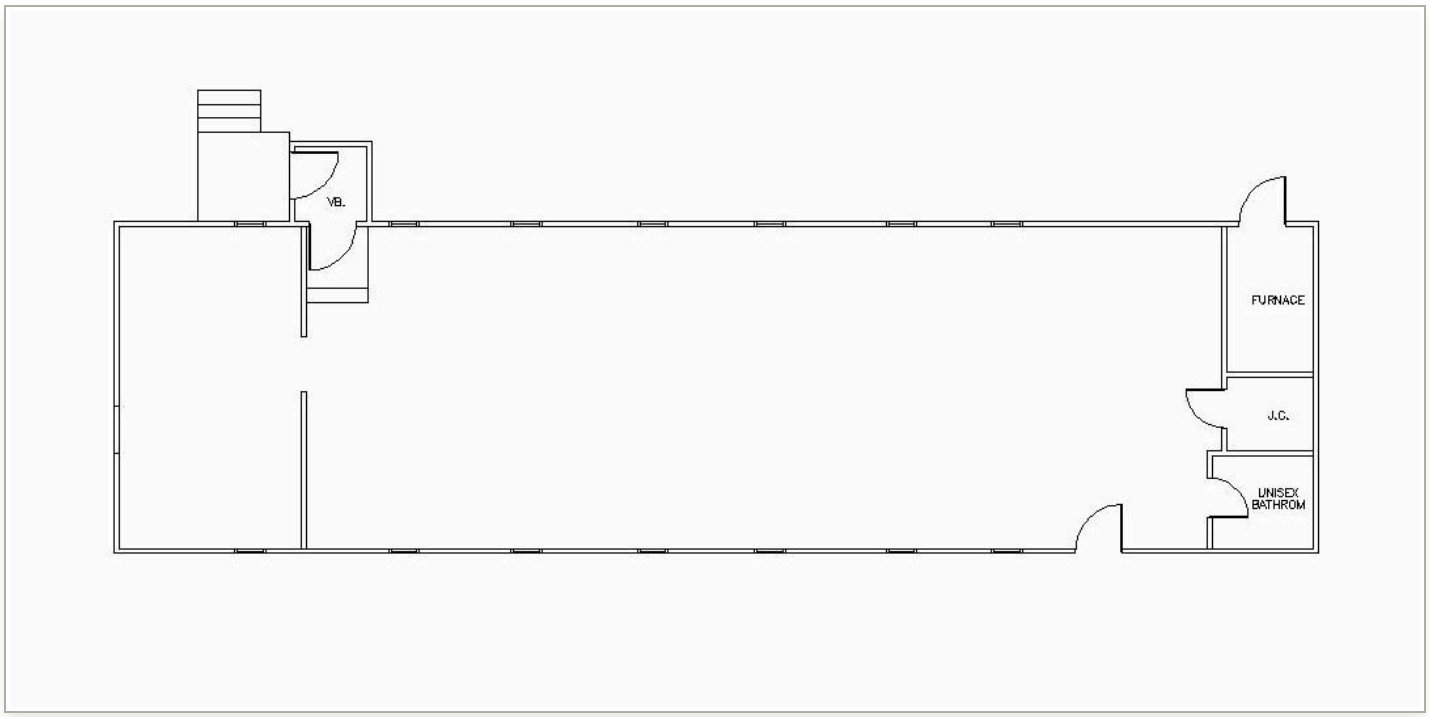


Figure 1: *Areobics & Exercise Room*